أزيدك للمقاولات العامة
وأعمال الإلكتروميكانيكال
Azeidk for General Contracting & MEP Solutions

Title

Material Submittal for Foam

Brand

Safe Guard

SAFE GUARD®

Equip to face fire

C.R.4030244617
012 6880407/0581444606
info@azeidk.com
www.azeidk.com

المقر الرئيسي - جدة:
برج الصفا، مقابل عزيز مول، أعلى شركة عبداللطيف جميل، مبنى A، الدور الثالث، مكتب رقم ٣٤٠.
الرياض:
حي الملز، شارع صلاح الدين، بجوار شركة زين، الدور الثاني، مكتب رقم ١٦.

Index

- *Technical Data Sheets (Catalogues).*
- *UL Certificates.*
- *Shipment Conformity Certificate.*
- *Previous Approvals.*
- *Azeidk Co. Documents.*

C.R.4030244617
012 6880407/0581444606
info@azeidk.com
www.azeidk.com
المقر الرئيسي - جدة:
برج الصفا، مقابل عزيز مول، أعلى شركة عبداللطيف جميل، مبنى A، الدور الثالث، مكتب رقم ٣٤٠.
الرياض:
حي الملز، شارع صلاح الدين، بجوار شركة زين، الدور الثاني، مكتب رقم ١٦.

أزيدك للمقاولات العامة
وأعمال الإلكتروميكانيكال
Azeidk for General Contracting & MEP Solutions

SAFE GUARD®
Equip to face fire

Technical Data Sheets (Catalogues).

C.R.4030244617
012 6880407/0581444606
info@azeidk.com
www.azeidk.com

المقر الرئيسي - جدة:
برج الصفا، مقابل عزيز مول، أعلى شركة عبداللطيف جميل، مبنى A، الدور الثالث، مكتب رقم ٣٤٠.
الرياض:
حي الملز، شارع صلاح الدين، بجوار شركة زين، الدور الثاني، مكتب رقم ١٦.

TECHNICAL DATA SHEET

PRODUCT : AQUEOUS FILM FORMING FOAM (AFFF)
BRAND NAME : SAFEGUARD AFFF-3%
MANUFACTURED BY : Safeguard Fire Protections Pvt. Ltd,
B-3, Mangolpuri Indl. Area, Phase-II, Delhi-110083.

PRODUCT DESCRIPTION:

Safeguard brand AFFF is a superior quality firefighting foam concentrate for extinguishing and securing flammable hydrocarbon and select oxygenated fuel based fires. It is mainly formulated by hydrocarbon surfactants, C6 based fluorocarbon surfactants, solvents, preservatives and buffers that are used to effectively extinguish hydrocarbon fuel based fires and have a secondary benefit of preventing re-ignition.

FEATURES:

i. It produced a thin aqueous film which spreads across the surface of the fuel, separating the fuel from oxygen. It has superior knock down, burn back properties and post fire security.
ii. It is suitable for extinguishing & securing flammable hydrocarbon fuel fires as 3%.
iii. It can be used with fresh, brackish & sea water. It is compatible with all dry chemical powders extinguishing agent.

APPLICATIONS:

It is used in high risk areas where various types of hydrocarbon fuels and chemicals are stored, processed, or transported. Typical applications include fuel storage tanks, process areas, power stations, marine terminals and offshore platforms.

PROPORTIONING:

SAFEGUARD AFFF-3% can be correctly proportioned using most conventional, properly calibrated, in-line proportioning equipment such as:

- Balanced and in-line balanced pressure pump proportioners
- Balanced pressure bladder tanks and ratio flow controllers
- Around-the-pump type proportioners
- Fixed or portable in-line venturi type proportioners
- Hand line nozzles with fixed eductor/pick-up tubes

TYPICAL PHYSICAL & CHEMICAL PROPERTIES:

- Appearance : Amber liquid
- pH : 6.5 – 8.0
- Freezing point : < (-) 6^0C
- Expansion : 7 - 12
- 25% drainage time : > 120 sec
- Viscosity : < 20 cps
- Spreading coefficient : > 3.0
- Fire performance : Passes as per relevant specification

TECHNICAL DATA SHEET

MIXING RATIO: AFFF-3% shall be diluted with water as 97 parts water & 3 parts AFFF

COMPATIBILITY:
SAFEGUARD AFFF is compatible with Dry Chemical Powder for firefighting.

ENVIRONMENTAL IMPACT:
SAFEGUARD AFFF-3% is biodegradable, low in toxicity. It and can be treated in sewage treatment plants in consultation with relevant local authority.

STORAGE & HANDLING:

The storage place shall be free from dampness and shall be well ventilated and the containers shall not be directly exposed to the sunrays. The HDPE container (20/30 ltr capacity) shall be preferably stacked in single layer and shall not exceed more than 2 layers.

Recommended storage temperature: (-) 5^0C to 49^0C
Storage tanks for bulk storage: Foam concentrates are suitable for transferring into bulk storage tank for long term storage but these should be normally be kept full, with space (5-10% of tank volume) should be maintained for thermal expansion coefficient of material of construction and foam concentrate. Inlet pipe work should be located at the base of storage tank to avoid excessive foaming during filling. Outlet pipe work should be located above the base of the tank to avoid clogging in the event of sediment that might have formed.

Materials of construction
Storage tank should be fabricated or based with the following materials:

- Mild Steel (Uncoated): Not recommended as Protein based foam concentrates will cause initial etching which affect the tank to some extent.
- Stainless Steel: 304 and 316 (HIGHLY RECOMMENDED)
- Glass Reinforced Plastic (GRP) : Fiberglass with Isophthalic Polyester Resin, Expoxy Resin or Vinylester Resin (Premium).Not recommended for foam systems involving pressure displacement
- Polyethylene : High density cross linked polyethylene (HDPE) (HIGHLY RECOMMENDED)

MARKING/APPROVAL:
UL, EN, LR as per IMO, BIS & IRS.

CONFORMING STANDARD:
US-MIL, ICAO, FM, DEF.STAN

PACKING:
20 L, 30 L, 200 L HDPE containers or as per customer requirements.

An ISO 9001:2008 Certified Company

SAFE GUARD

Equip to face fire

MATERIAL SAFETY DATA SHEET

1. IDENTIFICATION OF THE MATERIALS AND THE COMPANY

1.1 Product Identification : SAFEGUARD , AFFF - 3% (Type - 3)

1.2 Application and Use
Fire Fighting Foam Concentrate (Fire Extinguishing agent)

1.3 Manufacturer:
SAFEGUARD FIRE PROTECTIONS PVT. LTD., B-3,Mangolpuri, Industrial Area, Phase-II, New Delhi- 110034 (India)
Mob : +91 9818272647

Emergency Telephone Number (24 hours)
For information and supply: SAFEGUARD FIRE PROTECTIONS PVT. LTD, Mob : +91 9818272647

1.4 Product Description
Solvent, Foaming surfactant & fluoro surfactants and glycol solvents.

2. COMPOSITION

Substance	Synonyms	Concentration %	Cas-No.
Di-ethylene glycol monobutyl ether	2-(2-Butoxyethoxy)ethanol	<25%	112-34-5
Hydrocarbon surfactants (Mixture)		<25%	
Fluoro surfactants (mixture)		<20%	
Water		Balance	10034-99-8

3. HAZARDS IDENTIFICATION

Emergency overview WARNING! Causes skin and eye irritation.

Potential health effects
Routes of exposure Eye contact. Skin contact. Inhalation. Ingestion.
Eyes Do not get this material in contact with eyes.

Skin	Avoid contact with the skin. Frequent or prolonged contact may defat and dry the skin, leading to discomfort and dermatitis.
Inhalation	Do not breathe vapor. May be irritating.
Ingestion	Not a likely route of entry. Do not ingest.
Target organs	Eyes.RESPIRATORY SYSTEM.Skin.Central nervous system.
Chronic effects	Frequent or prolonged contact may defat and dry the skin, leading to discomfort and dermatitis.
Signs and symptoms	Irritation of nose and throat.Irritation of eyes and mucous membranes.Defatting of the skin. Rash.Skin irritation.

4. FIRST AID MEASURES

4.1 General

First Aid - Skin: Remove contaminated clothing. If there is skin contact, wash immediately with plenty of clean, gently flowing water. If persistent irritation occurs, obtain medical attention.
First Aid - Eye: If there is eye contact, wash immediately with plenty of clean, gently flowing water for 10 minutes.
First Aid - Ingestion: If ingestion is suspected, do not induce vomiting. Send casualty to hospital immediately.
First Aid - Inhalation: Remove casualty from exposure. If there is breathing difficulty or cough, keep patient at rest seated in position of maximum comfort.

5. FIRE FIGHTING MEASURES

General Hazards
Fire fighting measures are not applicable as it is a fire extinguishing medium.

6. ACCIDENTAL RELEASE MEASURES

Personal precautions: Avoid contact with skin, eyes and clothing. Do not breathe mists, aerosols.
Personal protection: Wear protective clothing specified for normal operations.
Environmental precautions: SPILLAGE: The practice of washing spills into drains should be avoided if at all possible and should under no circumstances be allowed without first consulting the local Water Authority and the Environment Agency.
Clean-up methods - small spillage: Absorb or contain liquid with sand, earth or spill control material. Shovel up and place in a labelled, sealable container for subsequent safe disposal.

7. HANDLING AND STORAGE

Handling	Do not get this material in contact with eyes. Avoid contact with skin. Avoid prolonged exposure. Handle and open container with care.
Storage	Store in cool place. Store in a well-ventilated place. Keep container tightly closed. Keep out of the reach of children. Use care in handling / storage.

8. EXPOSURE CONTROL/PERSONAL PROTECTION

Personal protective equipment

Eye / face protection	Do not get in eyes. Wear approved chemical safety glasses or goggles where eye exposure is reasonably probable.
Skin protection	Wear appropriate chemical resistant clothing. Chemical resistant gloves.
Respiratory protection	When workers are facing concentrations above the exposure limit they must use appropriate certified respirators.
General hygiene considerations	Handle in accordance with good industrial hygiene and safety practice. When using, do not eat, drink or smoke. Avoid contact with skin.

---

9. PHYSICAL AND CHEMICAL PROPERTIES

Physical state:	Liquid	pH at 20$_0$C: 6.5 – 8.5
Colour:	Clear pale yellow	Sp. gravity: 1.0-1.04
Odour:	Organic	Freeze Point: (-)5^0 C
		Flash Point: >98$_0$C
		Flammability: Not flammable
		Solubility: Miscible with water in all proportions
		Viscosity at 20$_0$C: <5cst

---

10. STABILITY/REACTIVITY

Chemical stability	Material is stable under normal conditions.
Conditions to avoid	None known.
Incompatible materials	Alkaline metals. Strong acids, alkalies and oxidizing agents.
Hazardous decomposition products	Nitrogen oxides (NOx). Sulfur oxides. Carbon oxides

.---

11. TOXICOLOGICAL INFORMATION

Inhalation
Inhalation of hazardous amounts is unlikely when used as intended. May cause irritation to respiratory tract when inhaled.
Ingestion
Low oral risk when used as intended. May cause nausea, vomiting and diarrhoea when ingested.
Contact to eyes or skin
Low risk if appropriate precaution measures are taken (see section 6). May cause skin and eye irritation when in contact with eyes or skin.

---

12. ECOLOGICAL INFORMATION

Ecotoxicity: Not expected to be harmful to aquatic organisms.

Environmental effects	An environmental hazard cannot be excluded in the event of unprofessional handling or disposal.
Persistence and degradability	Not available.
Carcinogenicity	This product is not considered to be a carcinogenicity as per OSHA.

13. DISPOSAL CONSIDERATIONS

Disposal :

Waste from residues / unused products: Waste should be disposed of in accordance with local regulation.

14. TRANSPORT INFORMATION

DOT
Not regulated as dangerous goods.

15. REGULATORY INFORMATION

As per local statutory requirements.

16. OTHER INFORMATION

As per NFPA Rating

Health - 1
Flammability - 0

DISCLAIMER: This information is based on our current knowledge and is intended to describe the product for the purposes of health,safety and environmental requirements only. It should not therefore be construed as guaranteeing any specific property of the product.

أزيدك للمقاولات العامة
وأعمال الإلكتروميكانيكال
Azeidk for General Contracting & MEP Solutions

SAFE GUARD®
Equip to face fire

UL Certificates.

C.R.4030244617
012 6880407/0581444606
info@azeidk.com
www.azeidk.com

المقر الرئيسي - جدة:
برج الصفا، مقابل عزيز مول، أعلى شركة عبداللطيف جميل، مبنى A، الدور الثالث، مكتب رقم ٣٤٠.
الرياض:
حي الملز، شارع صلاح الدين، بجوار شركة زين، الدور الثاني، مكتب رقم ١٦.

GFGV.EX26577 - Foam Liquid Concentrates

Foam Liquid Concentrates

Safeguard Fire Protections Private Limited
B-3
Mangolpuri Industrial Area
Phase 2, Delhi 110034 India

EX26577

SAFEGUARD AR-AFFF 3%/3%, nominal 3 percent Alcohol Resistant Aqueous Film Forming Foam, +35°F min storage and use temperature. Hydrocarbon fuels at 3 percent. Polar solvent fuels at 3 percent.

SAFEGUARD AFFF 1%, nominal 1 percent Aqueous Film Forming Foam, +20°F minimum storage and use temperature. Hydrocarbon fuels only.

SAFEGUARD AFFF 3%, nominal 3 percent Aqueous Film Forming Foam, +20°F minimum storage and use temperature. Hydrocarbon fuels only.

SAFEGUARD AFFF 6%, nominal 6 percent Aqueous Film Forming Foam, +20°F minimum storage and use temperature. Hydrocarbon fuels only.

SAFEGUARD BIOSOLV^{C6} AFFF 3%, nominal 3 percent Aqueous Film Forming Foam, +20°F minimum storage and use temperature. Hydrocarbon fuels only.

SAFEGUARD BIOSOLV^{C6} AFFF 6%, nominal 6 percent Aqueous Film Forming Foam, +20°F minimum storage and use temperature. Hydrocarbon fuels only.

SAFEGUARD BIOSOLV^{C6} AR-AFFF 3%/3%, nominal 3 percent Alcohol Resistant Aqueous Film Forming Foam, +35°F min storage and use temperature. Hydrocarbon fuels at 3 percent. Polar solvent fuels at 3 percent.

SAFEGUARD BIOSOLV^{C6} AR-AFFF 3%/6% , nominal 3 or 6 percent Alcohol Resistant Aqueous Film Forming Foam, +350F minimum storage and use temperature. Hydrocarbon fuels only at 3 percent. Polar solvent fuels at 6 percent.

SAFEGUARD BIOSOLV^{C6} FP 3%, nominal 3 percent Fluroprotein Foam, +20°F minimum storage and use temperature. Hydrocarbon fuels only.

SAFEGUARD BIOSOLV^{C6} FFFP 3%, nominal 3 percent Film Forming Fluroprotein Foam, +20°F minimum storage and use temperature. Hydrocarbon fuels only.

Foam concentrates for use with the following equipment.

SAFEGUARD AR-AFFF 3%/3%, 3 PERCENT

PROPORTIONERS - PORTABLE IN-LINE INDUCTORS

ANGUS FIRE LTD, Model UNI225, 2-1/2 in. size, set at 3, inlet pressure of 100 psi with 50 ft(15m) of 2-1/2 in. hose between inductor and ANGUS FIRE LTD, Model F225HU nozzle.

NOZZLES

Description	Size In.	Inlet Pressure psi
ANGUS FIRE LTD, Model F225HU	2-1/2	60

PROPORTIONERS - FIXED IN-LINE INDUCTORS

Description	Size In.	Orifice Diam In. (mm)	Inlet Pressure psi	Back Pressure psi
ANGUS FIRE LTD, Model IND-40	1-1/2	0.19 (4.8)	91	56

FIXED FOAM DISCHARGE OUTLETS

Description	Orifice Diam In. (mm)	Inlet Pressure psi
ANGUS FIRE LTD, Model TPS-50MKV	0.59 (15)	56

Where:

Fuel	Min Application Rate, gpm/ft^2
Alc (Alcohols)	0.20

SAFEGUARD AFFF 1%, 1 PERCENT

PROPORTIONERS - PORTABLE IN-LINE INDUCTORS

ANGUS FIRE LTD, Model UNI225, 2-1/2 in. size, set at 1, inlet pressure of 100 psi with 50 ft(15m) of 2-1/2 in. hose between inductor and ANGUS FIRE LTD, Model F225U nozzle.

NOZZLES

Description	Size In.	Inlet Pressure psi
ANGUS FIRE LTD, Model F225U	2-1/2	60

SAFEGUARD AFFF 3%, 3 PERCENT

PROPORTIONERS - PORTABLE IN-LINE INDUCTORS

ANGUS FIRE LTD, Model UNI225, 2-1/2 in. size, set at 3, inlet pressure of 100 psi with 50 ft(15m) of 2-1/2 in. hose between inductor and ANGUS FIRE LTD, Model F225U nozzle.

PROPORTIONERS - FIXED IN-LINE INDUCTORS

Description	Size In.	Orifice Diam In. (mm)	Inlet Pressure psi	Back Pressure psi
ANGUS FIRE LTD, Model IND-40	1-1/2	0.19 (4.8)	100	60

NOZZLES

Description	Size In.	Inlet Pressure psi
ANGUS FIRE LTD, Model F225U	2-1/2	60

FOAM WATER SPRINKLERS

HD Fire Protection Pvt Ltd, Model F1 pendent style, 30 psi minimum pressure, hydrocarbon fuels only.

SAFEGUARD AFFF 6%, 6 PERCENT

PROPORTIONERS - PORTABLE IN-LINE INDUCTORS

ANGUS FIRE LTD, Model UNI225, 2-1/2 in. size, set at 6, inlet pressure of 100 psi with 50 ft(15m) of 2-1/2 in. hose between inductor and ANGUS FIRE LTD, Model F225U nozzle.

NOZZLES

Description	Size In.	Inlet Pressure psi
ANGUS FIRE LTD, Model F225U	2-1/2	60

SAFEGUARD BIOSOLV^{C6} AFFF 3%, 3 PERCENT

PROPORTIONERS - PORTABLE IN-LINE INDUCTORS

ANGUS FIRE LTD, Model UNI225, 2-1/2 in. size, set at 3, inlet pressure of 100 psi with 50ft(15m) of 2-1/2 in. hose between inductor and ANGUS FIRE LTD, Model F225HU nozzle.

PROPORTIONERS - FIXED IN-LINE INDUCTORS

Description	Size In.	Orifice Diam In	Inlet Pressure psi	Back Pressure psi
Angus Model IND 40	1-1/2	0.18	100	55



NOZZLES

Description	Size In.	Inlet Pressure psi
ANGUS FIRE LTD, Model F225HU	2-1/2	60

FOAM MONITORS

Monitor Model	Nozzle Model	Type	Nozzle Inlet Pressure psi	Solution Flow, gpm
Hd Fire Protect Pvt, Varun 443	Varsha H4-V 500-750-100	Self-Inducting	100	500
		Self-Inducting	100	750
		Self-Inducting	100	1000

PROPORTIONERS-BLADDER TANK WITH CONTROLLER

HD FIRE PROTECT PVT LTD bladder tanks with the following controllers:

Description	Controller Size In.	Orifice Size In.	Flow GPM
HD FIRE PROTECT PVT LTD, Model RCW-S	0.24	0.24	56-79

FOAM WATER SPRINKLERS

HD FIRE PRTECTION PVT. LTD., Model F1 pendent style, 30 psi minimum pressure, hydrocarbon fuels only.

SAFEGUARD BIOSOLV^{C6} AFFF 6%, 6 PERCENT

PROPORTIONERS - PORTABLE IN-LINE INDUCTORS

ANGUS FIRE LTD, Model UNI225, 2-1/2 in. size, set at 6, inlet pressure of 100 psi with 50ft(15m) of 2-1/2 in. hose between inductor and ANGUS FIRE LTD, Model F225HU nozzle.

NOZZLES

Description	Size In.	Inlet Pressure psi
ANGUS FIRE LTD, Model F225HU	2-1/2	60

SAFEGUARD BIOSOLV^{C6} AR-AFFF 3%/3% , 3 PERCENT

PROPORTIONERS - PORTABLE IN-LINE INDUCTORS

ANGUS FIRE LTD, Model UNI225, 2-1/2 in. size, set at 6, inlet pressure of 100 psi with 50ft(15m) of 2-1/2 in. hose between inductor and ANGUS FIRE LTD, Model F225HU nozzle.

PROPORTIONERS - FIXED IN-LINE INDUCTORS

Description	Size In.	Orifice Diam In. (mm)	Inlet Pressure psi	Back Pressure psi
ANGUS FIRE LTD, Model IND-40	1-1/2	0.19(4.8)	91	57

NOZZLES

Description	Size In.	Inlet Pressure psi
ANGUS FIRE LTD, Model F225HU	2-1/2	60

FIXED FOAM DISCHARGE OUTLETS

Description	Orifice Diam In. (mm)	Inlet Pressure psi
ANGUS FIRE LTD, Model TPS-50MKV	0.59(15)	57

Where:

Fuel	Min Application Rate, GPM/Sq Ft
Alc (Alcohols)	0.10

SAFEGUARD BIOSOLV^{C6} AR-AFFF 3%/6%, 3 PERCENT

PROPORTIONERS - PORTABLE IN-LINE INDUCTORS

ANGUS FIRE LTD, Model UNI225, 2-1/2 in. size, set at 3, inlet pressure of 100 psi with 50ft(15m) of 2-1/2 in. hose between inductor and ANGUS FIRE LTD, Model F225HU nozzle.

NOZZLES

Description	Size In.	Inlet Pressure psi
ANGUS FIRE LTD, Model F225HU	2-1/2	60

SAFEGUARD BIOSOLV^{C6} AR-AFFF 3%/6%, 6 PERCENT

PROPORTIONERS - FIXED IN-LINE INDUCTORS

Description	Size In.	Orifice Diam In. (mm)	Inlet Pressure psi	Back Pressure psi
ANGUS FIRE LTD, Model IND-40	1-1/2	0.36(9.2)	91	57

FIXED FOAM DISCHARGE OUTLETS

Description	Orifice Diam In. (mm)	Inlet Pressure psi
ANGUS FIRE LTD, Model TPS-50MKV	0.59(15)	57

Where:

Fuel	Min Application Rate, GPM/Sq Ft
Alc (Alcohols)	0.10

SAFEGUARD BIOSOLV^{C6} FP 3%, 3 PERCENT

PROPORTIONERS - PORTABLE IN-LINE INDUCTORS

Angus Fire, Model UNI-225, 2-1/2 in. size, set at 3, inlet pressure of 100 psi with 49 feet of 2-1/2 in. hose between inductor and Angus Fire, Model F225HU nozzle.

NOZZLES

Description	Size In.	Inlet Pressure psi
Angus Fire, Model F225HU	2-1/2	57



SAFEGUARD BIOSOLV^{C6} FFFP 3%, 3 PERCENT

PROPORTIONERS - PORTABLE IN-LINE INDUCTORS

Angus Fire, Model UNI-225, 2-1/2 in. size, set at 3, inlet pressure of 100 psi with 49 feet of 2-1/2 in. hose between inductor and Angus Fire, Model F225HU nozzle.

NOZZLES

Description	Size In.	Inlet Pressure psi
Angus Fire, Model F225HU	2-1/2	57

Trademark and/or Tradename: SAFE GUARD Equip to face fire

Last Updated on 2021-11-02

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under UL's Follow-Up Service. Only those products bearing the UL Mark should be considered to be Certified and covered under UL's Follow-Up Service. Always look for the Mark on the product.

UL permits the reproduction of the material contained in the Online Certification Directory subject to the following conditions: 1. The Guide Information, Assemblies, Constructions, Designs, Systems, and/or Certifications (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from the Online Certifications Directory with permission from UL" must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "© 2021 UL LLC"

SAFEGUARD FIRE PROTECTIONS PVT. LTD. NEW DELHI 110034

UL Product iQ™

GGBS2.EX26576 - Containers for Foam Liquid Concentrates - Component

Containers for Foam Liquid Concentrates - Component

See General Information for Containers for Foam Liquid Concentrates - Component

SAFEGUARD FIRE PROTECTIONS PRIVATE LIMITED EX26576
B-3
MANGOLPURI INDUSTRIAL AREA
PHASE 2, NEW DELHI 110034 INDIA
20, 30 and 200 liter blue containers.

Marking: Company name or trademark SAFE GUARD Equip to face fire , FIRE GUARD FIREGUARD GLOBAL , month and year of manufacture and the UL Component Recognition Mark .

Last Updated on 2020-06-04

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under UL's Follow-Up Service. Only those products bearing the UL Mark should be considered to be Certified and covered under UL's Follow-Up Service. Always look for the Mark on the product.

UL permits the reproduction of the material contained in the Online Certification Directory subject to the following conditions: 1. The Guide Information, Assemblies, Constructions, Designs, Systems, and/or Certifications (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from the Online Certifications Directory with permission from UL" must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "© 2020 UL LLC"

SAFEGUARD FIRE PROTECTIONS PVT. LTD. NEW DELHI 110034

أزيدك للمقاولات العامة
وأعمال الإلكتروميكانيكال
Azeidk for General Contracting & MEP Solutions

SAFE GUARD®
Equip to face fire

Shipment Conformity Certificate.

C.R.4030244617
012 6880407/0581444606
info@azeidk.com
www.azeidk.com

المقر الرئيسي - جدة:
برج الصفا، مقابل عزيز مول، أعلى شركة عبداللطيف جميل، مبنى A، الدور الثالث، مكتب رقم ٣٤٠.
الرياض:
حي الملز، شارع صلاح الدين، بجوار شركة زين، الدور الثاني، مكتب رقم ١٦.

شهادة مطابقة للمنتجات الخاضعة للوائح

Certificate of conformity for regulated products

الخدمات دليل الخدمة
CB logo

We (.....SGS Gulf Ltd ROHQ.....) office number (.....00204.....) are bearing full responsability for the product described below is conforms to the conformity assessment procedure Conduct the relevant technical regulations and standards which mentioned during this certificate.

Certificate Number	19117-002-24-1627875	Issue Date	04/11/2024	Expire Date	04/11/2025
Certificate Type	Product Conformity Certificate (COC)	Commercial Registration No	4030267410 / 7012025560		
Establishment Address	5065 2 8073-22335 جدة				

Product and Manufacturer Data			
Model Name	abc powder	Trade Mark	safe guard
Product Name	powder for fire		

Product Description

EN

دليل الخدمة


الخدمات





EN
دليل الخدمة
الخدمات

Country of origin	India

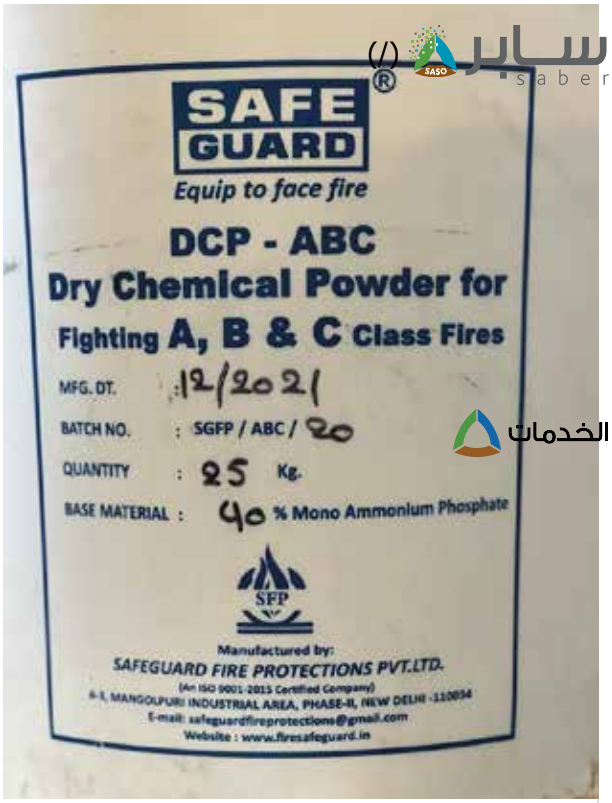

HS Code	381300900000
Technical Regulation	Technical Regulation for Fire Fighting Equipments and Materials
Manufacturer name	safeguard fire protections PVT.Ltd

Product test data	
Report number	
Report Date	
Decision of confomity assessment	Product Approved

CB Organization Office Responsabile Manager signature	07/11/2024 03:28	CB Organization Office Stamp
		

EN
دليل الخدمة
الخدمات
سابر saber

تفاصيل أرقام الموديلات

تفاصيل

عودة (/ContactOfficer/MyRequests/HRRequests)

أزيدك للمقاولات العامة
وأعمال الإلكتروميكانيكال
Azeidk for General Contracting & MEP Solutions

SAFE GUARD®
Equip to face fire

Previous Approvals.

C.R.4030244617
012 6880407/0581444606
info@azeidk.com
www.azeidk.com

المقر الرئيسي - جدة:
برج الصفا، مقابل عزيز مول، أعلى شركة عبداللطيف جميل، مبنى A، الدور الثالث، مكتب رقم ٣٤٠.
الرياض:
حي الملز، شارع صلاح الدين، بجوار شركة زين، الدور الثاني، مكتب رقم ١٦.

AAW & PARTNERS

المملكة العربية السعودية
المراسم الملكية

المحترفون المتطورة
Advance Professionals

ROJECT NAME: مشروع انشاء مطبخ مركزي نموذجي بقصر الزاهر بجدة **LOCATION:** قصر الزاهر – جدة	PAGE 01 OF 01

DOCUMENT TRANSMITTAL/ SUBMITTAL	المستندات المقدمة
REF. NO.: 154 رقم:	SUBMITTAL NO: MEC-MS-154R0
DATE: 22/07/2024 تاريخ :	☒ New Submittal ☐ Re- Submittal

DISCIPLINE:

CIVIL ☐ ARCHITECTURAL ☐ STRUCTURAL ☐ **MECHANICAL** ☒ PLUMBING ☐ ELECTRICAL ☐ GENERAL ☐

ENCLOSURES (مرفقات)

Drawings ☐ مخططات material submittal ☒ مواد catalogs ☐ كتالوج Request for inspection ☐ طلب استلام أعمال

Specification ☒ مواصفات sample ☐ عينة sketch ☐ سكتش supplier ☐ مورد lab ☐ معمل - مختبر

test date ☐ بيانات اختبار schedule ☐ جداول report ☐ تقارير clarification ☐ توضيحات others ☐ اخرى

DRWG. NO. مخطط رقم SPECS. NO: رقم المواصفة	رقم المراجعة REV.	بيـــــان DESCRIPTION	عدد النسخ NO. OF COPIES
	0	FIREFIGHTING Foam System (Bladder tank & Material)	1
		ATTACHED: TECHNICAL DATA SHEET	
		ATTACHED: PREVIOUS APPROVALS	

ANY REVIEW/APPROVAL FROM THE ENGINEER SHALL NOT RELIEVE THE CONTRACTOR OF HIS OBLIGATION TO PERFORM THE WORK IN ACCORDANCE WITH THE CONTRACT DOCUMENTS.

شركة المحترفون المتطورة
للاستشارات الهندسية

ITEM NO BOQ: البند بجدول الكميات أو العقد:	LOCATION / USE مكان الاستخدام: قصر الزاهر جدة
CO-ORDINATOR: Name: AHMED SAMEH Signature & Date:	**REVIEWED BY:** Name: Ghadi Waznah Signature & Date: مشروع المطبخ المركزي - قصر الزاهر إدارة المشاريع

CONSULTANT REPRESENTATIVE APPROVAL & COMMENTS: ملاحظات وتوصيات المهندس الاستشاري

- موافق إعتماد شركة أزيدان لتوريد نظام fire fighting foam system
- Tank (Falcon Solid) & Safe Board شركة UL
- مع الالتزام بجداول الكميات ومخططات الرفاع المرفق العقد.

NAME/SIGNATURE: Alwaleed Abdelsalam DATE/STAMP: 30/7/2024

ACTION CODES:

A) Approved (موافقة) B) Approved As Noted (موافقة بملاحظات) C)Revised And Re-Submit (تعديل واعادة تقييم) D)Rejected(مرفوض)

OWNER REPRESENTATIVE APPROVAL & COMMENTS:

مشروع المطبخ المركزي - مكتب استشاري هندسي (الشرائف) مجموعة مقاولات

ACTION CODES:

A) Approved (موافقة) B) Approved As Noted (موافقة بملاحظات) C)Revised And Re-Submit (تعديل واعادة تقييم) D)Rejected(مرفوض)

NAME:

إعتماد المالك	الختم

أزيدك للمقاولات العامة
وأعمال الإلكتروميكانيكال
Azeidk for General Contracting & MEP Solutions

SAFE GUARD®
Equip to face fire

Azeidk Co. Documents.

C.R.4030244617
012 6880407/0581444606
info@azeidk.com
www.azeidk.com

المقر الرئيسي - جدة:
برج الصفا، مقابل عزيز مول، أعلى شركة عبداللطيف جميل، مبنى A، الدور الثالث، مكتب رقم ٣٤٠.
الرياض:
حي الملز، شارع صلاح الدين، بجوار شركة زين، الدور الثاني، مكتب رقم ١٦.

المملكة العربية السعودية
الهيئة العليا للأمن الصناعي

الهيئة العليا للأمن الصناعي
High Commission For Industrial Security

رؤية VISION 2030
المملكة العربية السعودية
KINGDOM OF SAUDI ARABIA

وثيقة التأهيل

رقم الوثيقة: ٢٤٥٣٦٢١١٦٢٥

تاريخ إصدار الوثيقة	٢٠٢٤/١٠/٢١م	تاريخ إنتهاء الوثيقة	٢٠٢٥/١٠/٢١م
الاسم التجاري	شركة ازيدك للمقاولات العامه		
رقم السجل التجاري	٤٠٣٠٢٤٤٦١٧	موقعها الرئيسي	جدة
النشاط المرخص	مقاولات الوقاية والحماية من الحريق		
الفئة	مقاولات الوقاية والحماية من الحريق		

تصادق وترخص الهيئة العليا للأمن الصناعي لهذه المنشأة لمزاولة النشاط المذكور في هذه الوثيقة.

*هذه الوثيقة سارية للسجل التجاري الرئيسي وجميع السجلات التجارية الفرعية للمنشأة.

الهيئة العليا للأمن الصناعي
High Commission For Industrial Security





الهيئة العليا للأمن الصناعي
High Commission For Industrial Security

رخصة مزاولة نشاط

المملكة العربية السعودية
الهيئة العليا للأمن الصناعي

رقم الرخصة : ٢٣٥١٠٠٧٧٣٣٢

الإسم التجاري	شركة ازيدك للمقاولات العامه			
رقم السجل التجاري	٤٠٣٠٢٤٤٦١٧	الرقم الموحد للمنشآت(٧)	٧٠١٤١٢٦٢٦٧	
تاريخ الإصدار	١٤٤٤-٠٦-٢٦	تاريخ الإنتهاء	١٤٤٧-٠٦-٢٦	منطقة مزاولة النشاط	جدة
النشاط المرخص	البيع بالجملة لأجهزة ومعدات ومواد الوقاية والحماية من الحريق			
الأجهزة والمعدات				

تشهد الهيئة العليا للأمن الصناعي بأن المنشأة الموضحة أعلاه قد أستوفت كافة الإجراءات والإشتراطات النظامية لمزاولة النشاط الموضح أعلاه وقد أصدرت لها هذه الرخصة كمنشأة مصرح لها لمزاولة النشاط المذكور.

الهيئة العليا للأمن الصناعي
High Commission For Industrial Security



* للتحقق من صلاحية الرخصة الرجاء الدخول على منصة الهيئة العليا للأمن الصناعي https://hcis.gov.sa
* يتطلب وجود النشاط في السجل التجاري المذكور أعلاه، على ان يكون السجل التجاري ساري المفعول





الهيئة العليا للأمن الصناعي
High Commission For Industrial Security

رخصة مزاولة نشاط

المملكة العربية السعودية
الهيئة العليا للأمن الصناعي

رقم الرخصة : ٢٣٥١٠٠٧٧٣٣٢

الإسم التجاري	شركة ازيدك للمقاولات العامه			
رقم السجل التجاري	٤٠٣٠٢٤٤٦١٧	الرقم الموحد للمنشآت(٧)	٧٠١٤١٢٦٢٦٧	
تاريخ الإصدار	١٤٤٤-٠٦-٢٦	تاريخ الإنتهاء	١٤٤٧-٠٦-٢٦	منطقة مزاولة النشاط	جدة
النشاط المرخص	البيع بالجملة لأجهزة ومعدات ومواد الوقاية والحماية من الحريق			
الأجهزة والمعدات				

تشهد الهيئة العليا للأمن الصناعي بأن المنشأة الموضحة أعلاه قد أستوفت كافة الإجراءات والإشتراطات النظامية لمزاولة النشاط الموضح أعلاه وقد أصدرت لها هذه الرخصة كمنشأة مصرح لها لمزاولة النشاط المذكور.

الهيئة العليا للأمن الصناعي
High Commission For Industrial Security



* للتحقق من صلاحية الرخصة الرجاء الدخول على منصة الهيئة العليا للأمن الصناعي https://hcis.gov.sa
* يتطلب وجود النشاط في السجل التجاري المذكور أعلاه، على ان يكون السجل التجاري ساري المفعول

المملكة العربية السعودية
الهيئة العليا للأمن الصناعي

الهيئة العليا للأمن الصناعي
High Commission For Industrial Security

رؤية VISION 2030
المملكة العربية السعودية
KINGDOM OF SAUDI ARABIA

رخصة مزاولة نشاط

رقم الرخصة : ٢٣٥١٣١٠١٦٣٢

الإسم التجاري	شركة ازيدك لاجهزة السلامة				
رقم السجل التجاري	٤٠٣٢٢٦٣١٤١	الرقم الموحد للمنشآت(٧)	٧٠٣١٢٩٩٨٦٥		
تاريخ الإصدار	١٤٤٥-٠٥-٢٧	تاريخ الإنتهاء	١٤٤٨-٠٥-٢٧	منطقة مزاولة النشاط	الطائف
النشاط المرخص	البيع بالتجزئة لمعدات الإطفاء والإنقاذ				
الأجهزة والمعدات					

تشهد الهيئة العليا للأمن الصناعي بأن المنشأة الموضحة أعلاه قد أستوفت كافة الإجراءات والإشتراطات النظامية لمزاولة النشاط الموضح أعلاه وقد أصدرت لها هذه الرخصة كمنشأة مصرح لها لمزاولة النشاط المذكور.

* للتحقق من صلاحية الرخصة الرجاء الدخول على منصة الهيئة العليا للأمن الصناعي https://hcis.gov.sa
* يتطلب وجود النشاط في السجل التجاري المذكور أعلاه، على ان يكون السجل التجاري ساري المفعول

المملكة العربية السعودية
وزارة الداخلية
الهيئة العليا للأمن الصناعي
إدارة التراخيص الأمنية المركزية

رؤية VISION 2030
المملكة العربية السعودية
KINGDOM OF SAUDI ARABIA

رخصة مزاولة نشاط

رقم الرخصة : ٢٣٠٢١٠٧٩٣٦٧

الإسم التجاري	شركة أزيدك لأجهزة السلامة			
رقم السجل التجاري	٤٠٣٠٢٦٧٤١٠	الرقم الموحد للمنشآت(٧)	٧٠١٢٠٢٥٥٦٠	
تاريخ الإصدار	١٤٤٤-٠٨-٠٦	تاريخ الإنتهاء	١٤٤٧-٠٨-٠٦	منطقة مزاولة النشاط	جدة
النشاط المرخص	تركيب وصيانة أجهزة ومعدات الإطفاء			
الأجهزة والمعدات				

تشهد إدارة التراخيص الأمنية المركزية بأن المنشأة الموضحة أعلاه قد أستوفت كافة الإجراءات والإشتراطات النظامية لمزاولة النشاط الموضح أعلاه وقد أصدرت لها هذه الرخصة كمنشأة مصرح لها لمزاولة النشاط المذكور.

أمين عام الهيئة العليا للأمن الصناعي
عقيد مهندس/ عادل بن زايد العتيبي

* للتحقق من صلاحية الرخصة الرجاء الدخول على منصة الهيئة العليا للأمن الصناعي https://hcis.gov.sa
* يتطلب وجود النشاط في السجل التجاري المذكور أعلاه، على ان يكون السجل التجاري ساري المفعول

المملكة العربية السعودية
وزارة الداخلية
الهيئة العليا للأمن الصناعي
إدارة التراخيص الأمنية المركزية

رؤية VISION 2030
المملكة العربية السعودية
KINGDOM OF SAUDI ARABIA

رخصة مزاولة نشاط

رقم الرخصة : ٢٣٠٢٢٠٧٨٤٤٥

الإسم التجاري	شركة أزيدك لأجهزة السلامة			
رقم السجل التجاري	٤٠٣٠٢٦٧٤١٠	الرقم الموحد للمنشآت(٧)	٧٠١٢٠٢٥٥٦٠	
تاريخ الإصدار	١٤٤٤-٠٧-١١	تاريخ الإنتهاء	١٤٤٧-٠٧-١١	منطقة مزاولة النشاط	جدة
النشاط المرخص	تركيب وصيانة أجهزة ومعدات الإنذار من الحريق			
الأجهزة والمعدات				

تشهد إدارة التراخيص الأمنية المركزية بأن المنشأة الموضحة أعلاه قد أستوفت كافة الإجراءات والإشتراطات النظامية لمزاولة النشاط الموضح أعلاه وقد أصدرت لها هذه الرخصة كمنشأة مصرح لها لمزاولة النشاط المذكور.

أمين عام الهيئة العليا للأمن الصناعي
عقيد مهندس/ عادل بن زايد العتيبي

وزارة الداخلية
الأمانة العامة
الهيئة العليا للأمن الصناعي

* للتحقق من صلاحية الرخصة الرجاء الدخول على منصة الهيئة العليا للأمن الصناعي https://hcis.gov.sa
* يتطلب وجود النشاط في السجل التجاري المذكور أعلاه، على ان يكون السجل التجاري ساري المفعول

المملكة العربية السعودية
وزارة الداخلية
الهيئة العليا للأمن الصناعي
إدارة التراخيص الأمنية المركزية

رؤية VISION 2030
المملكة العربية السعودية
KINGDOM OF SAUDI ARABIA

رخصة مزاولة نشاط

رقم الرخصة : ٢٣٥١٠٠٧٧٣٣٢

الإسم التجاري	شركة أزيدك لأجهزة السلامة			
رقم السجل التجاري	٤٠٣٠٢٦٧٤١٠	الرقم الموحد للمنشآت(٧)	٧٠١٢٠٢٥٥٦٠	
تاريخ الإصدار	١٤٤٤-٠٦-٢٦	تاريخ الإنتهاء	١٤٤٧-٠٦-٢٦	منطقة مزاولة النشاط	جدة
النشاط المرخص	البيع بالجملة لأجهزة ومعدات ومواد الوقاية والحماية من الحريق			
الأجهزة والمعدات				

تشهد إدارة التراخيص الأمنية المركزية بأن المنشأة الموضحة أعلاه قد أستوفت كافة الإجراءات والإشتراطات النظامية لمزاولة النشاط الموضح أعلاه وقد أصدرت لها هذه الرخصة كمنشأة مصرح لها لمزاولة النشاط المذكور.

أمين عام الهيئة العليا للأمن الصناعي

عقيد مهندس/ عادل بن زايد العتيبي

* للتحقق من صلاحية الرخصة الرجاء الدخول على منصة الهيئة العليا للأمن الصناعي https://hcis.gov.sa
* يتطلب وجود النشاط في السجل التجاري المذكور أعلاه، على ان يكون السجل التجاري ساري المفعول

المملكة العربية السعودية
الهيئة العليا للأمن الصناعي

الهيئة العليا للأمن الصناعي
High Commission For Industrial Security

رؤية VISION 2030
المملكة العربية السعودية
KINGDOM OF SAUDI ARABIA

رخصة مزاولة نشاط

رقم الرخصة : ٢٤٥٠٦١١١٧٢٣

الإسم التجاري	شركة أزيدك لاجهزة السلامة			
رقم السجل التجاري	٤٠٣٠٥٥٣١٦٧	الرقم الموحد للمنشآت(٧)	٧٠٣٨٨٧٧١٤٣	
تاريخ الإصدار	١٤٤٥-١٠-٢٨	تاريخ الإنتهاء	١٤٤٨-١٠-٢٨	منطقة مزاولة النشاط	جدة
النشاط المرخص	تركيب وصيانة الأجهزة الأمنية			
الأجهزة والمعدات	كاميرات المراقبة الأمنية, أنظمة الدوائر التليفزيونية المغلقة, أجهزة وأنظمة الإنذار ضد السرقة, أجهزة وبوابات الكشف عن المعادن, أجهزة تفتيش الحقائب والطرود, أجهزة بوابات الدخول والخروج بالبطاقات الممغنطة والبصمة, السياج الأمني			

تشهد الهيئة العليا للأمن الصناعي بأن المنشأة الموضحة أعلاه قد أستوفت كافة الإجراءات والإشتراطات النظامية لمزاولة النشاط الموضح أعلاه وقد أصدرت لها هذه الرخصة كمنشأة مصرح لها لمزاولة النشاط المذكور.

الهيئة العليا للأمن الصناعي
High Commission For Industrial Security

* للتحقق من صلاحية الرخصة الرجاء الدخول على منصة الهيئة العليا للأمن الصناعي https://hcis.gov.sa
* يتطلب وجود النشاط في السجل التجاري المذكور أعلاه، على ان يكون السجل التجاري ساري المفعول

المملكة العربية السعودية
الهيئة العليا للأمن الصناعي

الهيئة العليا للأمن الصناعي
High Commission For Industrial Security

رؤية VISION 2030
المملكة العربية السعودية
KINGDOM OF SAUDI ARABIA

رخصة مزاولة نشاط

رقم الرخصة : ٢٣٥١٣١٠١٦٣٢

الإسم التجاري	شركة ازيدك لاجهزة السلامة				
رقم السجل التجاري	٤٠٣٢٢٦٣١٤١	الرقم الموحد للمنشآت(٧)	٧٠٣١٢٩٩٨٦٥		
تاريخ الإصدار	١٤٤٥-٠٥-٢٧	تاريخ الإنتهاء	١٤٤٨-٠٥-٢٧	منطقة مزاولة النشاط	الطائف
النشاط المرخص	البيع بالتجزئة لمعدات الإطفاء والإنقاذ				
الأجهزة والمعدات					

تشهد الهيئة العليا للأمن الصناعي بأن المنشأة الموضحة أعلاه قد أستوفت كافة الإجراءات والإشتراطات النظامية لمزاولة النشاط الموضح أعلاه وقد أصدرت لها هذه الرخصة كمنشأة مصرح لها لمزاولة النشاط المذكور.

* للتحقق من صلاحية الرخصة الرجاء الدخول على منصة الهيئة العليا للأمن الصناعي https://hcis.gov.sa
* يتطلب وجود النشاط في السجل التجاري المذكور أعلاه، على ان يكون السجل التجاري ساري المفعول

المملكة العربية السعودية
الهيئة العليا للأمن الصناعي

الهيئة العليا للأمن الصناعي
High Commission For Industrial Security

رؤية VISION 2030
المملكة العربية السعودية
KINGDOM OF SAUDI ARABIA

رخصة مزاولة نشاط

رقم الرخصة : ٢٣٠٢٢١٠٢٠٠٣

الإسم التجاري	شركة ازيدك لاجهزة السلامة				
رقم السجل التجاري	٤٠٣٢٢٦٣١٤١	الرقم الموحد للمنشآت(٧)	٧٠٣١٢٩٩٨٦٥		
تاريخ الإصدار	١٤٤٥-٠٦-٠١	تاريخ الإنتهاء	١٤٤٨-٠٦-٠١	منطقة مزاولة النشاط	الطائف
النشاط المرخص	تركيب وصيانة أجهزة ومعدات الإنذار من الحريق				
الأجهزة والمعدات					

تشهد الهيئة العليا للأمن الصناعي بأن المنشأة الموضحة أعلاه قد أستوفت كافة الإجراءات والإشتراطات النظامية لمزاولة النشاط الموضح أعلاه وقد أصدرت لها هذه الرخصة كمنشأة مصرح لها لمزاولة النشاط المذكور.

* للتحقق من صلاحية الرخصة الرجاء الدخول على منصة الهيئة العليا للأمن الصناعي https://hcis.gov.sa
* يتطلب وجود النشاط في السجل التجاري المذكور أعلاه، على ان يكون السجل التجاري ساري المفعول

المملكة العربية السعودية
وزارة الداخلية
الهيئة العليا للأمن الصناعي
إدارة التراخيص الأمنية المركزية

رؤية VISION 2030
المملكة العربية السعودية
KINGDOM OF SAUDI ARABIA

رخصة مزاولة نشاط

رقم الرخصة : ٢٣٥١١٠٨٢٧٠٨

الإسم التجاري	شركة أزيدك لاجهزة السلامة			
رقم السجل التجاري	٢٠٥٠١٦٨٠٢٥	الرقم الموحد للمنشآت(٧)	٧٠٣٣٨١٠٣٦٢	
تاريخ الإصدار	١٤٤٤-٠٩-٢٠	تاريخ الإنتهاء	١٤٤٧-٠٩-٢٠	منطقة مزاولة النشاط	الدمام
النشاط المرخص	البيع بالتجزئة لأجهزة ومعدات ومواد الوقاية والحماية من الحريق			
الأجهزة والمعدات				

تشهد إدارة التراخيص الأمنية المركزية بأن المنشأة الموضحة أعلاه قد أستوفت كافة الإجراءات والإشتراطات النظامية لمزاولة النشاط الموضح أعلاه وقد أصدرت لها هذه الرخصة كمنشأة مصرح لها لمزاولة النشاط المذكور.

أمين عام الهيئة العليا للأمن الصناعي

عقيد مهندس/ عادل بن زايد العتيبي

وزارة الداخلية - الأمانة العامة - الهيئة العليا للأمن الصناعي

* للتحقق من صلاحية الرخصة الرجاء الدخول على منصة الهيئة العليا للأمن الصناعي https://hcis.gov.sa
* يتطلب وجود النشاط في السجل التجاري المذكور أعلاه، على ان يكون السجل التجاري ساري المفعول

وزارة الشؤون البلدية والقروية والإسكان
Ministry of Municipal Rural Affairs & Housing

بلدي balady

رقم الشهادة 2022030862

تاريخ الاصدار 2022/04/25

اعتماد*

شهادة اعتماد
تصنيف مقدمي خدمات المدن

تمنح وزارة الشؤون البلدية والقروية والاسكان شهادة الاعتماد*

للمنشأة	مؤسسة ازيدك للمقاولات العامه

في قطاع التشييد والبناء

السجل التجاري	4030244617
النشاط	الإنشاءات العامة للمباني السكنية,الإنشاءات العامة للمباني الغير السكنية ، يشمل,(المدارس ، المستشفيات، الفنادق ...الخ)الإنشاءات العامة للمباني الحكومية,ترميمات المباني السكنية والغير سكنية

- يسري مفعول هذه الشهادة حتى تاريخ 04/10/1444 هـ / الموافق 25/04/2023 م
- تصدر هذه الشهادة الكترونياً وعلى الجهات المالكة للمشاريع التحقق من الشهادة المقدمة من خلال موقع الوزارة

وكيل الوزارة لتصنيف المقاولين
د. أحمد بن جميل قطان

تصنيف
مقدمي خدمات المدن

* هذه الشهادة منحت بغرض اصدار وثيقة التأمين ضد العيوب الخفية و الدخول في المنافسات الحكومية الأقل من قيمة مشاريع الدرجة الخامسة.

وزارة الشؤون البلدية والقروية والإسكان
بلدي balady
تنظيم مشغلي المدن

شهـــادة

تصنيف مقدمي خدمات المدن

تمنح وزارة الشؤون البلدية والقروية والإسكان شهادة تصنيف بالدرجة

الدرجة الأولى

للمنشأة: شركة ازيدك للمقاولات العامه

بيانات المنشأة

الرقم الوطني الموحد/ الترخيص	تاريخ إصدار السجل التجاري/ الترخيص	اسم مالك المنشأة	نوع المنشأة	جنسية المنشأة	رأس المال
7014126267	15/04/2013	غازي جابر درويش القحطاني	ذات مسئولية محدودة	سعودي	100000.0

بيانات شهادة التصنيف

رقم الشهادة	تاريخ الإصدار	درجة التقييم الائتماني	درجة التقييم الفني
2024005747	29/05/2024	BBB+	88.55

أنشطة شهادة التصنيف

المجال	الأنشطة
التشييد والبناء	الإنشاءات العامة للمباني السكنية,الإنشاءات العامة للمباني الغير السكنية ، يشمل,(المدارس ، المستشفيات، الفنادق ...الخ) الإنشاءات العامة للمباني الحكومية, ترميمات المباني السكنية والغير سكنية

- يسري مفعول هذه الشهادة حتى تاريخ 29/05/2026
- تصدر هذه الشهادة الكترونيا وعلى الجهات المالكة للمشاريع التحقق من الشهادة المقدمة من خلال موقع الوزارة.

وكيل الوزارة لتنظيم مشغلي المدن
عبدالرحمن بن أحمد العريني