أزيدك للمقاولات العامة
وأعمال الإلكتروميكانيكال
Azeidk for General Contracting & MEP Solutions

Title

Material Submittal for
Automatic Fire Extinguisher Panel

Brand

Context Plus

C.R.4030244617
012 6880407/0581444606
info@azeidk.com
www.azeidk.com

المقر الرئيسي - جدة:
برج الصفا، مقابل عزيز مول، أعلى شركة عبداللطيف جميل، مبنى A، الدور الثالث، مكتب رقم ٣٤٠.
الرياض:
حي الملز، شارع صلاح الدين، بجوار شركة زين، الدور الثاني، مكتب رقم ١٦.

Index

- *Technical Data Sheets (Catalogues).*
- *UL Certificates.*
- *LPCB Certificates.*
- *Intertek Certificates.*
- *Previous approval.*
- *Authorization Lettre.*
- *Shipment Conformity Certificate (Saber).*
- *Warranty Letter.*
- *Spare Parts Letter.*

أزيدك للمقاولات العامة
وأعمال الإلكتروميكانيكال
Azeidk for General Contracting & MEP Solutions

Context Plus

Material List.

C.R.4030244617
012 6880407/0581444606
info@azeidk.com
www.azeidk.com

المقر الرئيسي - جدة:
برج الصفا، مقابل عزيز مول، أعلى شركة عبداللطيف جميل، مبنى A، الدور الثالث، مكتب رقم ٣٤٠.
الرياض:
حي الملز، شارع صلاح الدين، بجوار شركة زين، الدور الثاني، مكتب رقم ١٦.

Item	Description	Brand/Origin
1	Extinguishant control panel, 3 zone EP (to BS.EN12094.1) c.w 3A EN54.4 PSU & 128 x64 pixel graphical LCD display. LPCB Approved, Context Plus. **Model: EP203CON**	**Context Plus England**
2	ALARM BATTERY 2.2 AMP VOLT 12 **Matrix.**	
3	No Break Resettable Fire Call Point. Surface Mount. fitted with Transparent Polycarbonate Cover. Context Plus. **Model: CP500CPRC**	**Context Plus England**
4	Series S65 Optical smoke detector with base (UL Listed with Flashing LED), Context Plus. **Model: 55000326IMC**	**Context Plus England**
5	Series S65 Fixed Temperature Rate of Rise heat detector 135 °F with base (UL Listed with Flashing LED), Context Plus. **Model: 55000139IMC**	**Context Plus England**
6	polarised fire bell 24V (150mm under dome) c.w diode. Context Plus. **Model: CP250BR**	**Context Plus England**
7	Conventional Combined fire Sounder / Beacon 24V Red 4 Tone CP **Model: CP750CDB**	**Context Plus England**
8	Extinguishant Abort button, surface mounting, with hinged cover & "EXTINGUISHANT ABORT" text **Model: CP200ABO**	**Context Plus England**

أزيدك للمقاولات العامة
وأعمال الإلكتروميكانيكال
Azeidk for General Contracting & MEP Solutions

Context Plus

Technical Data Sheets (Catalogues).

C.R.4030244617
012 6880407/0581444606
info@azeidk.com
www.azeidk.com

المقر الرئيسي - جدة:
برج الصفا، مقابل عزيز مول، أعلى شركة عبداللطيف جميل، مبنى A، الدور الثالث، مكتب رقم ٣٤٠.
الرياض:
حي الملز، شارع صلاح الدين، بجوار شركة زين، الدور الثاني، مكتب رقم ١٦.

CONTEXT PLUS | EXPERT IN FIRE SAFETY & SECURITY SYSTEMS

LPCB Certified
EP203/CON 3 Zone Automatic Extinguisher Panel

Introducing the EP203/CON 3 zone automatic extinguisher panel from Context Plus.

LPCB certified to EN 12094 part 1 (Fixed Firefighting Systems - Components for Gas Extinguishing Systems) and EN54 parts 2 & 4, the panel epitomises quality, durability and reliability and is ideal for use in any area housing expensive, dangerous or irreplaceable items of equipment.

Featuring an intuitive 128 x 64 pixel two-colour graphic display that gives clear and concise feedback to the user, installer and commissioning engineer, the panel also includes six monitored inputs (including hold and abort), a time stamped log, adjustable flood times and volt-free changeover relays for fire, local fire, 1st stage active, 2nd stage active, extractor fan and fault.

The panel is supplied in an durable enclosure with all of its electronics - apart from its powerful 3A EN54-4 switch mode PSU - mounted on a detachable metal bridge plate for ease of installation. A wide range of ancillaries are also available including remote status units, hold-off and abort buttons, line terminators and output expansion relay boards.



LPCB Ref. 176c
to EN 12094-1 (2003)
EN 54-2/A2 (2007)
EN 54-4/A2 (2006)

0832-CPD-0794

Context Plus systems are certified and comply with the quality requirements specified in the standards.

Key Features

- **LPCB approved to EN 12094 part 1 and EN54 parts 2 & 4**
- **Functions as a standard three zone fire panel with additional circuitry for controlling the release of fire-suppressing gas into protected areas**
- **Unique 128 x 64 pixel graphical display facilitates straightforward system programming**
- **Any combination of activated zones can be programmed to automatically start the panel's extinguishant release sequence**
- **Includes a pull-down front-panel manual release button and two keyswitches for accessing the panel's functions and toggling between auto/manual mode**
- **Three conventional sounder circuits (two x 1st stage, one x 2nd stage)**
- **Powerful 3A EN54-4 compliant switch mode PSU**
- **Low quiescent current - less than 40mA on mains fail**
- **Wide range of monitored inputs and auxiliary outputs (see schematic overleaf)**
- **Abort and hold inputs allow the panel's release sequence to be cancelled or suspended at any time**
- **Time-stamped event log**
- **RS485 connections for up to eight flush or surface remote status units with their own LCDs, manual release and mode (auto/manual) switches. Single gang economy status units (without an LCD) are also available**
- **Extensive range of commissioning and engineering functions**
- **Optional relay expansion boards and single gang abort and hold buttons**
- **Ideal for use in computer rooms, telecommunication centres, archive storage areas, chemical plants, generator rooms, museums, etc**
- **System line terminator included with all panels**

Context Plus



How do automatic extinguisher systems work?

Automatic extinguisher systems work by controlling the release of fire-suppressing gas into areas where fires need to be put out quickly, with minimal damage to the equipment being protected. A typical automatic extinguisher system comprises the fire suppressing agent – usually an inert gas such as Argonite – storage containers, release valves, fire detectors, the control panel (and ancillaries), delivery piping and dispersion nozzles.


Fitting an extinguishing system clearly requires a degree of expertise. However, the EP203/CON is incredibly easy to install. It is the first EN 12094 part 1 compliant extinguisher panel to feature an intuitive 128 x 64 pixel display that gives clear and concise feedback to the user, installer and commissioning engineer. This allows engineers to commission with confidence without having to refer to complicated LED arrays, convoluted 7-segment displays and look-up sheets ... everything is in plain English.

Despite the EP203/CON's ease of programming, it is one of the most powerful extinguisher panels on the market. It includes three conventional detector circuits and three conventional sounder circuits (2 x 1st stage, 1 x 2nd stage), all of which are line monitored for open and short circuit faults. Any combination of activated detector zones can be programmed to automatically activate the panel's extinguishant release sequence, which can be set to operate with or without a delay. No less than six monitored inputs are also provided, including Hold and Abort for suspending or cancelling the release sequence at anytime. An optional relay expansion board can also be fitted to provide reset, mode, discharged, hold and abort outputs.

Other features include adjustable flood times, an alarm counter that records the number of occasions the panel has been in alarm, a time-stamped log, support for up to two solenoids or multiple Metrons and volt-free changeover relay contacts for fire, local fire, first stage active, second stage active, extract fan and fault.

For additional flexibility, up to eight flush or surface remote status units, each with their own displays, manual release mechanisms and mode switches, can be connected to the EP203/CON via a monitored RS485 bus. Single gang economy status units without a display are also available (8 per system). The availability of these and a host of other ancillary devices including system line terminators and hold off/abort buttons, makes the EP203/CON ideal for use in computer rooms, telecommunication centres, archive storage areas, chemical plants, generator rooms, museums and more.

An overview of the EP203/CON's inputs and outputs

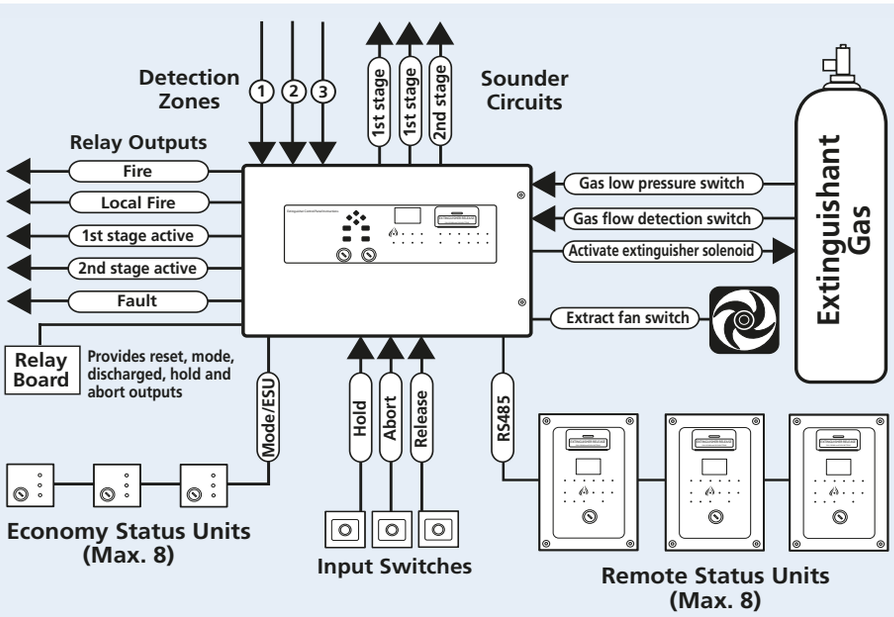

Products & Descriptions

3 Zone Automatic Extinguisher Panel




Part No: EP203/CON

Includes all of the circuitry for controlling the extinguishant release, a pull-down manual release button, a 128x64 pixel LCD display plus all of the features listed.

W467 x H293 x D100 mm

Output Expansion Relay Board



Part No: EP212

Mounts inside the EP203 panel to provide volt-free changeover relay contacts for reset, mode, discharged, hold and abort. Max. 1 per EP203.

W162 x H70 x D20mm

Flush Mounting Remote Status Unit



Part No: EP210F

Includes a status LCD, manual release and mode (auto/manual) switches. Max. 8 EP210F/EP210S per EP203. Weatherproof enclosure also available, order code BF359/1.

W175 x H250 x D53mm

Surface Mounting Remote Status Unit



Part No: EP210S

Includes a status LCD, manual release and mode (auto/manual) switches. Max. 8 EP210F/EP210S per EP203. Weatherproof enclosure also available, order code BF359/1.

W160 x H240 x D51mm

Single Gang Economy Status Unit



Part No: EP211

Includes a keyswitch operated mode (auto/manual) switch and three status LEDs. Max. 8 per EP203.

W87 x H87 x D35mm

System Line Terminator



Part No: EP214

Allows the EP203's extinguishant release output to be terminated to a gas release solenoid. Max. 2 per EP203 (one EP214 is supplied with the EP203).

W55 x H55 x D22mm

Extinguishant Hold Off/Abort Buttons



Part No: CP150ALB (Abort)
CP200HLB (Hold)

Easy to operate buttons that can be used to delay/hold off or cancel/abort the extinguishant release. Order CP150ALB for Abort or CP200HBL for Hold. Hinged protective covers are supplied with both.

W89 x H93 x D59mm (without cover)

Yellow Extinguishant Release Call Point



Part No: CP100RLR

A surface mounting call point that can be used to remotely trigger the EP203's extingushant release sequence. Supplied with a hinged protective cover.

W89 x H93 x D59mm (without cover)

EP215 IP66 Extinguishant Hold Off/Abort Buttons



Part No: EP215

An IP66 rated button that can be used to delay (hold off) or cancel (abort) the extinguishant release sequence depending on how it is connected.

W93 x H93 x D88mm

BF372 Yellow Extinguishant Release Call Point, Surface



Part No: BF372

Certified to EN54 Part 11 (LPCB/VdS). Ideal for use with Context plus EP203 Automatic Extinguisher

Ordering Code
MCP3A-Y000SG-14C

W93 x H89 x D60mm

Also available for your gas extinguishing installations:



Bells | Sounder/ Beacons | Xenon Beacons

COMMISSIONING & ENGINEERING FUNCTIONS

- **Zone selection:** Selects the zone combination that starts the extinguishant release sequence
- **Extinguishant delay:** Sets the countdown duration before extinguishant release
- **Extinguishant duration:** Sets the duration of the firing signal to the extinguishant output
- **Flooding time:** Sets the duration for the release of extinguishant
- **Extract option:** Enables/disables the ventilation extract option
- **Extract time:** Sets the duration for the ventilation extract fan operation
- **Sounder delay:** Sets the delay duration before the fire sounders are activated
- **Remote status unit learn:** Finds all remote status units and updates the panel's database
- **Extinguishant output EOLS:** Selects the number of extinguisher circuit terminations
- **Mode exceptions:** Selects the default setting mode when the mode input is in Fault and/or Disabled
- **Earth fault:** Disables/enables the panel's earth fault monitoring circuitry
- **Manual release mode:** Selects either delayed or immediate release of extinguishant
- **Zone trigger:** Enables a short circuit condition on the three detection zones
- **Clean start:** Clears the panel's memory back to its default factory settings
- **Walk test:** Puts detection zone(s) into walk test mode
- **Test relays:** Tests the panel's auxiliary relay outputs
- **Test sounders:** Tests the panel's sounder circuits
- **Monitoring:** Applies a constant monitoring voltage
- **Show PSU stats:** Displays the status of the panel's power supply & standby battery

EP203/CON Automatic Extinguisher Panel Technical Specifications

Power Supply Specification

Mains supply voltage	230Vac, 50/60Hz
Internal power supply	24Vdc nominal
Max. output current	3A@230Vac
Power rating (including charging)	1.5A cont., 3A peak
Battery type	2 x 12Vdc, 7Ahr VRLA type, connected in series
Battery charge current	0.7A
Earth fault monitoring	YES
Mains supply/battery charger monitored for failure	YES
Batteries monitored for disconnection and failure	YES
Quiescent current drain on mains fail	40mA approx.

Detector Circuit Specification

Number of conventional detector circuits	3 @ 21-28Vdc
Line monitored for open and short circuit faults	YES
Max. cable length per circuit	250m
Max. no. of smoke/heat detectors per circuit	20
Max. combined no. of detectors & manual call points per circuit	32
Zone quiescent current	2mA max.
End-of-line resistor value	6K8 ohm ± 5%, 0.25W

Sounder Circuit Specification

No. of conventional circuits	3 (two x 1st stage, one x 2nd stage)
Line monitored for open and short circuit faults	YES
Sounder outputs rating	21-28Vdc, fused @200mA per circuit
Max. sounder cable length per circuit	50m
Max. number of polarised sounders per circuit	10 @ 20mA each
End-of-line resistor value	6K8 ohm ± 5%, 0.25W

Auxiliary outputs

No. of auxiliary outputs *	6 (Fire, Local Fire, Extract Fan, 1st Stage, 2nd Stage, Fault)
Relay contact rating	30Vdc, 1A max.

* Note that 5 additional relay outputs (Reset, Mode Switch, Discharged, Hold, Abort) are available on the EP212 relay output expansion card

Extinguishant release outputs

Extinguishant release output	21-28Vdc, rated at 1A for 5mins.
Extinguishant release time delay	Adjustable 0-60 seconds (1 second steps)
Extinguishant release duration	Adjustable 1-300 seconds (1 second steps)
Extinguishant release flooding time	Adjustable 60-1800 seconds (1 second steps)
Extinguishant output end-of-line	"Terminator" circuitry EOL (Part No. EP214)

Monitored Inputs

Number of monitored inputs and type	6 (Manual Release, Flow Switch, Low Pressure, Mode, Hold, Abort)
Thresholds	8k to 2k ohms (normal); 1.8k to 200 ohms (active), 150 to 0 ohms (short circuit)
End-of-line resistor value	6K8± 5%, 0.25W

Controls & Indicators

Status Display Unit	128 x 64 pixel graphic LCD unit, two-colour backlight
LCD 'Access Level 1' Menus:	• Display Faults • Display Disablements • Zones in Test • Lamp Test • Alarm Counter
LCD 'Access Level 2' Menus:	• Display Faults • Display Disablements • Zones in Test • Lamp Test • Alarm Counter • Set Time/Date • Event Log • Display Contrast • Disablements
LCD 'Access Level 3' Menus:	• Display Faults • Display Disablements • Zones in Test • Display RSUs • Disablements • Commissioning • Engineering
Controls (2 x keyswitches)	• Accessed • Manual Only or Manual & Automatic
Controls (push buttons)	• Menu • Silence Internal Sounder • Control Panel Reset • Silence/Resound Sounders • Scroll up • Scroll down • Escape • Accept • Extinguisher Release (housed in yellow casing).
Indicators (LEDs)	• General Fire • Fire Zones (x3) • General Disablement • Zone Fault/Disable/Test (x3) • Hold • First Stage Output • Release Imminent (x2) • Extinguishant Released • Abort • Disablements (Extinguishant Release, Manual Release, First Stage Output, Second Stage Output, Sounder) • Manual Only • Manual & Automatic • Supply Present • PSU Fault • Accessed • Test • General Fault • System Fault • Delays • Sounder Fault • Flooding Zone Fault • Low Press Fault.
Internal control (push button)	Access Level 3 Switch (located on Main Control PCB)

Dimensions (W x H x D)

Dimensions	Back box = 439mm x 276mm x 70mm approx. (metal); Lid = 467mm x 293mm x 29mm approx. (plastic)
Weight	4.65kg (without batteries)

Context Plus Limited

Registered office: 175 Mauldeth Road, Manchester M14 6SG England, United Kingdom

Tel: +44 161 257 2541 **F**ax: +44 161 225 8817 **W**eb: www.contextplus.co.uk **E**mail: contextplus@xportsales.com

The company reserves the right to change specifications of products at any time without prior notice. It cannot be held responsible for any omissions or errors.

SERIES 65A (UL)
CONVENTIONAL FIRE DETECTORS

10 Year WARRANTY

Context Plus Series 65A UL devices incorporate well-proven sensing technologies, together with advances in materials and electronics technology .With a wide operating voltage of 9-33V, the range consists of ionization, integrating ionization and photo-electric smoke detectors, 2 grades of thermal detector and a standard base. Each type of detector has an LED which flashes continuously in stand-by.

- Wide operating voltage
- Can be used on security systems
- Advanced electronic technology
- Remote indicator connection as standard
- Flashing LED
- Designed to meet UL approvals

Listed

MADE IN ENGLAND



Series 65A Ionisation smoke detector
Part Number 55000-226IMC

CONTEXT PLUS SERIES 65A IONISATION SMOKE DETECTORS 55000-226IMC

Detector	Integrating Ionisation
Features	Flashing LED
Part No	55000-226IMC
Supply voltage	9 to 33V
Average stand-by current at 24V	45µA
Average stand-by current at 9V	21µA
Alarm current at 24V	52mA
Alarm current at 9V	17mA
Alarm indication	Red LED
Ambient temperature	32 to 158°F
Max wind continuous	2,000ft/min
Remote output (R-)	Current sink to -ve line, limited to 17mA.

Listed

MADE IN ENGLAND



Series 65A Optical smoke detector
Part Number 55000-326IMC

CONTEXT PLUS SERIES 65A PHOTO-ELECTRIC SMOKE DETECTORS 55000-326IMC

Detector	Context Plus Series 65A Photo-electric
Features	Flashing LED
Part No	55000-326IMC
Supply voltage	9 to 33V
Average stand-by current at 24V	45µA
Average stand-by current at 9V	40µA
Alarm current at 24V	52mA
Alarm current at 9V	17mA
Alarm indication	Red LED
Ambient temperature	32 to 100°F
Max wind continuous	not affected
Remote output (R-)	Current sink to -ve line, limited to 17mA.

Listed

MADE IN ENGLAND



Series 65A Fixed Temp / Rate of Rise heat detector 135 °F
Part Number 55000-139IMC

CONTEXT PLUS SERIES 65A THERMAL DETECTORS 55000-139IMC / 145IMC

Detector	Series 65A Thermal	Series 65A Thermal
Features	Flashing LED	Flashing LED
Rating	Ordinary	Intermediate
Part No	55000-139IMC	55000-145IMC
Supply voltage	9 to 33V	9 to 33V
Average stand-by current at 24V	55µA	55µA
Average stand-by current at 9V	50µA	50µA
Alarm current at 24V	52mA	52mA
Alarm current at 9V	17mA	17mA
Alarm indication	Red LED	Red LED
Ambient temperature	32 to 100°F	32 to 100°F
Max wind continuous	not affected	not affected
Remote output (R-)	Current sink to -ve line, limited to 17mA.	

Listed

MADE IN ENGLAND



Part Number 45681-200IMC
Part Number 45681-245

CONTEXT PLUS SERIES 65A BASES 45681-200IMC / 45681-245

Series 65A bases have been designed to enable detectors to be plugged in without any need for force - particularly useful on suspended ceilings. All versions are lockable. It has no electronic parts that could be damaged during installation.

65A UL ORDER CODES

	Part Code
Series 65A Optical smoke detector, UL Listed with Flashing LED, Context Plus branded	55000-326IMC
Series 65A Ionisation smoke detector , UL Listed with Flashing LED, Context Plus branded	55000-226IMC
Series 65A Fixed Temp / Rate of Rise heat detector 135 °F, UL Listed with Flashing LED, Context Plus branded	55000-139IMC
Series 65A Fixed Temp / Rate of Rise heat detector 200 °F, UL Listed with Flashing LED, Context Plus branded	55000-145IMC
Series S65A Base only	45681-200IMC
Standard Relay base for Series 65A detectors	45681-245
RLI Remote LED Detector Indicator	BF318

Note: when using a remote indicator a current-limiting series resistor may be required.

CONVENTIONAL MANUAL CALL POINTS



Conventional Manual Call Point
Part Number MCP1A-525IMC

LPCB Approved

MADE IN ENGLAND

CONVENTIONAL INDOOR MANUAL CALL POINT MCP1A-525IMC

Offers installation efficiency, flexibility and full compliance with the latest standards. Provides a unique 'plug and play' concept to reduce installation time. The MCP utilises a special terminal block, where all initial installation cabling is terminated. This terminal block is then simply connected to the back of the MCP. Simple, but effective, with no re-termination required and no time wasted. Also comes with resettable element as standard. Illegal removal of the lid will result in the call point operating and the system going into alarm. Fully approved to EN54-11 standard and is supplied with both a resistor and normally open clean contact electrical options.

- Unique 'Plug & Play' installation concept
- Total 'Flex-Ability' in the choice of operating element
- Anti-Tamper facility
- LPCB Approved



Fire Alarm Call Point
Part Numbers below

FIRE ALARM CALL POINT CP550CP

Professionally designed for use in fire detection systems. When wired for open circuit operation, the circuit closes instantly when the glass is smashed. Openings are provided for 3/4" Ø conduit entries from top, bottom and the back. Comes in 5 different colours in casings with high impact strength and high resistance to heat. All metal parts are made of brass and phosphor bronze to ensure life long resistance against corrosion. A high reliability microswitch is also included. Designed to meet the requirements of BS5839 Part 2, EN54 Part 11 and approved by Australian Standard AS1603 Part 5.

- Double terminal wire connectors for independent input and output connections.
- Incorporation of the instant test operation which is activated by a special key.
- Protection against injury through foil-labelled glass pane.



Resettable Fire Call Point
Part Numbers below

RESETTABLE FIRE ALARM CALL POINT CP550CPR

Has a simple 'RESET' mechanism comprising tough ABS plastic operating elements that simulate break glass activation. Is instantly reusable without environmental hazard caused by fragments of broken glass–making.Perfect for food processing plants and places that are prone to false activations such as schools, shopping malls and other high traffic areas. When wired for open circuit operation, the circuit closes instantly when activated. Also meets the requirements of BS5839 Part 2 and EN54 Part 11.

- No glass elements to break, lose or incorrectly fit when installing.
- Complete functional test with every activation.
- Virtually maintenance free – achieved by an easy reset operation with a simple key.

MCP ORDER CODES

	Part Code
No Break Resettable Conventional Manual Call Point, LPCB Approved, Context Plus branded	MCP1A-525IMC
No Break Resettable Fire Call Point, Surface Mount, Context Plus branded	CP500CPR
Smash Glass Fire Call Point, Surface Mount, Context Plus branded	CP550CP
Spare Glass for CP550CP Call points	CP550CP/G
Transparent Polycarbonate cover for the CP500CPR and CP550CP	CP500/550/C

FIREPLUS
CONVENTIONAL SOUNDERS & BEACONS

EN54-3 Compliant FirePlus Platform Sounder, Sounder and Sounder Beacons. Comprehensive range including: CP550DB FirePlus DB sounder, red body deep base (IP65), LPCB approved, CP750CDB FirePlus CDB sounder/beacon, red body, red lens, deep base (IP65), Intertek approved and CP850BSW FirePlus BS base sounder, white, LPCB approved.



LPCB Approved

MADE IN ENGLAND

24VDC Red FirePlus Weatherproof IP65 fire sounder
Part Number CP550DB

FIREPLUS WEATHERPROOF SOUNDER CP550DB

- 32 tones plus a selectable override tone
- Independently certified to IP65
- Unique twist and lock bayonet mounting system
- Fully approved to EN54-3 by LPCB
- Removable cover for surface wiring
- Features base locking system as standard
- Sound level @ 1m (Tone1): 82.1dB(A) Low, 97.6dB(A) Med, 102.3dB(A) High.
- Current consumption @ 24Vdc: 8.3mA Low, 16.4mA Med, 30.8mA High.



Intertek Approved

MADE IN ENGLAND

24VDC Red FirePlus Weatherproof IP65 fire sounder/beacon
Part Number CP750CDB

FIREPLUS WEATHERPROOF SOUNDER/BEACON CP750CDB

- Sounder function fully approved EN54-3
- 32 tones plus a selectable override tone
- Switch selectable beacon only feature
- Independently certified to IP65
- Unique twist and lock bayonet mounting system
- Removable cover for surface wiring
- Fully approved to EN54-3 by Intertek
- Sound level @ 1m (Tone1): 79.7dB(A) Low, 95.4dB(A) Med, 99.1dB(A) High.
- Current consumption @ 24Vdc: 10.8mA Low, 19.9mA Med, 34.4mA High.



LPCB Approved

MADE IN ENGLAND

24VDC White FirePlus platform conventional base sounder
Part Number CP850BSW

FIREPLUS PLATFORM SOUNDER CP850BSW

- 32 tones plus a selectable override tone
- Sound level @ 1m (Tone1): 93.8dB(A) High.
- Current consumption @ 12mA High.
- Switch selectable volume control
- Modern ultra low profile for discreet mounting
- Fully approved to EN54-3 by LPCB
- Designed to accept most leading detector bases
- IP21C Rated

FIREPLUS ORDER CODES

	Part Code
24VDC Red FirePlus Weatherproof IP65 fire sounder, deep base, LPCB, Context Plus branded	CP550DB
24VDC Red FirePlus Weatherproof IP65 fire sounder/beacon, deep base, Intertek, Context Plus branded	CP750CDB
24VDC White FirePlus platform conventional base sounder, LPCB	CP850BSW

CP RANGE
CONVENTIONAL SOUNDERS, BEACONS & BELLS

Our CP RANGE of wall-mounting Electronic Sounders and Sounder/Beacons provide good audibility in all directions. They have locally controllable output levels allowing the sound intensity to be adjusted to suit the application. If required, the use of a third wire enables a second stage alarm to be switched to override the selected tone. These versatile features allow them to work seamlessly with most fire detection systems. All fully comply with EN54 and have a protection rating of IP65. Also available is a motorised bell.



Sounder
Part Number CP400SR

SOUNDER CP400SR

- Available in ABS or polycarbonate.
- Acoustically efficient design - capable of generating (100 dBA at 13mA 24VDC)
- Operates over a wide voltage range of 8 to 28V DC
- Automatic sounder synchronization.
- High sound output, low current consumption.
- 4 On-board selectable tones.
- Adjustable volume control screw.
- High reliability and stable performance.
- Wide angle uniform sound distribution.
- IP65 rated
- Full EN54 compliance.



Sounder/Beacon
Part Number CP450SER

SOUNDER/BEACON CP450SER

- Available in ABS or polycarbonate.
- Polycarbonate Freznel lens.
- Voltage range 20 to 28V DC
- Automatic sounder synchronization.
- High sound output, low current consumption.
- 4 On-board selectable tones.
- Adjustable volume control screw.
- High reliability and stable performance.
- High brightness LED.
- Full EN54 compliance.
- IP65 rated



Motor Driven Dome Bell
Part Number CP250BR

6 INCH (150MM) MOTOR DRIVEN DOME BELL CP250BR

- Heavy duty micro-motor with built-in varistor suppression ensures reliability and long life.
- Designed to meet the requirements of EN54-3:2001.
- Plug-in power supply.
- Interchangeable base suitable for surface mounting.
- Zero standby current and low current consumption.
- Integral RFI suppression to minimize induced noise on the alarm circuit.
- 8" size and IP65 variants available
- Decibel rating @ 1m = 95dB (24V, 0.03A)
- Weight = 812g.

CP RANGE ORDER CODES

	Part Code
24V Red weatherproof IP65 4 Tone 103dBA CP Conventional fire Sounder, Context Plus branded	CP400SR
24V Red Weatherproof IP65 4 Tone CP Conventional Fire Sounder / Beacon, 103dBA, Context Plus branded	CP450SER
24V 6" polarised fire bell (150mm under dome) c/w diode, Context Plus branded	CP250BR

INDOOR EXTINGUISHANT SYSTEM ANCILLARIES



Extinguishant Abort Switch
CP150ALB

Resettable Extinguishant Release Call Point
CP100RLR

Extinguishant Hold Off Switch
CP200HLB

DESCRIPTION

Context Plus' indoor system activation devices are designed with ease of installation in mind. Suitable for open circuit system, they are made from tough ABS plastic and come standard with hinged protective cover.

CP100RL Resettable Extinguishant Release Call Point's simple 'RESET' mechanism consists of ABS plastic operating elements that simulates break glass activation which is instantly reusable with no glass elements to break, lose or incorrectly fit when installing.

CP150ALB Extinguishant Abort Switch's shrouded push button design helps prevent inadvertent operation during the cancelation of extinguishant release sequence.

CP200HLB Extinguishant Hold Off Switch 's raised push button design is good for quick positive operation or momentary actuation when delaying the immenent suppression agent's release.

CP ADVANTAGES

- Transparent Polycarbonate lift-up protection cover.
- Suitable for surface or flush mounting.
- Thread protection plugs are provided to protect the brass inserts on the base box (when conceal fixing is needed).
- 3/4"Ø preopened conduit entries from top, bottom and the back are provided for extra convenience.
- Colour matching polythene plugs for conduit entries are included.

SPECIFICATIONS

Size (H x W x D)	88 X 88 X 55 mm (Surface Mount) 88 X 88 X 20 mm (Flush Mount)
Current Ratings	1Amp@240V AC 2 Amps@24V DC
Net/Gross Weight	128/153g **(CP100RL)** 130/155g **(CP150ALB)** 127/152g **(CP200HLB)**
Connections	TERMINAL- MAX 2.5mm² CABLE
Protection Rating	IP24D

Specifications are subject to change without prior notice.

OPTIONAL FEATURES


- Super-bright LED.
- Monitoring resistor.
- Blocking diode.
- Specific languages or custom imprints available on facial layout upon request.
- Casing available in different colours.



RANGE OF CASING COLOURS
White, Yellow, Green, Red, Blue



HINGED COVER
(Pack 20)
CP500/550/C

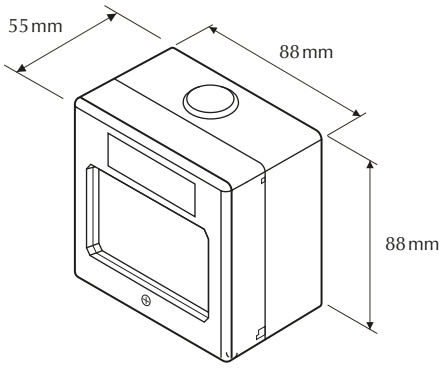



LED Single Strobe Light
CP350ER

DESCRIPTION

Context Plus' LED Single Strobe Light **CP350ER** is compactly designed and ideal for use on existing alarm systems due to its high intensity of illumination at very low current consumption.

CP ADVANTAGES

- Red Fresnel lens for maximum light output.
- High-grade Polycarbonate lens and base offer excellent impact and heat resistant.
- Reducd need for additional battery back-up.

SPECIFICATIONS

Size (Ø x D)	82 X 55 mm
Operating Voltage	12V DC 24V DC
Operating Current	30mA
Input Power	2 Watt
Flashing Rate	90 Flash per sec@12V 120 Flash per sec@24V
Net/Gross Weight	67/86g

Specifications are subject to change without prior notice.

OPTIONAL FEATURES

- Lens available in different colours.



RANGE OF LENS COLOURS
Red, Green, Clear, Amber, Blue

Context Plus Limited
175, Mauldeth Road,
Manchester, M14 6SG,
United Kingdom
Tel: +44 (0)161 257 2541
Fax: +44 (0) 161 225 8817
Email: contextplus@xportsales.com

LPCB Certificate.

C.R.4030244617
012 6880407/0581444606
info@azeidk.com
www.azeidk.com

المقر الرئيسي - جدة:
برج الصفا، مقابل عزيز مول، أعلى شركة عبداللطيف جميل، مبنى A، الدور الثالث، مكتب رقم ٣٤٠.
الرياض:
حي الملز، شارع صلاح الدين، بجوار شركة زين، الدور الثاني، مكتب رقم ١٦.

LPCB®

www.redbooklive.com

Certificate of Product Approval

Certificate Number: 176c-(cl-2) Issue: 03

Context Plus Ltd

Progress House, Newby Industrial Estate,
Newby Road,
Hazel Grove, Stockport,
Cheshire,
SK7 5DA,
United Kingdom

is certified by BRE Global Ltd. and is authorised to use the LPCB mark in association with the product(s) listed in this certificate and appendix having complied with the requirement(s) of the standards as detailed below:

Products

Control and Indicating equipment
EP203/CON
(refer to Appendix for details)

Standards

EN 54-2:1997 + A1:2006
EN 54-4:1997 + A1:2002 + A2:2006
EN 12094-1:2003

This Certificate is maintained and held in force through regular surveillance activities and subject to the corresponding ISO 9001 Certificate being maintained.

Signed for BRE Global Ltd	Verifier	Date of Issue	Date of First Issue
	E.Mattie-Suleiman	23 May 2023	13 February 2013

This certificate and appendix remains the property of BRE Global Ltd. and is issued subject to terms and conditions (for details visit www.redbooklive.com/terms).
To check the validity of this certificate and appendix please visit www.redbooklive.com/check, scan the QR tag or contact us.
BRE Global Ltd, Watford, WD25 9XX
T: +44 (0)333 321 8811 E: enquiries@breglobal.com
LPCB is a Registered Trademark of the Building Research Establishment Ltd.

 © BRE Global Ltd, 2023

LPCB®

Appendix to Certificate No: 176c-(cl-2) Issue: 03

Context Plus Ltd

Certified Product	Description	LPCB Ref.No.
EP203/CON	Conventional Three Zone 'Class A' Extinguisher Control Panel under Context Plus Brand Incorporating the following units: SPF0000203 Main extinguisher control SPF0000212 External relay interface SPF0361021 Power supply unit SPF0000214 EP214 terminator Certified with the following options with requirements from EN 12094-1:2003 4.17 Delay of extinguishing signal 4.18 Signal representing the flow of extinguishing agent 4.19 Monitoring of the status of components 4.20 Emergency hold device 4.21 Control of flooding time 4.23 Manual only mode 4.26 Triggering of equipment outside the system 4.27 Emergency abort device 4.30 Activation of alarm devices with different signals Certified with the following options with requirements from EN 54-2:1997 7.8 Output to fire alarm device(s) 7.11 Delays to the auctioning of outputs fire alarm devices and fire routing equipment 7.13 Alarm counter 10 Test condition	176c/01

This Certificate is maintained and held in force through regular surveillance activities and subject to the corresponding ISO 9001 Certificate being maintained.

Signed for BRE Global Ltd	Verifier	Date of Issue	Date of First Issue
	E.Mattie-Suleiman	23 May 2023	13 February 2013

This certificate and appendix remains the property of BRE Global Ltd. and is issued subject to terms and conditions (for details visit www.redbooklive.com/terms).
To check the validity of this certificate and appendix please visit www.redbooklive.com/check, scan the QR tag or contact us.

BRE Global Ltd, Watford, WD25 9XX
T: +44 (0)333 321 8811 E: enquiries@breglobal.com

LPCB is a Registered Trademark of the Building Research Establishment Ltd.

 © BRE Global Ltd, 2023

LPCB®

Appendix to Certificate No: 176c-(cl-2) Issue: 03

Context Plus Ltd

Certified Product	Description	LPCB Ref.No.
	Notes: 1. The following modules are ancillaries that are permitted to be connected to the e.c.d. as optional modules but are not tested or approved to any standard(s) EP210S Remote Status Unit "Surface Mount" optional EP210F Remote Status Unit "Flush Mount" optional EP211 Economy Status Unit optional EP215 Emergency Hold/Abort 2. The e.c.d. meets the requirements of EN 12094-1:2003, Class A – i.e. operational temperature range of -5°C to + 40°C. 3. This product approval does not constitute compliance with the fire detection and alarm system requirements of EN 54-13.	

This Certificate is maintained and held in force through regular surveillance activities and subject to the corresponding ISO 9001 Certificate being maintained.

Signed for BRE Global Ltd	E.Mattie-Suleiman Verifier	23 May 2023 Date of Issue	13 February 2013 Date of First Issue

This certificate and appendix remains the property of BRE Global Ltd. and is issued subject to terms and conditions (for details visit www.redbooklive.com/terms).

To check the validity of this certificate and appendix please visit www.redbooklive.com/check, scan the QR tag or contact us.

BRE Global Ltd, Watford, WD25 9XX
T: +44 (0)333 321 8811 E: enquiries@breglobal.com

LPCB is a Registered Trademark of the Building Research Establishment Ltd.

 © BRE Global Ltd, 2023

UL Certificates.

C.R.4030244617
012 6880407/0581444606
info@azeidk.com
www.azeidk.com

المقر الرئيسي - جدة:
برج الصفا، مقابل عزيز مول، أعلى شركة عبداللطيف جميل، مبنى A، الدور الثالث، مكتب رقم ٣٤٠.
الرياض:
حي الملز، شارع صلاح الدين، بجوار شركة زين، الدور الثاني، مكتب رقم ١٦.

UL-EU CERTIFICATE

Certificate No.	UL-EU-01227-CPR
Page	1/4
Date of Issue	2021-11-25
Certificate Holder	Context Plus Limited Progress House, Newby Industrial Estate, Newby Road, Hazel Grove, Stockport SK7 5DA, United Kingdom
Manufacturer	Factory B
Certified Product Type	Smoke detectors – Point detectors using scattered light, transmitted light or ionization
Product Trade Name	55000-316IMC Series 65E Optical Smoke Detector with Flashing LED
Trademark	Context Plus
Rating/Classification	9-33 VDC
Harmonised Technical Specifications	EN 54-7:2018
Supporting Documentation	S36045-D04-EuropeanDirective-Original
Additional information	NA
Expiry date	2031-11-24

UL EU

UKAS PRODUCT CERTIFICATION 4705

Authorized Certification Decision Maker
Chris Miles

This is to certify that representative samples of the Certified Product listed above have been investigated by Underwriters Laboratories to the Standard(s) indicated on this Certificate, in accordance with the UL Global Services Agreement and the UL-EU Mark Service Terms and Conditions ("Agreement"). The Certificate Holder is entitled to use the UL-EU Mark for the Certified Product listed on the certificate and manufactured at the production site(s) listed, in accordance with the terms of the Agreement. Only those products bearing the UL-EU Mark for Europe should be considered as being covered by UL's UL-EU Mark Service. This Certificate shall remain valid through the Expiration date, unless a Standard identified on this Certificate is amended or withdrawn prior to that date or there is a non-compliance with the Agreement.

Appendix UL-EU CERTIFICATE

This certificate relates to the use of the use of Smoke detectors - Point detectors using scattered light, transmitted light or ionization in fire detection and fire alarm systems installed in buildings. The detailed scope is given in pages 3 to 4 of this Certificate.

The product is certificated on the basis of:

i) S36045-D04-EuropeanDirective-Original
ii) Inspection and surveillance of factory production control by UL

Conventional Optical Smoke Detector with Flashing LED Model 55000-316IMC	
Technical Data	
Operating Voltage Nominal:	24VDC (as powered by CIE)
Operating Voltage Maximum:	33VDC
Operating Voltage Minimum:	9VDC

Appendix UL-EU CERTIFICATE

Certificate No. UL-EU-01227-CPR
Page 3/4
Date of Issue 2021-11-25

Essential Characteristics for 55000-316IMC	Performance	Standard
Compliance	**Pass**	EN 54-7:2018
Individual alarm indication	**Pass**	EN 54-7:2018
Connection of ancillary devices	**Pass**	EN 54-7:2018
Monitoring of detachable detectors	**Pass**	EN 54-7:2018
Manufacturer's adjustments	**Pass**	EN 54-7:2018
Protection against the ingress of foreign bodies	**Pass**	EN 54-7:2018
Response to slowly developing fires	**Pass**	EN 54-7:2018
General	**Pass**	EN 54-7:2018
Repeatability	**Pass**	EN 54-7:2018
Directional dependence	**Pass**	EN 54-7:2018
Reproducibility	**Pass**	EN 54-7:2018
Air movement	**Pass**	EN 54-7:2018
Dazzling	**Pass**	EN 54-7:2018
Variation in supply parameters	**Pass**	EN 54-7:2018
Fire sensitivity	**Pass**	EN 54-7:2018
Cold (operational)	**Pass**	EN 54-7:2018
Dry heat (operational)	**Pass**	EN 54-7:2018
Damp heat, steady state (operational)	**Pass**	EN 54-7:2018
Damp heat, steady state (endurance)	**Pass**	EN 54-7:2018
Sulphur dioxide (SO_2) corrosion (endurance)	**Pass**	EN 54-7:2018
Shock (operational)	**Pass**	EN 54-7:2018
Impact (operational)	**Pass**	EN 54-7:2018
Vibration, sinusoidal (operational)	**Pass**	EN 54-7:2018
Vibration, sinusoidal (endurance)	**Pass**	EN 54-7:2018
EMC, immunity (operational)	**Pass**	EN 54-7:2018
Marking, Labelling & Packaging	**Pass**	EN 54-7:2018

Appendix UL-EU Certificate

Certification Mark	**UL-EU mark**
Certificate No.	UL-EU-01227-CPR
Page	4/4
Date of Issue	2021-11-25

The UL-EU Mark, as displayed below, shall appear on certified products only. Minimum size is not specified, as long as the Mark is legible. The following is suggested.



The minimum height of the registered trademark symbol ® shall be 1 mm. When the overall diameter of the UL-EU Mark is less than 9.5 mm, the trademark symbol may be omitted if it is not legible to the naked eye.

The UL-EU Mark may appear on a label, nameplate, or may be cast, stamped or molded into the product. When appearing on a label or nameplate, the Manufacturer's name or trademark along with a model number are also required on that same label or nameplate. If cast, stamped or molded, the Manufacturer's name or trademark and model number shall also appear elsewhere on the product.

All content shall be in accordance with the details provided on this UL-EU Certificate.

PROCUREMENT

The Production site may reproduce the Mark or obtain it from a UL authorized supplier. The list of UL authorized suppliers can be found on UL's online directory at www.ul.com.

UL Product iQ®

UROX.S24127 - Smoke Detectors for Fire Alarm Systems

Smoke Detectors for Fire Alarm Systems

CONTEXT PLUS LTD S24127
Progress House
Newby Industrial Estate
Newby Road , Hazel Grove.
Stockport, SK7 5DA United Kingdom

Investigated To UL 268 (previous editions)
Products Suitable for Ducts, D(I) and D(ST) are investigated to UL 268A

Detector			Compatibility	Velocity Range (fpm)		Date of	Time of Manufacture	Firmware Version
Model	Application	Type	Restrictions	Min	Max	Manufacture	Firmware Version	Update
55000-226 IMC	OAP	I	D2	0	300	-	-	-
55000-326 IMC (a)	OAP	P	D2	0	300	-	-	-
58000-550IMC	OAP	I	D2	0	300	-	-	-
58000-650IMC	OAP	P	D2	0	300	-	-	-
58000-750IMC	OAP	P(IHD)	D2	0	300	-	-	-

Base Model	Related Detector	Control Unit Compatibility Restrictions
45681-200 IMC	55000-326 IMC, 55000-226 IMC	B2
45681-210IMU	58000-450IMC, 58000-550IMC, 58000-650IMC, 58000-750IMC	B2
45681-242IMC	55000-550, 55000-650, 55000-886, 55000-550, 58000-650, 58000-750	B2
45681-284IMC	55000-550, 55000-650, 55000-886, 55000-450, 58000-450, 58000-550, 58000-650, 58000-750	B2
45681-526IMC	55000-550, 55000-650, 55000-886, 58000-550, 58000-650, 58000-750	B2

Feedback

B2 - For connection to Listed control units with which compatibility was determined by test or a review of circuit parameters. Interconnection and compatible models indicated on installation wiring diagram for detector (base) and/or control unit.

D2 - For connection to Listed control units with which compatibility was determined by test or a review of circuit parameters. Interconnection and compatible models indicated on installation wiring diagram for detector (base) and/or control unit.

OAP - Open Area Protection

I - Ionization

P - Photoelectric

IHD - Includes Integral Heat Detector

Date of Manufacture identifies the manufacturing start date of all product models that will use the specific Time of Manufacture Firmware Version. The date of manufacture is noncoded and in the format YEAR (in 4 digits), MONTH (in letters), DAY (in 2 digits).

Time of Manufacture Firmware Version identifies a numerical and/or alphabetic series designation that is product and date-code specific and will only identify the Firmware Version at the time the product was manufactured. The numeric and/or alphabetic sequence is defined by the manufacturer.

Firmware Version Update is a numerical and/or alphabetic sequential identification that is product and date-code specific and sequentially identifies the Firmware Version Update from the previous version of firmware. The numerical and/or alphabetic sequence is defined by the manufacturer.

(a) - Suitable for use in ambient temperatures of 0-60 C (32-140 F).

Trademark and/or Tradename: Context plus

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under UL Solutions' Follow - Up Service. Only those products bearing the UL Mark should be considered to be Certified and covered under UL Solutions' Follow - Up Service. Always look for the Mark on the product.

UL Solutions permits the reproduction of the material contained in Product iQ subject to the following conditions: 1. The Guide Information, Assemblies, Constructions, Designs, Systems, and/or Certifications (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from Product iQ with permission from UL Solutions" must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "©2023 UL LLC."

Feedback

UL Product iQ®

UQGS.S24128 - Heat-automatic Fire Detectors

Heat-automatic Fire Detectors

See General Information for Heat-automatic Fire Detectors

CONTEXT PLUS LTD S24128
Progress House
Newby Industrial Estate
Newby Road , Hazel Grove.
Stockport, SK7 5DA UNITED KINGDOM

Model No.	Type	Compatibility Restrictions	Contact Arrangement	Temp Range (°F)	Spacing (Ft) Smooth Ceiling	Spacing (Ft) to Wall or Partition
55000-139 IMC	FT/ROR	D2	-	135	50	25
55000-145 IMC	FT/ROR	D2	-	200	50	25
58000-450IMC	FT/ROR	*1	-	135 (m1)	70	35
				150 (m2 / m3)	70	35
				200 (m4 / m5)	70	35
LHD-105-N	FT, HSC	None	NO	221	15	7.5
LHD-105-P	FT, HSC	None	NO	221	35	17.5
LHD-185-N	FT, HSC	None	NO	-	-	-
LHD-68-N	FT, HSC	None	NO	155	15	7.5
LHD-68-P	FT, HSC	None	NO	155	35	17.5
LHD-88-N	FT, HSC	None	NO	190	15	7.5
LHD-88-P	FT, HSC	None	NO	190	35	17.5

Base Model	Related Detector	Control Unit Compatibility Restrictions
45681-200 IMC	55000-139 IMC, 55000-145-IMC	#1
45681-210IMU	58000-450IMC	#1

D2 - For connection to Listed control units with which compatibility was determined by test or a review of circuit parameters. Interconnection and compatible models indicated on installation wiring diagram for detector (base) and/or control unit.

#1 - For connection to Listed Control units Models ZXa and ZXe, manufactured by Morley IAS, employing software revision greater than 684aU0.

*1 - For connection to Listed Control units Models ZXa and ZXe, manufactured by Morley IAS, employing software revision greater than 684aU0.

FT/ROR - Fixed temperature/rate of rise combination

Feedback

FT - Fixed temperature

HSC - Heat sensitive cable

Note - Complementary Listed as a heat actuated device for special applications (UTHV).

Trademark and/or Tradename: Context plus

Last Updated on 2019-05-10

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under UL Solutions' Follow - Up Service. Only those products bearing the UL Mark should be considered to be Certified and covered under UL Solutions' Follow - Up Service. Always look for the Mark on the product.

UL Solutions permits the reproduction of the material contained in Product iQ subject to the following conditions: 1. The Guide Information, Assemblies, Constructions, Designs, Systems, and/or Certifications (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from Product iQ with permission from UL Solutions" must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "©2023 UL LLC."

Feedback

أزيدك للمقاولات العامة
وأعمال الإلكتروميكانيكال
Azeidk for General Contracting & MEP Solutions

Context Plus

Certificate of Origin.

C.R.4030244617
012 6880407/0581444606
info@azeidk.com
www.azeidk.com

المقر الرئيسي - جدة:
برج الصفا، مقابل عزيز مول، أعلى شركة عبداللطيف جميل، مبنى A، الدور الثالث، مكتب رقم ٣٤٠.
الرياض:
حي الملز، شارع صلاح الدين، بجوار شركة زين، الدور الثاني، مكتب رقم ١٦.

1 Consignor
IMCI Services Limited
Progress House, Newby Road,
Hazel Grove, Stockport SK7 5DA
England
United Kingdom

Tel No 0161 257 2541 Fax No 0161 226 8817

No. FJ 1397817

ORIGINAL

CI-APO 13446 A

UNITED KINGDOM

CERTIFICATE OF ORIGIN

2 Consignee
Azeidk Establishment for Safety
Kilo 5
Old Makkah Road
Jeddah
SAUDI ARABIA

3 Country of Origin
United Kingdom

4 Transport details (Optional)

5 Remarks

6 Item number; marks; numbers, number and kind of packages; description of goods	7 Quantity
APO 13446 A/Jeddah/ SAUDI ARABIA FIRE ALARM COMPONENT 3 x Pallets As per Invoice Number CI-APO 13446 A dated 20/10/2022	Total Gross: 503 KG

8 THE UNDERSIGNED AUTHORITY CERTIFIES THAT THE GOODS DESCRIBED ABOVE ORIGINATE IN THE COUNTRY SHOWN IN BOX 3

GREATER MANCHESTER CHAMBER OF COMMERCE

Greater Manchester Chamber of Commerce

ELECTRONIC CERTIFYING STAMP
22 Nov 2022
Certificate Number: FJ1397817

Authorised by H M Government

Kathryn Hoggitt
AUTHORISED SIGNATORY

CERTIFICATE OF ORIGIN

Place and date of issue: name, signature and stamp of competent authority

UK-CBE14520-4260035-E
www.ecert.sgs.com

Mercury Print & Packaging Ltd, Leeds

Previous approval

C.R.4030244617
012 6880407/0581444606
info@azeidk.com
www.azeidk.com

المقر الرئيسي - جدة:
برج الصفا، مقابل عزيز مول، أعلى شركة عبداللطيف جميل، مبنى A، الدور الثالث، مكتب رقم ٣٤٠.
الرياض:
حي الملز، شارع صلاح الدين، بجوار شركة زين، الدور الثاني، مكتب رقم ١٦.

شركة سفر للتجارة والمقاولات المحدودة
Safar Trading & Contracting Co. Ltd.

dar شركة دار الهندسة للتصميم والاستشارات الهندسية

كدانة KIDANA

الهيئة الملكية لمدينة مكة المكرمة والمشاعر المقدسة

CONTRACTOR : Safar Trading & Contracting Co. Ltd. | Date : **10-Mar-2022**

☑ New Submittal / ☐ Resubmittal	PRQ	Submittal Ref. No.:	DEPARTMENT					
			AR	CV	ST	ME	EL	LC
		MINA-C-GEN-SFR-PRQ-EL-ELC-00038-00	☐	☐	☐	☐	☑	☐

☐ **Material Submittal** ☐ **Sample Submittal** ☑ **Pre-qualification** ☐ **Method Statement** ☐ **Other**

To : DAR AL- HANDASAH

1. Subject: PUBLIC ADDRESS SYSTEM. FROM Context Company.

2. Submittal Description:

PREQUALIFICATION FOR AZEIDK FOR FIRE ALARM FROM Context Company.

Received
10 MAR 2022
dar

Area Of Application : Mina camps and toilets Upgrade PK-2, PK-4 , toilet pk2

Drawing Ref. :

Specification Ref. : SECTION 275116

Attached PRQ Approval Copy : **Code** :

Attachments	No.
Sample Board	
Catalogue	√
Product Warranty	
Test Report	
Tech. Data	
Pre-Qualification	√
Compliance Statement	
Drawings	
Supplier Calculation	
Reply of comments	
Certificates	√
Method Statement	

Note: Original attachec ☑ Soft copy attached: ☑

3. MANUFACTURER / SUPPLIER:

Manufacturer & Address : **Context Company.**

Supplier & Address : **Azeidk.**

4. SBG Comments: ☐ Please proceed ☐ Refer to attached sheet

Submitted by	Name:	Eng.AbdAlguom Bashir	
	Signature		
DAR	Name:	Eng.Mohamed Ijmail	
	Signature		

شركة سفر للتجارة والمقاولات

This section will be used by Approving Authority only.

5. ENGINEER'S REPRESENTATIVE'S COMMENTS:

approved

A). Approved ☑

B). Approved as Noted ☐

C). Revise & Resubmit ☐

D). Rejected ☐

Eng. Name M. Ijmail Title Maf-S.E Signature Date 12/3/2022

Approval shall not relieve the Contractor of its obligations and liabilities under the Contract or constitute authorization of any change to Contract Documents, and therefore shall not imply any recognition whatsoever of additional time and/ or cost.

Document Submittal Form

Submittal Ref.	01101-SPC-MAT-ELE-000044	Revision	01	Date	26-11-2024
Project Title	**Almanar phase 1**				
Package					
Client	ROSHN Real Estate Company				
Engineer/Consultant	Hill International				
Contractor	Saudi Pan Kingdom Company (SAPAC)				

Discipline ☐ Civil ☐ Architecture ☐ Mechanical ■ Electrical ☐ Geotechnical (GEO)

Material Details		**List of Enclosure**
Specs. / BOQ / Drawings Reference	Specs: (ROSHN) Specification: SECTION 28 31 00 BOQ: Part 2 - Irrigation Pumping Station Fire Detection and Alarm System	PQL/ Copy of related spec's /BOQ
Specified Material	Addressable Fire Alarm Component.	COMPLIANCE
Proposed Material	Addressable Fire Alarm Component.	
Manufacturer / Local Supplier	AZEIDK Company	Others (Specify) Pre-Qualification
Reason for Alternative (if any)		
Remarks		

Contractor Signatures & Stamp:

Discipline Engineer	QA/ QC Manager	HSE Manager	MEP/Technical Manager	Construction Manager
Eng. Javed	Eng. M. Ahmad	Eng. A Kareem	Eng. Ibrahim	Eng. Tanveer Ahmad

Received By Engineer:

Name		**Signature**		**Date/ Time**	

Submittal Status:
☑ A- Approved ☐ B- Approved with Comments ☐ C- Revise and Resubmit ☐ D- Rejected

Engineer's Comments:

Approved

	Name	**Signature**	**Date**
Reviewed by (Engineer)	Ahmed Araby		03/12/2024
Approved by (Engineer)	Ala'a K.		04/12/2024
Received By (Contractor)			

Distribution:

☐ Engineer	☐ Contractor	☐ Others (Specify)	……

AAW & PARTNERS

المراسم الملكية

المحترفون المتطورة
Advance Professionals

PAGE 01 OF 01

ROJECT NAME: مشروع انشاء مطبخ مركزي نموذجي بقصر الزاهر بجدة
LOCATION: قصر الزاهر – جدة

DOCUMENT TRANSMITTAL/ SUBMITTAL

المستندات المقدمة

REF. NO.: 102 رقم:
DATE: 28/07/2024 تاريخ :

SUBMITTAL NO: MEC-MS-102R0

☒ New Submittal ☐ Re- Submittal

DISCIPLINE:

CIVIL ☐ ARCHITECTURAL ☐ STRUCTURAL ☐ MECHANICAL ☒ PLUMBING ☐ ELECTRICAL ☐ GENERAL ☐

ENCLOSURES (مرفقات)

Drawings ☐ مخططات material submittal ☒ مواد catalogs ☒ كتالوج Request for inspection ☐ طلب استلام اعمال

Specification ☒ مواصفات sample ☐ عينة sketch ☐ سكتش supplier ☐ مورد lab ☐ معمل - مختبر

test date ☐ بيانات اختبار schedule ☐ جداول report ☐ تقارير clarification ☐ توضيحات others ☐ اخرى

DRWG. NO. مخطط رقم / SPECS. NO: رقم المواصفة	رقم المراجعة REV.	بيـــــان DESCRIPTION	عدد النسخ NO. OF COPIES
	0	AUTOMATIC FIRE Alarm System – CONTEXT PLUS	1
		ATTACHED: TECHNICAL DATA SHEET	
		ATTACHED: PREVIOUS APPROVALS	

ANY REVIEW/APPROVAL FROM THE ENGINEER SHALL NOT RELIEVE THE CONTRACTOR OF HIS OBLIGATION TO PERFORM THE WORK IN ACCORDANCE WITH THE CONTRACT DOCUMENTS.

ITEM NO BOQ: البند بجدول الكميات أو العقد:

LOCATION / USE مكان الاستخدام: قصر الزاهر جدة

شركة المحترفون المتطورة للتجارة والمقاولات المحدودة
ملاحظات وتوصيات المهندس الاستشاري
مشروع المطبخ المركزي - قصر الزاهر
إدارة المشاريع

CO-ORDINATOR:
Name: AHMED SAMEH
Signature & Date:

REVIEWED BY:
Name: Ghadi Wazdan
Signature & Date:

CONSULTANT REPRESENTATIVE APPROVAL & COMMENTS:

١. لا مانع من اعتماد لوحة التحكم ذ ٢٠٠ مع ٢ حلقة
context plus 14 loops
٢. أن تكون اللوحة من الـ Listed
brand نفس الـ
٣. أن تكون كواشف الدخان والحرارة وجرس إنذار من نفس الـ

NAME/SIGNATURE: DATE/STAMP:

ACTION CODES:
A) Approved (موافقة) B) Approved As Noted (موافقة بملاحظات) C)Revised And Re-Submit (تعديل واعادة تقييم) D)Rejected(مرفوض)

OWNER REPRESENTATIVE APPROVAL & COMMENTS:

٤. توصيل الكواشف كما هو مبين بالكتالوج
٥. أن يتم تركيب الكواشف بالسقف وداخل شرشان الكابلات (Under ground)
٦. أن يتم ربط اللوحة مع انذار الحريق
٧. لتفعيل اللوحة نجب انه يكون كاشف الدخان + الحرارة activated سوياً

ACTION CODES:
A) Approved (موافقة) B) Approved As Noted (موافقة بملاحظات) C)Revised And Re-Submit (تعديل واعادة تقييم) D)Rejected(مرفوض)

NAME:

اعتماد المالك
١٢ لوحة الله حسبنا ملك
٣٠-٤-١٩٤٠

الختم

Scanned with CamScanner

الإدارة العامة للمشاريع والصيانة
إدارة المشاريع

وزارة الحج و العمرة
MINISTRY OF HAJJ AND UMRAH

نموذج رقم (م١٢)

طلب اعتماد مواد

اسم المشروع :	مشروع مستودع ارض الهاوة بمحطة حجاج البر بالمدينة المنورة			المقاول:	وزارة الحج و العمرة - إدارة الدراسات و التصاميم
المستشاري:	وزارة الحج و العمرة - إدارة المشاريع			نوع التقديم:	☐ جديد ☐ إعادة تقديم
رقم التقديم:		المسلسل:		تاريخ التقديم:	
رقم التقديم السابق:		تاريخ التقديم السابق:		المصنع/الماركة:	
المنشأ:				المورد:	

المرفقات				نطاق الأعمال	
☑ عينات	☐ كتالوج	☑ شهادات	☐ نشرة فنية	☐ دليل الاستخدام	☐ مدني	☐ معماري
☐ مخططات	☐ اعتمادات سابقة	☑ شهادة ضمان	☐ شهادة ضمان الصانع أو المورد		☑ كهرباء	☐ ميكانيكا
☐ حسابات	☐ نتائج اختبارات	☐ أخرى:			☐ أخرى:	

معلومات المادة

رقم البند	وصف البند	مواصفات المادة المقدمة
٦-١	نظام الإنذار (لوحة الإنذار - لوحة التكرار)	نظام النذار كاملا من انتاج شركة كونتكس (انجليزي)
٦-٢		
٦-٣		
٦-٤	نظام الإنذار (كاشف حراري- كاشف دخان -كاسر-جرس - محطة انذار يدوي)	
٦-٥		
٦-٦		

قرار المقاول: يقر المقاول بان العينة المقدمة متوافقة بشكل تام مع المخططات والعقد والمواصفات عدا ما ذكر في خانة الاستثناءات، وان الاعتماد لا يعفيه من التزاماته التعاقدية.

الاستثناءات:

معلومات مقدم الطلب

الاسم:

التوقيع/الختم:

التاريخ:

سمات السعودية
Souds samat
C.R.: 4031044308
C.C.R.: 21642

رأي أعضاء لجنة الاعتماد:

A يعتمد | B يعتمد مع وجود ملاحظات | C يعاد التقديم مع وجود ملاحظات | D مرفوض

التعليق والملاحظات: (اعتماد المواد والمخططات لا يعفي المقاول من التزاماته التعاقدية)

تقديم عينات حهد وشهادات الضمان وشهادات المصنع [redacted] صحيحة
المواصفات ومشروع سبق وتعديل الملاحظات السابقة

الاعتماد

	لجنة اعتماد العينات				المهندس المشرف	
الاسم	م / سعود المزين	م / يحي مدخلي	م / ياسر سعيد	م / حسين ميره	م /محمد أمين	م/ محمد الشريف
التوقيع						
التاريخ		٧/١٠/١٤٤٢هـ			٢٢/٩/١٤٤٢هـ	

الأصل . إدارة المشاريع

ص. للمقاول

Material Submittal

شركة أزيدك
لأجهزة السلامة

OWNER	: جمعية خيركم لتعليم القرآن الكريم وتحفيظه		
CONSULTANT	: الأبنية الحديثة	**Document No.** :	**MS-Mech-F.F-13**
CONTRACTOR	: **Azeidk Co. for Safety**	**Date** :	**06/07/2024**
PROJECT	: فندق لحظات	**Project No.** :	
LOCATION	:		

Project	فندق لحظات	Submittal No.	MS-Mech-F.F-13	Ref. Spec 's	
Ref. Dwg.		Date	6/07/2024		

Description:
Conventional Fire Alarm System - Context Plus - U.K

■ Catalogue ☐ Drawing ☐ Sample ■ Certificate ☐ Others

Having Checked this submittal, we certify it conforms to the requirements
Of the contract Documents in all respects, except as otherwise indicated herein

.....
.....
.....
.....
.....
.....

Contractor: Azeidk Co. for Safety **Signature**: ..... **Date**: 06/07/2024

ACTION
☑ Approved
☐ Approved As Noted
☐ Approved As Noted / Resubmittal Required
☐ Not Approved

Remarks/Comments

.....
.....
.....
.....
.....
.....
.....
.....

Profession	Name	Signature	Review Date
Site Manager	محمد ابو لادن		
Civil/Structural Engineer			
Electrical Engineer			
Mechanical Engineer			

MODERN BUILDING FOR CONSULTANCY
☑ A APPROVED
☐ B APPROVED AS NOTED
☐ C REVISE AND RESUBMIT
☐ D REJECTED
MB BUREAU REPRESENTATIVE SIGNATURE
10-7-2024

Material Submittal form

Submittal Ref:	SPC-OTCE-MK11-TSL-ELE-16	**Rev:**	00	**Date:**	11/12/2023
Program Title:	Developmental Housing Project of MOH WAVE #7				
Project Title:	Implementation of the housing development project units for the Al-Sadan project, (Contract No22000272) Alkhomra -Jeddah				
The Employer:	NHC - National Housing Company				
Third party:	Dar Al Riyadh				
Consultant:	O T C E Saudi Engineering Consulting Co.				
Contractor:	Saud Alsaadi & Partners Co. General Contracting & Trading (SPC)				

Guidance Notes:

The submission should only include materials which are compliant with the SOPR and CODE requirements and have been reviewed and coordinated between the Contractor and Designer (and Engineer if applicable) and should include any authorised variations / changes as instructed.

Review Discipline:

Architectural ☐	**Structural / Civil** ☐	**Mech / Plumb** ☐	**Elec.** ☒	**Others (Specify)** ☐

Material Details

Proposed by:

The Contractor		**The Consultant (Designer & The Engineer)**		**Specialist / Sub-Contractor**
Sign/ Stamp		**Sign/ Stamp**		**Sign/ Stamp**

Material Information & Checklist

Location /element Ref:	The Title: ELECTRICA PRODUCTS - Fire Alarm	Checklist of Attachments:	
Specified Material:	Fire Alarm – Context Plus	Drawing / Specification	☐
Proposed Material:	Azidek – Fire alarm	Product Datasheet	☒
SOPR/CODE Ref(s):		Compliance Certificates / Documents	☐
Manufacturer & Product code ref:	Supplier : azidek - Manufacturer/Brand : context plus	Compliance Statement	☐
Remarks / Notes:	SPC-OTCE-MK11-SAT-ELE-14	Sample (available)	☐

THE ENGINEER*	Review Date:	11/12/2023	Rejected	Approved	Signed:	#
	Print Name:	*Omar Labib*		✓		

Dar Al Riyadh	Recommendations to NHC Date:	12-12-2023	Objection	No Objection	Signed:	#
	Print Name:	*A R Khalil*		✓		

NHC	Review Date:		Objection	No Objection	Signed:	#
	Print Name:	#	#	#		

OWNER	CONSULTANT	CONTRACTOR
العربية للمراكز التجارية Arabian Centres	BUILD IN CONSULTING	Azidek أزيدك

PROJECT NAME: DANUBE - JEDDAH PARK	LOCATION: JEDDAH

MATERIAL SUBMITTAL / APPROVAL SHEET

☑ NEW SUBMITTAL	☐ RE-SUBMITTAL	SUBMITTAL DATE: 20/4/2022	SUBMITTAL NO.: MS-ELEC-1	REV.: 00

PURPOSE OF SUBMITTAL: ☑ FOR APPROVAL ☐ FOR COMMENTS ☐ FOR INFORMATION

DISCIPLINE: ☐ MECHANICAL ☐ Firefighting ☐ CIVIL ☑ ELECTRICAL ☐ H. V. A. C. ☐ PLUMBING ☐ OTHERS... Specify: Fire Alarm

MATERIAL NAME:	Adressable Fire Alarm System (Smoke and heat Detector - Sounder With Flasher - Manuall pull station - Monitor and Control Module)	ORIGIN:	United Kingdoom
BOQ. REFERENCE:		MANUFACTURER/SUPPLIER:	Context - Plus
SPECS. REF.:		SUPPLIER:	
DRAWING REF.:		MATERIAL DELIVERY PERIOD:	Stock
LOCATION:	JEDDAH	MATERIAL REQUIRED AT SITE:	Danube Jeddah PARK
QUANTITY:		SAMPLE ATTACHMENT:	
B. S. REFERENCE:		CERTIFICATE ATTACHMENT:	

WARRANTY FROM THE MANUFACTURER / SUPPLIER:

CONTRACTORS REMARKS (If any:)

CONSULTANTS COMMENTS:

APPROVED ADDRESSABLE FA SYSTEM (SMOKE, HEAT DETECTOR, SOUNDER WITH FLASHER - MANUAL PULL STATION AND CONTROL MODULE CONTEXT PLUS AS PER CATALOGUE INSTALLATION SHOULD BE AS PER NFPA 72

مؤسسة أزيدك للسلامة Azidek Safety Foundation

CONTRACTOR		CONSULTANT	
NAME:	Samir Mohamed	NAME:	MOHAMMED A. EDREES
POSITION:	Electrical Engineer	POSITION:	Consultant Engineer
SIGNATURE:		SIGNATURE:	
DATE:	20/4/2022	DATE:	21-4-2022

APPROVAL STATUS: ☐ A MATERIAL APPROVED ☐ B APPROVED WITH COMMENTS ☐ C MATERIAL REJECTED

RECEIVED BY: (CONSULTANT)	SIGNATURE: DATE:	RECEIVED BY: (CONTRACTOR)	SIGNATURE: DATE:

مشروع أعالي جدة

MATERIAL SUBMITTAL

القسم TRADE	ELECTRICAL / LOW CURRENT	Submittal No : رقم الطلب	مراجعة رقم : Revision No
Specs. Code & Ref / رمز التوصيف و المرجع	B.O.Q. Code Ref / رمز التصنيف في جداول الكميات	Part No / رقم القسم	NEA-GS-176
		Date Submitted: 28/SEP/2022 تاريخ التقديم:	
		Date Returned: تاريخ الارجاع:	

RECEIVED 29 Sep 2022 Solaiman SAK A. el Khereiji Consultant

No. رقم	Description البيان
	APPROVAL FOR FIRE ALARM SYSTEM
	SUPPLIER: AZEIDK FOR CONTRACTING
	MATERIAL DESCRIPTION:
	1. SMOKE DETECTOR / MODEL NO.: 55000-326IMC / SERIES 65A / BRAND: CONTEXT PLUS / CONTEXT PLUS COMMON BASE, 45681-200IMC
	2. MANUAL CALL POINTS / SA5900-908IMC / BRAND: CONTEXT PLUS.
	3. ALARM BELL / BRAND: CONTEXT PLUS.
	4. CONVENTIONAL FIRE DETECTION PANELS / 2 ZONE / BRAND: CONTEXT PLUS.
	ATTACHMENT:
	TECHNICAL DATA
	MATERIAL SAMPLE
	UL CERTIFICATE

شركة أبياتنا العقارية
Abyatona Real Estate Co.
مشروع الأمير فواز الجنوب - أعالي جدة
خاص بإعتماد المخططات الفنية
سجل تجاري 1010504729

Details التفاصيل

Submitted for الغاية من التقديم	
Approval	الموافقة ☑
Information	الاستعلام ☐
Coordination	التوافق ☐
Review	المراجعة ☐
Trade الموضوع	
Structural	عظم/انشائي ☐
Architectural	معماري ☐
Mechanical / Plumbing	ميكانيك/سباكة ☐
Civil defence	☐
Electrical	كهرباء ☑
Attachment المرفقات	
Certificates	الشهادات ☑
Tech. Brochure	منشور تقني ☐
Manufacturer's Data & Specs.	الصانع والمواصفات ☐
Shop Drawings	الرسم البياني ☐
Sample	عينة ☐
Manual	كتيب تعريف ☐
Data file	ملف بيانات ☐
As Built Drawings	مخطط على الواقع ☐
Warranty	ضمان ☐
Others (Specify)	أخرى (تذكر): ☐

For Contractor مخصص للمقاول

Prepared by / إعداد: 28/09/2022
Resident Engineer / مهندس الموقع

Submited By / تقديم: 29-9-2022
Tech. Off. Manager / مدير المكتب الفني

Noted by / ملاحظ
Project Manager / مدير المشروع

USE ONLY / خاص بالاستشاري

Received by / المستلم

Name / الاسم | Signature/التوقيع | Date: / /2022 التاريخ:

Remarks:

* لدى مانع من اعتماد مؤسسة أزيدك للمواد السعوديه وذلك لتوريد وتشغيل واختبار نظام انذار الحريق من نوعية ضمن البكيزيه Context Plus مع ضرورة الالتزام بالملاحظات التالية
1. ضرورة تقديم المخطط الشاملي قبل ختم الشركة مع ضرورة ربط النظام مع المصاعد ونظام الانذار
2. ضرورة الالتزام بالتربيط والمتطلبات الخاصه بالدفاع المدني بان يكون التعميد النهائي من جهة رسمية
3. ضرورة تقديم أصل شهادات الاختبار وشهادات الضمان وشهادات المنشأ موثقه من القنصلية السعودية
4. يلتزم المورد بتدريب الكادر المكلف بالتشغيل مع النظام بتقديم شهادة التدريب
5. أن يكون جميع مكونات النظام مطابقة للمواصفات القياسية السعودية
6. ضرورة تقديم ليزنس الكاشف المتعدد

Taken / الإجراء المتخذ

Approved مقبول ☐
Approved with comments مقبول مع وجود ملاحظات ☑ A
Revise and Resubmit يصحح ويعاد تقديمه ☐ B
Rejected مرفوض ☐ C D

Resident Engineer مهندس الموقع
Signature / التوقيع
Date 1-10-2022 التاريخ: / /

Approval, corrections or comments made relative to equipment during this review do not relieve the Contractor from compliance with the requirements of the drawings or specifications.
This check is only for review of general conformance with the design concept of the project and general compliance with the information given in the Contract documents.
The Contractor is responsible for confirming and correlating all quantities and dimensions, selecting fabrication processes and techniques of construction, coordinating his work with that of other trades, and performing his work in a safe, timely, and satisfactory manner.

Distribution / نسخة إلى

☐ OWNER المالك ☐ CONSULTANT الاستشاري ☐ CONTRACTOR المقاول

Received / المستلم

Contractor's Signature / توقيع المقاول ٢/٢

JHP-QC-IF-005-0

ZUHAIR FAYEZ PARTNERSHIP	MINISTRY OF DEFENSE	Art of foundations
CONSULTANT	CLIENT	CONTRACTOR

DOCUMENT SUBMITTAL
PROJECT NAME: Military police housing

SUBJECT: Fire Alarm & CCTV Camera – Prequalification

Specs. Code & Ref.	B.O.Q. Code Ref.	Drawing No.	Submittal No. DW-MP-EL-DC-016 Date Received: ~~13-12-2021~~ Date Returned: 15-12-2021

Sub-contractor
Name: AZIEDK Address:
Address: Phone: Telex:

Manufacturer
Name: AZIEDK
Address: JEDDAH
Phone: 0126880407
Fax: Telex:

Supplier/Agent
Name: AZIEDK
Address: Jeddah
Phone: 012-6880407
Fax: Telex:

Information submitted and attached:

Certificates	☑	Operation & Maintenance Manual	☐
Technical Brochure	☐	Spare Parts List	☐
Manufacturer's Data & Specs.	☑	As Built Drawings	☐
Shop Drawings	☐	Warranty	☐
Samples	☐	Others (specify)	☐

Contractor's Comments:

(4) CONTRACTOR SHALL PROVIDE UPDATED AUTHORIZATION LEETER FROM SUPPLIER AFTER RENEWAL FROM FIRE ALARM SYSTEM MANUFACTURER.

☐ See Attachment

Note: This review does not relieve the contractor of his responsibilities under the terms of the contract nor authorize additional compensation.

(Contractor)
Signature :
Date : 13-12-2021

Consultant's Comments (1) "AZIEDK" as Supplier and "Context plus" as Brand for "Addressable firealarm System is technically acceptable. ...
(3) * "HIKVISION" as Brand for CCTV Camera is acceptable. Contractor shall provide Warranty Certificate from Supplier.

☐ Attachment

Status:		Discipline		Sign & Date	Resident Engineer	Client Note
A - Approved	☐	■	Arch			
B -Approved as noted	☑	☐	Civil		Sign :	Sign:
C - Revise and submit	☑	☐	Mech		Date:	Date:
D - Rejected	☐	☒	Elect	19/12/21 (TOUFEEQ)	Name:	Name:
E - Noted/ NA	☐	☐	HVAC			
		☐	LS			

(2) Remarks: ** Contractor shall provide Project Completion Certificate of previously

ZUHAIR FAYEZ PARTNERSHIP	MINISTRY OF DEFENSE	Art of foundations
CONSULTANT	CLIENT	CONTRACTOR

MATERIAL SUBMITTAL DETAILS
PROJECT NAME

ubmittal No. : DW-MP-EL-DC-016

ITEM NO.	DESCRIPTION	REVIEW / APPROVAL STATUS
1	Fire Alarm	B & C
2	CCTV Camera	B

Reviewer Company Name: ZUHAIR FAYEZ PARTNERSHIP

Main Reviewer's Name: _____ Designation: _____ Signature: _____ Date: _____

Reviewer's Name: Mir Boufeq Ali Designation: Elect. Eng. Signature: Date: 19/12/21

شركة سفر للتجارة والمقاولات المحدودة
Safar Trading & Contracting Co. Ltd.

dar شركة دار الهندسة للتصميم والاستشارات الهندسية

كدانة KIDANA

الهيئة الملكية لمدينة مكة المكرمة والمشاعر المقدسة

CONTRACTOR : Safar Trading & Contracting Co. Ltd. | Date : **10-Mar-2022**

☑ New Submittal / ☐ Resubmittal	PRQ	Submittal Ref. No.:	DEPARTMENT					
			AR	CV	ST	ME	EL	LC
		MINA-C-GEN-SFR-PRQ-EL-ELC-00038-00	☐	☐	☐	☐	☑	☐

☐ **Material Submittal** ☐ **Sample Submittal** ☑ **Pre-qualification** ☐ **Method Statement** ☐ **Other**

To : DAR AL- HANDASAH

1. Subject: PUBLIC ADDRESS SYSTEM. FROM Context Company.

2. Submittal Description:

PREQUALIFICATION FOR AZEIDK FOR FIRE ALARM FROM Context Company.

Received
10 MAR 2022
dar

Area Of Application : Mina camps and toilets Upgrade PK-2, PK-4 , toilet pk2

Drawing Ref. :

Specification Ref. : SECTION 275116

Attached PRQ Approval Copy : **Code** :

Attachments	No.
Sample Board	
Catalogue	√
Product Warranty	
Test Report	
Tech. Data	
Pre-Qualification	√
Compliance Statement	
Drawings	
Supplier Calculation	
Reply of comments	
Certificates	√
Method Statement	

Note: Original attachec ☑ Soft copy attached: ☑

3. MANUFACTURER / SUPPLIER:

Manufacturer & Address : **Context Company.**

Supplier & Address : **Azeidk.**

4. SBG Comments: ☐ Please proceed ☐ Refer to attached sheet

Submitted by	Name:	Eng.AbdAlguom Bashir	
	Signature		
DAR	Name:	Eng.Mohamed Ijmail	
	Signature		

شركة سفر للتجارة والمقاولات

This section will be used by Approving Authority only.

5. ENGINEER'S REPRESENTATIVE'S COMMENTS:

approved

A). Approved ☑

B). Approved as Noted ☐

C). Revise & Resubmit ☐

D). Rejected ☐

Eng. Name M. Ijmail Title Maf-S.E Signature Date 12/3/2022

Approval shall not relieve the Contractor of its obligations and liabilities under the Contract or constitute authorization of any change to Contract Documents, and therefore shall not imply any recognition whatsoever of additional time and/ or cost.

OWNER	CONSULTANT	CONTRACTOR
العربية للمراكز التجارية Arabian Centres	BUILD IN CONSULTING	Azidek أزيدك

PROJECT NAME: DANUBE - JEDDAH PARK	LOCATION: JEDDAH

MATERIAL SUBMITTAL / APPROVAL SHEET

☑ NEW SUBMITTAL	☐ RE-SUBMITTAL	SUBMITTAL DATE: 20/4/2022	SUBMITTAL NO.: MS-ELEC-1	REV.: 00

PURPOSE OF SUBMITTAL: ☑ FOR APPROVAL ☐ FOR COMMENTS ☐ FOR INFORMATION

DISCIPLINE: ☐ MECHANICAL ☐ Firefighting ☐ CIVIL ☑ ELECTRICAL ☐ H. V. A. C. ☐ PLUMBING ☐ OTHERS... Specify: Fire Alarm

MATERIAL NAME:	Adressable Fire Alarm System (Smoke and heat Detector - Sounder With Flasher - Manuall pull station - Monitor and Control Module)	ORIGIN:	United Kingdoom
BOQ. REFERENCE:		MANUFACTURER/SUPPLIER:	Context - Plus
SPECS. REF.:		SUPPLIER:	
DRAWING REF.:		MATERIAL DELIVERY PERIOD:	Stock
LOCATION:	JEDDAH	MATERIAL REQUIRED AT SITE:	Danube Jeddah PARK
QUANTITY:		SAMPLE ATTACHMENT:	
B. S. REFERENCE:		CERTIFICATE ATTACHMENT:	

WARRANTY FROM THE MANUFACTURER / SUPPLIER:

CONTRACTORS REMARKS (If any:)

CONSULTANTS COMMENTS:

APPROVED ADDRESSABLE FA SYSTEM (SMOKE, HEAT DETECTOR, SOUNDER WITH FLASHER - MANUAL PULL STATION AND CONTROL MODULE CONTEXT PLUS AS PER CATALOGUE INSTALLATION SHOULD BE AS PER NFPA 72

مؤسسة أزيدك للسلامة Azidek Safety Foundation

CONTRACTOR		CONSULTANT	
NAME:	Samir Mohamed	NAME:	MOHAMMED A. EDREES
POSITION:	Electrical Engineer	POSITION:	Consultant Engineer
SIGNATURE:		SIGNATURE:	
DATE:	20/4/2022	DATE:	21-4-2022

APPROVAL STATUS: ☐ A MATERIAL APPROVED ☐ B APPROVED WITH COMMENTS ☐ C MATERIAL REJECTED

RECEIVED BY: (CONSULTANT)	SIGNATURE: DATE:	RECEIVED BY: (CONTRACTOR)	SIGNATURE: DATE:

أزيدك للمقاولات العامة
وأعمال الإلكتروميكانيكال
Azeidk for General Contracting & MEP Solutions

Context Plus

Shipment Conformity Certificate (Saber)

C.R.4030244617
012 6880407/0581444606
info@azeidk.com
www.azeidk.com

المقر الرئيسي - جدة:
برج الصفا، مقابل عزيز مول، أعلى شركة عبداللطيف جميل، مبنى A، الدور الثالث، مكتب رقم ٣٤٠.
الرياض:
حي الملز، شارع صلاح الدين، بجوار شركة زين، الدور الثاني، مكتب رقم ١٦.

تفاصيل الرقم المنسق

رمز النظام المنسق : 853110000002

الصنف بالعربية : اجهزة تنبيه ضد الحريق

الصنف بالإنجليزية : Fire alarms

الخدمة المتاحة

دليل الخدمة

منشأ المنتج

مستورد

العلامة التجارية

كنتكسة بلص

اسم الموديل

FIRE DETECTION AND ALARM EQUIPMENT

اسم المنتج بالإنجليزية

CONTEXT PLUS

وصف المنتج بالإنجليزي

بلد المنشأ

المملكة المتحدة

اسم الصانع بالإنجليزي

CONTEXT PLUS

عنوان الصانع بالإنجليزي 1







عودة (/ContactOfficer/ImportedFTRequest)

الهيئة السعودية للمواصفات والمقاييس والجودة (V 1.0.0.0) © 2024
تحت إشراف المواصفات السعودية Saudi Standards
تطوير وتشغيل REACH
رؤية VISION 2030 المملكة العربية السعودية KINGDOM OF SAUDI ARABIA
مسجلة لدى Registered on هيئة الحكومة الرقمية Digital Government Authority 20221213359
https://raqmi.dga.gov.sa/platforms/platforms/16f0b27b-f131-4766-b3b3-3d9d766c40e6/platform-license

منتج غير خاضع للوائح الفنية

شهادة مطابقة إرسالية للمنتجات المستوردة

Shipment Conformity Certificate for imported products

نقر ونتعهد نحن (..... شركة ازيدك لاجهزة السلامة .....) بأن جميع بيانات المنتجات الموجودة في طلب الإرسالية صحيحة، وأن المنتجات مطابقة للمواصفات القياسية السعودية واللوائح الفنية ذات العلاقة. ونتعهد بتوفير أي ملفات فنية للمنتجات تطلبها الهيئة السعودية للمواصفات والمقاييس والجودة أو من يمثلها لاحقًا، وفي حال تبين عدم صحة ذلك، نتحمل جميع التبعات النظامية المترتبة على ذلك.

Certificate Number	GB-24-1630457	Issue Date	25/11/2024	Expire Date	24/01/2025
Certificate Type	Shipment Conformity Certificate for Imported Products	Commercial Registration No.		4030267410 / 7012025560	
Establishment Address	5065 2 8073-22335 جدة				

Product and Manufacturer Data

Modal Name	FIRE DETECTION AND ALARM EQUIPMENT	Trademark	CONTEXT PLUS
Product Name	CONTEXT PLUS		
Product Description			
Country of origin	United Kingdom		
Production Date			
HS Code	853110000002		
Manufacturer Name	CONTEXT PLUS		
Exporter Name	IMCI SERVICES LTD	Exporter Address	UK

Establishment Stamp



نقر ونتعهد نحن (... شركة ازيدك لاجهزة السلامة ...) بأن المنتج ليس خاضعًا لأى من اللوائح الفنية المعتمدة من الهيئة كما أنه ليس بمنتج دوائي أو غذائي أو زراعي ولا يقع خارج نطاق المنتجات المشمولة باللوائح الفنية والمواصفات القياسية ذات العلاقة المعتمدة من الهيئة.

25/11/2024 00:06

Establishment Manager Signature



منتج غير خاضع للوائح الفنية

شهادة مطابقة إرسالية للمنتجات المستوردة

Shipment Conformity Certificate for imported products

Certificate Number	**GB-24-1630457**	HS Code	**853110000002**
Product Name	**CONTEXT PLUS**	Model Name	**FIRE DETECTION AND ALARM EQUIPMENT**
Quantity	**23217**	Unit	**UNIT**

Product invoices supplement

Invoice Number	Invoice Date	The amount of the item on the invoice	Invoices Currency
15123	**18/09/2024**	**92778.4**	**British Pound**

SASO
سابر
saber

شهادة مطابقة إرسالية للمنتجات المستوردة

Shipment Conformity Certificate for imported products

Certificate Number	GB-24-1630457	HS Code	853110000002
Product Name	CONTEXT PLUS	Model Name	FIRE DETECTION AND ALARM EQUIPMENT
Total Quantities	23217		

Model Number	License Number	Quantity	License Status
CP100RLR	Does not hold a license	500	
Z065040NMXCON	Does not hold a license	100	
Z045040PS	Does not hold a license	300	
58000450IMC	Does not hold a license	5000	
CP450SER	Does not hold a license	1000	
Z085040NM	Does not hold a license	1817	
64824547	Does not hold a license	500	
45681-200IMC	Does not hold a license	5000	
45184060	Does not hold a license	3000	
58000750IMC	Does not hold a license	250	
58200951IMC	Does not hold a license	500	
56000-005IMC	Does not hold a license	5000	
58000650IMC	Does not hold a license	250	

SASO
سابر
saber

شهادة مطابقة إرسالية للمنتجات المستوردة
Shipment Conformity certificate for imported products

نحن جهة تقويم المطابقة (QIMA Europe) رقم المكتب (06255) نتعهد بان جميع بيانات المنتجات الموجودة في طلب الإرسالية مطابق تماما لما ورد في شهادة مطابقة المنتج الممنوحة للمنتج سابقا. ونتعهد بتوفير أي ملفات فنية للمنتجات تطلبها الهيئة السعودية للمواصفات والمقاييس والجودة او من يمثلها لاحقا. وفي حال تبين عدم صحة ذلك التحمل جميع التبعات النظامية المترتبة على ذلك

Certificate Number	GB-20-0289362	Issue Date	21/10/2020
Certificate Type	Shipment Conformity Certificate for Imported Products	Commercial Registration No	4030267410
Establishment Address	5065 2 8073-22335 هدة	Shipment country	United Kingdom
Product Certificate No.	19117-062-20-216264		

Product and Manufacturer Data

Model type	FIRE DETECTION AND ALARM EQUIPMENT	Trade Mark	CONTEXT PLUS
Product Name	FIRE DETECTION AND ALARM EQUIPMENT		
Product Description	FIRE DETECTION AND ALARM EQUIPMENT	 	
Country of origin	United Kingdom		
Production Date			
HS Code	853110000002		
Technical Regulation	Technical Regulation for Fire Fighting Equipments and Materials		
Manufacturer name	CONTEXT PLUS		
Manufacturer Address			
Exporter name	IMCI SERVICES LTD	Exporter Address	PROGRESS HOUSE,NEWBy ROAD HAZEL GROVE.STOCKPORT. SK7 5DA

CB Organization Office Responsible manager signature

21/10/2020 06:30

CB Organization Office Stamp

شهادة مطابقة إرسالية للمنتجات المستوردة
Shipment Conformity certificate for imported products

نحن جهة تقويم المطابقة (QIMA Europe) رقم المكتب (06255) نتعهد بان جميع بيانات المنتجات الموجودة في طلب الإرسالية مطابق تماما لما ورد في شهادة مطابقة المنتج الممنوحة للمنتج سابقا. ونتعهد بتوفير أي ملفات فنية للمنتجات تطلبها الهيئة السعودية للمواصفات والمقاييس والجودة او من يمثلها لاحقا. وفي حال تبين عدم صحة ذلك التحمل جميع التبعات النظامية المترتبة على ذلك

Certificate Number	GB-20-0289362	Issue Date	21/10/2020
Certificate Type	Shipment Conformity Certificate for Imported Products	Commercial Registration No	4030267410
Establishment Address	5065 2 8073-22335 هدة	Shipment country	United Kingdom
Product Certificate No.	19117-062-20-216263		

Product and Manufacturer Data

Model type	FIRE ALARM PANEL EQUIPMENT	Trade Mark	CONTEXT PLUS
Product Name	FIRE ALARM PANEL EQUIPMENT		
Product Description		 	
Country of origin	United Kingdom		
Production Date			
HS Code	853120000000		
Technical Regulation	Technical Regulation for Telecommunications Devices		
Manufacturer name	CONTEXT PLUS		
Manufacturer Address			
Exporter name	IMCI SERVICES LTD	Exporter Address	PROGRESS HOUSE,NEWBy ROAD HAZEL GROVE.STOCKPORT. SK7 5DA

CB Organization Office Responsible manager signature

21/10/2020 06:30

CB Organization Office Stamp

QIMA
YOUR EYES IN THE SUPPLY CHAIN

شهادة مطابقة إرسالية للمنتجات المستوردة
Shipment Conformity certificate for imported products

نحن جهة تقويم المطابقة (QIMA Europe) رقم المكتب (06255) نتعهد بان جميع بيانات المنتجات الموجودة في طلب الارسالية مطابق تماما لما ورد في شهادة مطابقة المنتج الممنوحة للمنتج سابقا. ونتعهد بتوفير أي ملفات فنية للمنتجات تطلبها الهيئة السعودية للمواصفات والمقاييس والجودة او من يمثلها لاحقا. وفي حال تبين عدم صحة ذلك اتحمل جميع التبعات النظامية المترتبة على ذلك

Certificate Number	GB-20-0334933	Issue Date	25/11/2020
Certificate Type	Shipment Conformity Certificate for Imported Products	Commercial Registration No	4030267410
Establishment Address	5065 2 8073-22335 جدة	Shipment country	United Kingdom
Product Certificate No.	19117-062-20-216264		

Product and Manufacturer Data			
Model type	FIRE DETECTION AND ALARM EQUIPMENT	Trade Mark	CONTEXT PLUS
Product Name	FIRE DETECTION AND ALARM EQUIPMENT		
Product Description	FIRE DETECTION AND ALARM EQUIPMENT	 	
Country of origin	United Kingdom		
Production Date			
HS Code	853110000002		
Technical Regulation	Technical Regulation for Fire Fighting Equipments and Materials		
Manufacturer name	CONTEXT PLUS		
Manufacturer Address			
Exporter name	IMCI SERVICES LTD	Exporter Address	HAZEL GROVE,STOCKPORT,SK7 5DA UK

CB Organization Office Responsible manager signature



25/11/2020 05:40

CB Organization Office Stamp



Certificate Number	19117-062-20-216264	HS Code	853110000002
Product Name	FIRE DETECTION AND ALARM EQUIPMENT	Model type	FIRE DETECTION AND ALARM EQUIPMENT
Total quantities	20000.00		

Model Number	License Number	Quantity	License Status
55000-139IMC+45681-200IMC	Does not hold a license	5000	
55000-326IMC+45681-200IMC	Does not hold a license	15000	

سابر saber

Authorization Lettre

C.R.4030244617
012 6880407/0581444606
info@azeidk.com
www.azeidk.com

المقر الرئيسي - جدة:
برج الصفا، مقابل عزيز مول، أعلى شركة عبداللطيف جميل، مبنى A، الدور الثالث، مكتب رقم ٣٤٠.
الرياض:
حي الملز، شارع صلاح الدين، بجوار شركة زين، الدور الثاني، مكتب رقم ١٦.

CONTEXT PLUS LTD
Progress House, Newby Industrial Estate, Newby Road,
Hazel Grove, Stockport, Cheshire SK7 5DA, England.

Tel. Int: +44 (0)161 257 2541
Fax Int: +44 (0)161 225 8817
Email: sales@contextplus.co.uk
Web: www.contextplus.co.uk

AUTHORISED OVERSEAS DISTRIBUTION

PRODUCTS	**Context Plus Conventional and Intelligent Addressable Fire Alarm detectors, panels and accessories.**
COUNTRY OF MANUFACTURE	**UNITED KINGDOM**
TERRITORY	**Kingdom of Saudi Arabia**
AUTHORISED SALES & SERVICE CENTRE	**Azeidk Establishment for Safety Kilo 5, Old Makkah Road, Jeddah, Saudi Arabia.**
	The staff of Azeidk establishment are fully trained and qualified to program and commission the Context Plus addressable panels. They are capable of providing after sales support for the addressable fire systems of Context Plus Ltd.
WARRANTY	**Against manufacturing defects: 10 years for fire detectors and modules and 2 years for fire panels.**
TERM	**4 Years Renewable by Mutual Agreement.**
COMMENCEMENT	**1st of January 2022**

AUTHORISED OFFICER

DATE: 1st January 2022

CONTEXT PLUS LTD
PROGRESS HOUSE
NEWBY ROAD INDUSTRIAL ESTATE
HAZEL GROVE, STOCKPORT
GREATER MANCHESTER
SK7 5DA
UNITED KINGDOM

CONTEXT PLUS LTD
Progress House, Newby Industrial Estate, Newby Road,
Hazel Grove, Stockport, Cheshire SK7 5DA, England.

Tel. Int: +44 (0)161 257 2541
Fax Int: +44 (0)161 225 8817
Email: sales@contextplus.co.uk
Web: www.contextplus.co.uk

Date: 08/08/2022

Attention: King Faisal Specialist & Research Centre

Project: Supply, installation testing and commissioning of fire alarm system AL-Amoudia for King Faisal Specialist & Research Centre

We would like to inform you that Azeidk for safety is the exclusive sales distribution channel for Context Plus fire alarm systems in the Kingdom of Saudi Arabia.
Azeidk staff are fully trained and qualified to install, program and commission the Context Plus addressable panels. They are well able to provide an excellent after sales support for all Context Plus products.

Signed For and On Behalf of Context Plus Ltd
Stephen Stuart
Export Supervisor

CONTEXT PLUS LTD
PROGRESS HOUSE
NEWBY ROAD INDUSTRIAL ESTATE
HAZEL GROVE, STOCKPORT
GREATER MANCHESTER
SK7 5DA
UNITED KINGDOM

CONTEXT PLUS LTD
Progress House, Newby Industrial Estate, Newby Road,
Hazel Grove, Stockport, Cheshire SK7 5DA, England.

Tel. Int: +44 (0)161 257 2541
Fax Int: +44 (0)161 225 8817
Email: sales@contextplus.co.uk
Web: www.contextplus.co.uk

التاريخ: 2022/08/09

السادة / مستشفى الملك فيصل التخصصى ومركز الابحاث.

تحية طيبة وبعد.....

الموضوع: توريد وتركيب انظمة انذار الحريق فى قرية العمودية لمستشفى الملك فيصل التخصصى ومركز الابحاث

بالإشارة الى الموضوع اعلاه نفيدكم نحن شركة كونتكست بلس المحدودة لصناعة انظمة انذار الحريق – صناعة انجليزية - بأن مؤسسة ازيدك لمعدات السلامة هى الوكيل الحصرى للشركة داخل المملكة العربية السعودية.

وتم تدريب فريق العمل لدى مؤسسة ازيدك على تركيب وبرمجة وصيانة انظمة الانذار على اعلى المستويات ومعتمدين لدى الشركة للقيام بتلك الاعمال.

شركة كونتكست بلس المحدودة

CONTEXT PLUS LTD
PROGRESS HOUSE
NEWBY ROAD INDUSTRIAL ESTATE
HAZEL GROVE, STOCKPORT
GREATER MANCHESTER
SK7 5DA
UNITED KINGDOM

أزيدك للمقاولات العامة
وأعمال الإلكتروميكانيكال
Azeidk for General Contracting & MEP Solutions

Context Plus

Azeidk Co. Documents.

C.R.4030244617
012 6880407/0581444606
info@azeidk.com
www.azeidk.com

المقر الرئيسي - جدة:
برج الصفا، مقابل عزيز مول، أعلى شركة عبداللطيف جميل، مبنى A، الدور الثالث، مكتب رقم ٣٤٠.
الرياض:
حي الملز، شارع صلاح الدين، بجوار شركة زين، الدور الثاني، مكتب رقم ١٦.

المملكة العربية السعودية
الهيئة العليا للأمن الصناعي

الهيئة العليا للأمن الصناعي
High Commission For Industrial Security

رؤية VISION 2030
المملكة العربية السعودية
KINGDOM OF SAUDI ARABIA

وثيقة التأهيل

رقم الوثيقة: ٢٤٥٣٦٢١١٦٢٥

تاريخ إصدار الوثيقة	٢٠٢٤/١٠/٢١م	تاريخ إنتهاء الوثيقة	٢٠٢٥/١٠/٢١م
الاسم التجاري	شركة ازيدك للمقاولات العامه		
رقم السجل التجاري	٤٠٣٠٢٤٤٦١٧	موقعها الرئيسي	جدة
النشاط المرخص	مقاولات الوقاية والحماية من الحريق		
الفئة	مقاولات الوقاية والحماية من الحريق		

تصادق وترخص الهيئة العليا للأمن الصناعي لهذه المنشأة لمزاولة النشاط المذكور في هذه الوثيقة.

*هذه الوثيقة سارية للسجل التجاري الرئيسي وجميع السجلات التجارية الفرعية للمنشأة.

الهيئة العليا للأمن الصناعي
High Commission For Industrial Security





الهيئة العليا للأمن الصناعي
High Commission For Industrial Security

رخصة مزاولة نشاط

المملكة العربية السعودية
الهيئة العليا للأمن الصناعي

رقم الرخصة : ٢٣٥١٠٠٧٧٣٣٢

الإسم التجاري	شركة ازيدك للمقاولات العامه			
رقم السجل التجاري	٤٠٣٠٢٤٤٦١٧	الرقم الموحد للمنشآت(٧)	٧٠١٤١٢٦٢٦٧	
تاريخ الإصدار	١٤٤٤-٠٦-٢٦	تاريخ الإنتهاء	١٤٤٧-٠٦-٢٦	منطقة مزاولة النشاط	جدة
النشاط المرخص	البيع بالجملة لأجهزة ومعدات ومواد الوقاية والحماية من الحريق			
الأجهزة والمعدات				

تشهد الهيئة العليا للأمن الصناعي بأن المنشأة الموضحة أعلاه قد أستوفت كافة الإجراءات والإشتراطات النظامية لمزاولة النشاط الموضح أعلاه وقد أصدرت لها هذه الرخصة كمنشأة مصرح لها لمزاولة النشاط المذكور.

الهيئة العليا للأمن الصناعي
High Commission For Industrial Security



* للتحقق من صلاحية الرخصة الرجاء الدخول على منصة الهيئة العليا للأمن الصناعي https://hcis.gov.sa
* يتطلب وجود النشاط في السجل التجاري المذكور أعلاه، على ان يكون السجل التجاري ساري المفعول





الهيئة العليا للأمن الصناعي
High Commission For Industrial Security

رخصة مزاولة نشاط

المملكة العربية السعودية
الهيئة العليا للأمن الصناعي

رقم الرخصة : ٢٣٥١٠٠٧٧٣٣٢

الإسم التجاري	شركة ازيدك للمقاولات العامه			
رقم السجل التجاري	٤٠٣٠٢٤٤٦١٧	الرقم الموحد للمنشآت(٧)	٧٠١٤١٢٦٢٦٧	
تاريخ الإصدار	١٤٤٤-٠٦-٢٦	تاريخ الإنتهاء	١٤٤٧-٠٦-٢٦	منطقة مزاولة النشاط	جدة
النشاط المرخص	البيع بالجملة لأجهزة ومعدات ومواد الوقاية والحماية من الحريق			
الأجهزة والمعدات				

تشهد الهيئة العليا للأمن الصناعي بأن المنشأة الموضحة أعلاه قد أستوفت كافة الإجراءات والإشتراطات النظامية لمزاولة النشاط الموضح أعلاه وقد أصدرت لها هذه الرخصة كمنشأة مصرح لها لمزاولة النشاط المذكور.

الهيئة العليا للأمن الصناعي
High Commission For Industrial Security



* للتحقق من صلاحية الرخصة الرجاء الدخول على منصة الهيئة العليا للأمن الصناعي https://hcis.gov.sa
* يتطلب وجود النشاط في السجل التجاري المذكور أعلاه، على ان يكون السجل التجاري ساري المفعول

المملكة العربية السعودية
الهيئة العليا للأمن الصناعي

الهيئة العليا للأمن الصناعي
High Commission For Industrial Security

رؤية VISION 2030
المملكة العربية السعودية
KINGDOM OF SAUDI ARABIA

رخصة مزاولة نشاط

رقم الرخصة : ٢٣٥١٣١٠١٦٣٢

الإسم التجاري	شركة ازيدك لاجهزة السلامة				
رقم السجل التجاري	٤٠٣٢٢٦٣١٤١	الرقم الموحد للمنشآت(٧)	٧٠٣١٢٩٩٨٦٥		
تاريخ الإصدار	١٤٤٥-٠٥-٢٧	تاريخ الإنتهاء	١٤٤٨-٠٥-٢٧	منطقة مزاولة النشاط	الطائف
النشاط المرخص	البيع بالتجزئة لمعدات الإطفاء والإنقاذ				
الأجهزة والمعدات					

تشهد الهيئة العليا للأمن الصناعي بأن المنشأة الموضحة أعلاه قد أستوفت كافة الإجراءات والإشتراطات النظامية لمزاولة النشاط الموضح أعلاه وقد أصدرت لها هذه الرخصة كمنشأة مصرح لها لمزاولة النشاط المذكور.

* للتحقق من صلاحية الرخصة الرجاء الدخول على منصة الهيئة العليا للأمن الصناعي https://hcis.gov.sa
* يتطلب وجود النشاط في السجل التجاري المذكور أعلاه، على ان يكون السجل التجاري ساري المفعول

المملكة العربية السعودية
وزارة الداخلية
الهيئة العليا للأمن الصناعي
إدارة التراخيص الأمنية المركزية

رؤية VISION 2030
المملكة العربية السعودية
KINGDOM OF SAUDI ARABIA

رخصة مزاولة نشاط

رقم الرخصة : ٢٣٠٢١٠٧٩٣٦٧

الإسم التجاري	شركة أزيدك لأجهزة السلامة			
رقم السجل التجاري	٤٠٣٠٢٦٧٤١٠	الرقم الموحد للمنشآت(٧)	٧٠١٢٠٢٥٥٦٠	
تاريخ الإصدار	١٤٤٤-٠٨-٠٦	تاريخ الإنتهاء	١٤٤٧-٠٨-٠٦	منطقة مزاولة النشاط	جدة
النشاط المرخص	تركيب وصيانة أجهزة ومعدات الإطفاء			
الأجهزة والمعدات				

تشهد إدارة التراخيص الأمنية المركزية بأن المنشأة الموضحة أعلاه قد أستوفت كافة الإجراءات والإشتراطات النظامية لمزاولة النشاط الموضح أعلاه وقد أصدرت لها هذه الرخصة كمنشأة مصرح لها لمزاولة النشاط المذكور.

أمين عام الهيئة العليا للأمن الصناعي
عقيد مهندس/ عادل بن زايد العتيبي

* للتحقق من صلاحية الرخصة الرجاء الدخول على منصة الهيئة العليا للأمن الصناعي https://hcis.gov.sa
* يتطلب وجود النشاط في السجل التجاري المذكور أعلاه، على ان يكون السجل التجاري ساري المفعول

المملكة العربية السعودية
وزارة الداخلية
الهيئة العليا للأمن الصناعي
إدارة التراخيص الأمنية المركزية

رؤية VISION 2030
المملكة العربية السعودية
KINGDOM OF SAUDI ARABIA

رخصة مزاولة نشاط

رقم الرخصة : ٢٣٠٢٢٠٧٨٤٤٥

الإسم التجاري	شركة أزيدك لأجهزة السلامة			
رقم السجل التجاري	٤٠٣٠٢٦٧٤١٠	الرقم الموحد للمنشآت(٧)	٧٠١٢٠٢٥٥٦٠	
تاريخ الإصدار	١٤٤٤-٠٧-١١	تاريخ الإنتهاء	١٤٤٧-٠٧-١١	منطقة مزاولة النشاط	جدة
النشاط المرخص	تركيب وصيانة أجهزة ومعدات الإنذار من الحريق			
الأجهزة والمعدات				

تشهد إدارة التراخيص الأمنية المركزية بأن المنشأة الموضحة أعلاه قد أستوفت كافة الإجراءات والإشتراطات النظامية لمزاولة النشاط الموضح أعلاه وقد أصدرت لها هذه الرخصة كمنشأة مصرح لها لمزاولة النشاط المذكور.

أمين عام الهيئة العليا للأمن الصناعي
عقيد مهندس/ عادل بن زايد العتيبي

وزارة الداخلية
الأمانة العامة
الهيئة العليا للأمن الصناعي

* للتحقق من صلاحية الرخصة الرجاء الدخول على منصة الهيئة العليا للأمن الصناعي https://hcis.gov.sa
* يتطلب وجود النشاط في السجل التجاري المذكور أعلاه، على ان يكون السجل التجاري ساري المفعول

المملكة العربية السعودية
وزارة الداخلية
الهيئة العليا للأمن الصناعي
إدارة التراخيص الأمنية المركزية

رؤية VISION 2030
المملكة العربية السعودية
KINGDOM OF SAUDI ARABIA

رخصة مزاولة نشاط

رقم الرخصة : ٢٣٥١٠٠٧٧٣٣٢

الإسم التجاري	شركة أزيدك لأجهزة السلامة			
رقم السجل التجاري	٤٠٣٠٢٦٧٤١٠	الرقم الموحد للمنشآت(٧)	٧٠١٢٠٢٥٥٦٠	
تاريخ الإصدار	١٤٤٤-٠٦-٢٦	تاريخ الإنتهاء	١٤٤٧-٠٦-٢٦	منطقة مزاولة النشاط	جدة
النشاط المرخص	البيع بالجملة لأجهزة ومعدات ومواد الوقاية والحماية من الحريق			
الأجهزة والمعدات				

تشهد إدارة التراخيص الأمنية المركزية بأن المنشأة الموضحة أعلاه قد أستوفت كافة الإجراءات والإشتراطات النظامية لمزاولة النشاط الموضح أعلاه وقد أصدرت لها هذه الرخصة كمنشأة مصرح لها لمزاولة النشاط المذكور.

أمين عام الهيئة العليا للأمن الصناعي

عقيد مهندس/ عادل بن زايد العتيبي

* للتحقق من صلاحية الرخصة الرجاء الدخول على منصة الهيئة العليا للأمن الصناعي https://hcis.gov.sa
* يتطلب وجود النشاط في السجل التجاري المذكور أعلاه، على ان يكون السجل التجاري ساري المفعول

المملكة العربية السعودية
الهيئة العليا للأمن الصناعي

الهيئة العليا للأمن الصناعي
High Commission For Industrial Security

رؤية VISION 2030
المملكة العربية السعودية
KINGDOM OF SAUDI ARABIA

رخصة مزاولة نشاط

رقم الرخصة : ٢٤٥٠٦١١١٧٢٣

الإسم التجاري	شركة أزيدك لاجهزة السلامة			
رقم السجل التجاري	٤٠٣٠٥٥٣١٦٧	الرقم الموحد للمنشآت(٧)	٧٠٣٨٨٧٧١٤٣	
تاريخ الإصدار	١٤٤٥-١٠-٢٨	تاريخ الإنتهاء	١٤٤٨-١٠-٢٨	منطقة مزاولة النشاط	جدة
النشاط المرخص	تركيب وصيانة الأجهزة الأمنية			
الأجهزة والمعدات	كاميرات المراقبة الأمنية, أنظمة الدوائر التليفزيونية المغلقة, أجهزة وأنظمة الإنذار ضد السرقة, أجهزة وبوابات الكشف عن المعادن, أجهزة تفتيش الحقائب والطرود, أجهزة بوابات الدخول والخروج بالبطاقات الممغنطة والبصمة, السياج الأمني			

تشهد الهيئة العليا للأمن الصناعي بأن المنشأة الموضحة أعلاه قد أستوفت كافة الإجراءات والإشتراطات النظامية لمزاولة النشاط الموضح أعلاه وقد أصدرت لها هذه الرخصة كمنشأة مصرح لها لمزاولة النشاط المذكور.

الهيئة العليا للأمن الصناعي
High Commission For Industrial Security

* للتحقق من صلاحية الرخصة الرجاء الدخول على منصة الهيئة العليا للأمن الصناعي https://hcis.gov.sa
* يتطلب وجود النشاط في السجل التجاري المذكور أعلاه، على ان يكون السجل التجاري ساري المفعول

المملكة العربية السعودية
الهيئة العليا للأمن الصناعي

الهيئة العليا للأمن الصناعي
High Commission For Industrial Security

رؤية VISION 2030
المملكة العربية السعودية
KINGDOM OF SAUDI ARABIA

رخصة مزاولة نشاط

رقم الرخصة : ٢٣٥١٣١٠١٦٣٢

الإسم التجاري	شركة ازيدك لاجهزة السلامة				
رقم السجل التجاري	٤٠٣٢٢٦٣١٤١	الرقم الموحد للمنشآت(٧)	٧٠٣١٢٩٩٨٦٥		
تاريخ الإصدار	١٤٤٥-٠٥-٢٧	تاريخ الإنتهاء	١٤٤٨-٠٥-٢٧	منطقة مزاولة النشاط	الطائف
النشاط المرخص	البيع بالتجزئة لمعدات الإطفاء والإنقاذ				
الأجهزة والمعدات					

تشهد الهيئة العليا للأمن الصناعي بأن المنشأة الموضحة أعلاه قد أستوفت كافة الإجراءات والإشتراطات النظامية لمزاولة النشاط الموضح أعلاه وقد أصدرت لها هذه الرخصة كمنشأة مصرح لها لمزاولة النشاط المذكور.

* للتحقق من صلاحية الرخصة الرجاء الدخول على منصة الهيئة العليا للأمن الصناعي https://hcis.gov.sa
* يتطلب وجود النشاط في السجل التجاري المذكور أعلاه، على ان يكون السجل التجاري ساري المفعول

المملكة العربية السعودية
الهيئة العليا للأمن الصناعي

الهيئة العليا للأمن الصناعي
High Commission For Industrial Security

رؤية VISION 2030
المملكة العربية السعودية
KINGDOM OF SAUDI ARABIA

رخصة مزاولة نشاط

رقم الرخصة : ٢٣٠٢٢١٠٢٠٠٣

الإسم التجاري	شركة ازيدك لاجهزة السلامة				
رقم السجل التجاري	٤٠٣٢٢٦٣١٤١	الرقم الموحد للمنشآت(٧)	٧٠٣١٢٩٩٨٦٥		
تاريخ الإصدار	١٤٤٥-٠٦-٠١	تاريخ الإنتهاء	١٤٤٨-٠٦-٠١	منطقة مزاولة النشاط	الطائف
النشاط المرخص	تركيب وصيانة أجهزة ومعدات الإنذار من الحريق				
الأجهزة والمعدات					

تشهد الهيئة العليا للأمن الصناعي بأن المنشأة الموضحة أعلاه قد أستوفت كافة الإجراءات والإشتراطات النظامية لمزاولة النشاط الموضح أعلاه وقد أصدرت لها هذه الرخصة كمنشأة مصرح لها لمزاولة النشاط المذكور.

* للتحقق من صلاحية الرخصة الرجاء الدخول على منصة الهيئة العليا للأمن الصناعي https://hcis.gov.sa
* يتطلب وجود النشاط في السجل التجاري المذكور أعلاه، على ان يكون السجل التجاري ساري المفعول

المملكة العربية السعودية
وزارة الداخلية
الهيئة العليا للأمن الصناعي
إدارة التراخيص الأمنية المركزية

رؤية VISION 2030
المملكة العربية السعودية
KINGDOM OF SAUDI ARABIA

رخصة مزاولة نشاط

رقم الرخصة : ٢٣٥١١٠٨٢٧٠٨

الإسم التجاري	شركة أزيدك لاجهزة السلامة			
رقم السجل التجاري	٢٠٥٠١٦٨٠٢٥	الرقم الموحد للمنشآت(٧)	٧٠٣٣٨١٠٣٦٢	
تاريخ الإصدار	١٤٤٤-٠٩-٢٠	تاريخ الإنتهاء	١٤٤٧-٠٩-٢٠	منطقة مزاولة النشاط	الدمام
النشاط المرخص	البيع بالتجزئة لأجهزة ومعدات ومواد الوقاية والحماية من الحريق			
الأجهزة والمعدات				

تشهد إدارة التراخيص الأمنية المركزية بأن المنشأة الموضحة أعلاه قد أستوفت كافة الإجراءات والإشتراطات النظامية لمزاولة النشاط الموضح أعلاه وقد أصدرت لها هذه الرخصة كمنشأة مصرح لها لمزاولة النشاط المذكور.

أمين عام الهيئة العليا للأمن الصناعي

عقيد مهندس/ عادل بن زايد العتيبي

وزارة الداخلية - الأمانة العامة - الهيئة العليا للأمن الصناعي

* للتحقق من صلاحية الرخصة الرجاء الدخول على منصة الهيئة العليا للأمن الصناعي https://hcis.gov.sa
* يتطلب وجود النشاط في السجل التجاري المذكور أعلاه، على ان يكون السجل التجاري ساري المفعول

وزارة الشؤون البلدية والقروية والإسكان
Ministry of Municipal Rural Affairs & Housing

بلدي balady

رقم الشهادة 2022030862

تاريخ الاصدار 2022/04/25

اعتماد*

شهادة اعتماد
تصنيف مقدمي خدمات المدن

تمنح وزارة الشؤون البلدية والقروية والاسكان شهادة الاعتماد*

للمنشأة	مؤسسة ازيدك للمقاولات العامه

في قطاع التشييد والبناء

السجل التجاري	4030244617
النشاط	الإنشاءات العامة للمباني السكنية,الإنشاءات العامة للمباني الغير السكنية ، يشمل,(المدارس ، المستشفيات، الفنادق ...الخ)الإنشاءات العامة للمباني الحكومية,ترميمات المباني السكنية والغير سكنية

- يسري مفعول هذه الشهادة حتى تاريخ 04/10/1444 هـ / الموافق 25/04/2023 م
- تصدر هذه الشهادة الكترونياً وعلى الجهات المالكة للمشاريع التحقق من الشهادة المقدمة من خلال موقع الوزارة

وكيل الوزارة لتصنيف المقاولين
د. أحمد بن جميل قطان

تصنيف
مقدمي خدمات المدن

* هذه الشهادة منحت بغرض اصدار وثيقة التأمين ضد العيوب الخفية و الدخول في المنافسات الحكومية الأقل من قيمة مشاريع الدرجة الخامسة.

وزارة الشؤون البلدية والقروية والإسكان
بلدي balady
تنظيم مشغلي المدن

شهـــادة

تصنيف مقدمي خدمات المدن

تمنح وزارة الشؤون البلدية والقروية والإسكان شهادة تصنيف بالدرجة

الدرجة الأولى

للمنشأة: شركة ازيدك للمقاولات العامه

بيانات المنشأة

الرقم الوطني الموحد/ الترخيص	تاريخ إصدار السجل التجاري/ الترخيص	اسم مالك المنشأة	نوع المنشأة	جنسية المنشأة	رأس المال
7014126267	15/04/2013	غازي جابر درويش القحطاني	ذات مسئولية محدودة	سعودي	100000.0

بيانات شهادة التصنيف

رقم الشهادة	تاريخ الإصدار	درجة التقييم الائتماني	درجة التقييم الفني
2024005747	29/05/2024	BBB+	88.55

أنشطة شهادة التصنيف

المجال	الأنشطة
التشييد والبناء	الإنشاءات العامة للمباني السكنية,الإنشاءات العامة للمباني الغير السكنية ، يشمل,(المدارس ، المستشفيات، الفنادق ...الخ) الإنشاءات العامة للمباني الحكومية, ترميمات المباني السكنية والغير سكنية

- يسري مفعول هذه الشهادة حتى تاريخ 29/05/2026
- تصدر هذه الشهادة الكترونيا وعلى الجهات المالكة للمشاريع التحقق من الشهادة المقدمة من خلال موقع الوزارة.

وكيل الوزارة لتنظيم مشغلي المدن
عبدالرحمن بن أحمد العريني