أزيدك للمقاولات العامة
وأعمال الإلكتروميكانيكال
Azeidk for General Contracting & MEP Solutions

Title

Material Submittal for Fire Hose Cabinet

Brand

Falcon Gold

Falcon Gold
YOU ARE SAFE WITH US

C.R.4030244617
012 6880407/0581444606
info@azeidk.com
www.azeidk.com

المقر الرئيسي - جدة:
برج الصفا، مقابل عزيز مول، أعلى شركة عبداللطيف جميل، مبنى A، الدور الثالث، مكتب رقم ٣٤٠.
الرياض:
حي الملز، شارع صلاح الدين، بجوار شركة زين، الدور الثاني، مكتب رقم ١٦.

أزيدك للمقاولات العامة
وأعمال الإلكتروميكانيكال
Azeidk for General Contracting & MEP Solutions

Index

- *Technical Data Sheets (Catalogues).*
- *LPCB Approvals.*
- *Shipment Confirmity Certificate.*
- *Previous Approvals.*
- *Authorization Letter.*
- *Azeidk Co. Documents*

Falcon Gold

YOU ARE SAFE WITH US

C.R.4030244617
012 6880407/0581444606
info@azeidk.com
www.azeidk.com

المقر الرئيسي - جدة:
برج الصفا، مقابل عزيز مول، أعلى شركة عبداللطيف جميل، مبنى A، الدور الثالث، مكتب رقم ٣٤٠.
الرياض:
حي الملز، شارع صلاح الدين، بجوار شركة زين، الدور الثاني، مكتب رقم ١٦.

أزيدك للمقاولات العامة
وأعمال الإلكتروميكانيكال
Azeidk for General Contracting & MEP Solutions

Technical Data Sheets (Catalogues).

Falcon Gold

YOU ARE SAFE WITH US

C.R.4030244617
012 6880407/0581444606
info@azeidk.com
www.azeidk.com

المقر الرئيسي - جدة:
برج الصفا، مقابل عزيز مول، أعلى شركة عبداللطيف جميل، مبنى A، الدور الثالث، مكتب رقم ٣٤٠.
الرياض:
حي الملز، شارع صلاح الدين، بجوار شركة زين، الدور الثاني، مكتب رقم ١٦.

-FG-1001R

- SINGLE DOOR,
- SURFACE MOUNTED,
- MILD STEEL,
- FIRE HOSE REEL CABINET










-FGR-1001R

- SINGLE DOOR,
- RECESSED,
- MILD STEEL,
- FIRE HOSE REEL CABINET


- FIRE CABINET WITH FALCON GOLD HOSE REEL

- CABINET MANUFACTURED FROM MILD STEEL THICKNESS 1.2MM RAL3000 POWDER COATING
- CABINET DIMENSION W 800MM X H 800MM X D 230 MM
- CABINET FULLY POWDER COATED AND OVEN BAKED FOR APPEARANCE AND PROTECTION FROM RUST.
- SURFACE MOUNTED &RECESSED TYPE,RIGHT HAND OPENED, WITH WELDED HINGE FOR ENOUGH STRENGTH
- CABINET SUPPLIED WITH S.S ROUND LOCK FOR EASY AND FAST OPERATION.
- FULLY APPROVED TO LPCB EN671-1 STANDARD;
- HOSE REEL DRUMS PRESSED ON HYDRAULIC PRESS TO FORM RIBS FOR STRENGTH AND DURABILITY.
- HOSE REEL DISK EDGES ROLLED OVER FOR SAFE HANDLING AND AESTHETIC APPEARANCE.

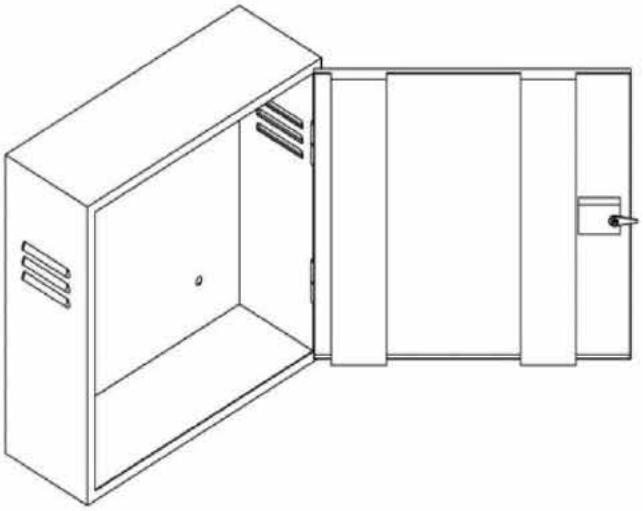





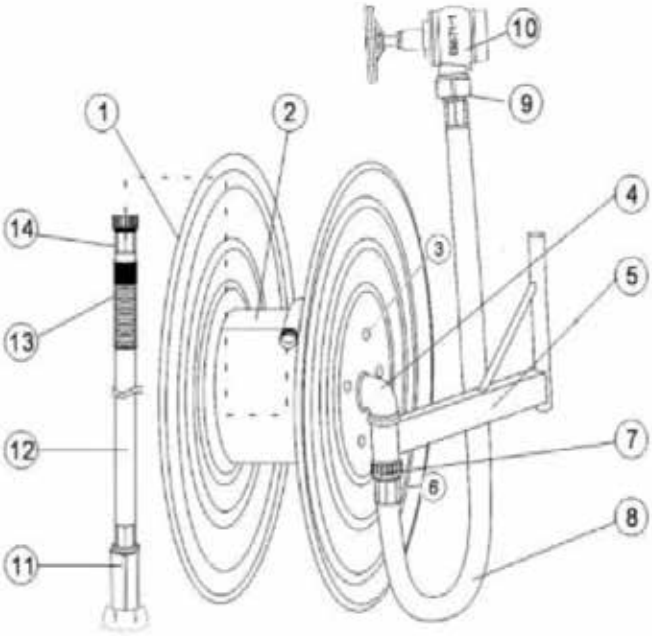

- SWINGING MANUAL HOSE REEL ASSY

• PARTS NAME

① HOSE REEL DISC ②HUB ③ LONG SCREW ROD ④ MANUAL WATERWAY ⑤ SWINGING ARM
⑥ CRIMPING SLEEVE ⑦ INLET JOINT ⑧ INLET HOSE ⑨ CONNECTOR ⑩ANGLE VALVE 1.5"-1" A-4 MODEL
⑪ NOZZLE N-04-2 ⑫ FIRE HOSE 25*30MTR ⑬ PROTECTIVE SPRING ⑭OUTLET JOINT

• FEATURES

- FULL BRASS WATERWAY WHICH WILL NEVER ROT.WE USE NIPPLES NOT HOSE CLAMPS, TO FILL IN THE INTERFACE BETWEEN HOSE AND WATERWAY. ONCE BEING SCREWED TIGHTLY,NO LEAKAGE.
- HOSE REEL WITH POWDER COATED AND ANTI-ULTRAVIOLET SIDE DISCS. THERE CAN BE PRESSURE GAUGE AT THE REEL AXIS.
- HIGH PRESSURE RESSISTANCE;WORKING AT 30 KG PRESSURE BUT NOT AFFECTED.
- ENDURANCE TEST ON REEL ROTATION; AFTER OVER 3000 ROTATION ,HOSE REELS SHOW NO VISIBLE LEAKAGE;OUR SWINGING HOSE REELS SHALL BE ABLE TO SWING 1000 TIMES TO MINIMUM 170° AND ALSO SHOW NO VISIBLE LEAKAGE OR DAMAGE.
- HIGH PRESSURE SPRAY.THE NOZZLE CAN BE ADJUSTED TO JET/SPRAY;
- OUR HOSE REELS CAN BE ALSO USED FOR CLEANING WHEN USED FOR FIRE FIGHTING.
- FIRE HOSE WITH ANTI-AGING AND ANTI-ULTRAVIOLET FUNCTION.MAXIMUM WP. IS 12BAR. EVERAGE BP.CAN BE UP TO 45BAR.

• PRODUCT SPECIFICATION & INSTALLATION MEASUREMENT

MODEL	HOSE SPECIFICATION (MM)	DIAMETER (MM)	BRACKET LENGTH (MM)	REEL WIDTH (MM)	HOSE PRESSUR(BAR)
FG-1001R	25MM×30MTR	600	290	150	12 BAR
FGR-1001R	25MM×30MTR	600	290	150	12 BAR

• USAGE


1 OPEN THE VALVE
2 PULL HOSE TOWARDS FIRE
3 OPEN NOZZLE TO SPRAY/JET AND AIM AT BASE OF FIRE.
4 AFTER USE,CLOSE THE VALVE
5 DRAIN WATER FROM HOSE
6 REWIND THE HOSE AND CLOSE NOZZLE .


-FGV-3001R


- DOUBLE DOOR,
- SURFACE MOUNTED,
- MILD STEEL,
- VERTICAL HOSE REEL CABINET





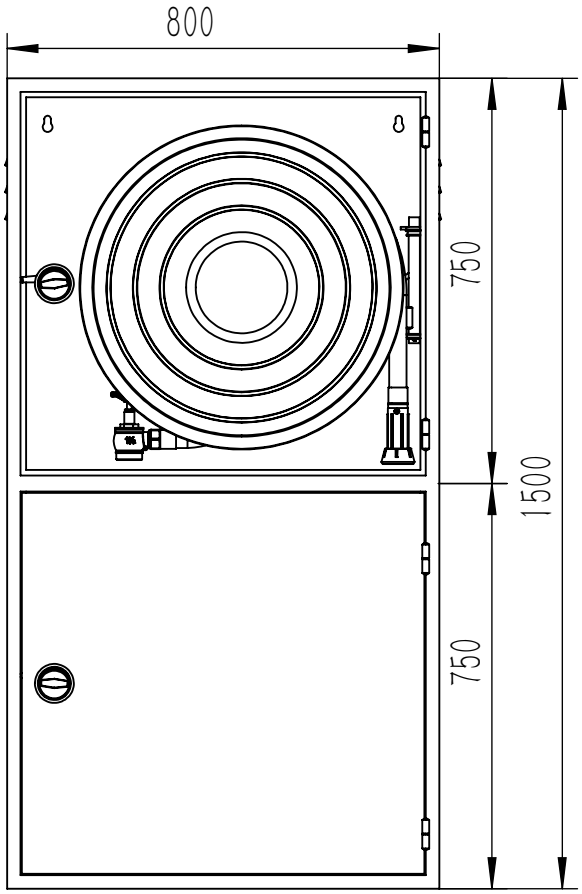

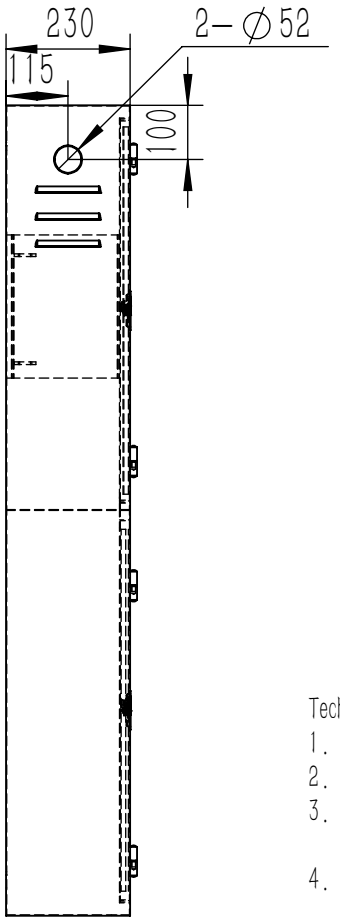

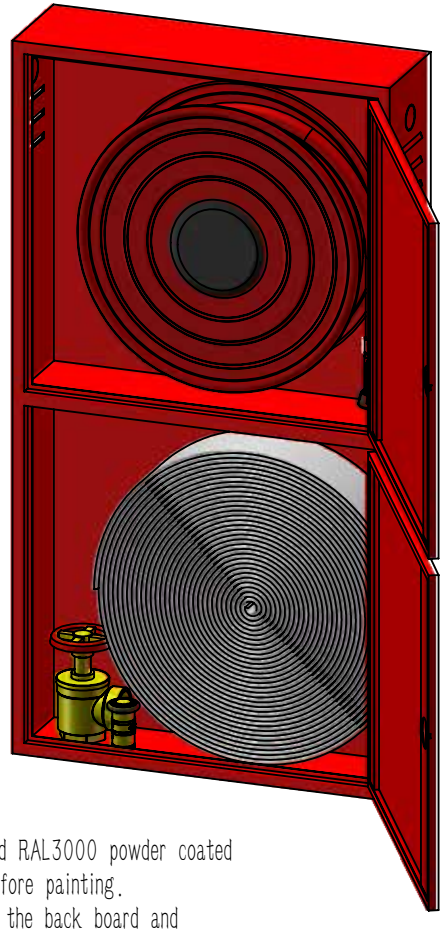

Technical requirements:

1. Cabinets made of 1.2mm mild steel and RAL3000 powder coated
2. Cabinet must be pickled and descale before painting.
3. Cabinet with four installation holes on the back board and two holes at the bottom– ϕ 10 drainage holes at bottom and dapboard
4. Cabinet supplied with round S.S round lock and welded hinge



NO.	Original Size	Modified	Revisor	Auditor	Date
△					
△					
△					
△					
△					
△					


Name	Surface Mounted Double Vertical Fire Cabinet			Approve	
Material	SPCC 1.2MM	Surface Colour	RAL3000	Design	
Drawing No.		Unit	mm	Draw	
		Proportion	1:10		
Falcon Gold				Revision	A

-FGV-3001R

- FIRE CABINET WITH FALCON GOLD HOSE REEL

- CABINET MANUFACTURED FROM MILD STEEL THICKNESS 1.2MM RAL3000 POWDER COATING
- CABINET DIMENSION W 1500MM X H 800MM X D 230 MM
- CABINET FULLY POWDER COATED AND OVEN BAKED FOR APPEARANCE AND PROTECTION FROM RUST.
- SURFACE MOUNTED TYPE,RIGHT HAND OPENED, WITH WELDED HINGE FOR ENOUGH STRENGTH
- CABINET SUPPLIED WITH S.S ROUND LOCK FOR EASY AND FAST OPERATION.
- FULLY APPROVED TO LPCB EN671-1 STANDARD;
- HOSE REEL DRUMS PRESSED ON HYDRAULIC PRESS TO FORM RIBS FOR STRENGTH AND DURABILITY.
- HOSE REEL DISK EDGES ROLLED OVER FOR SAFE HANDLING AND AESTHETIC APPEARANCE.



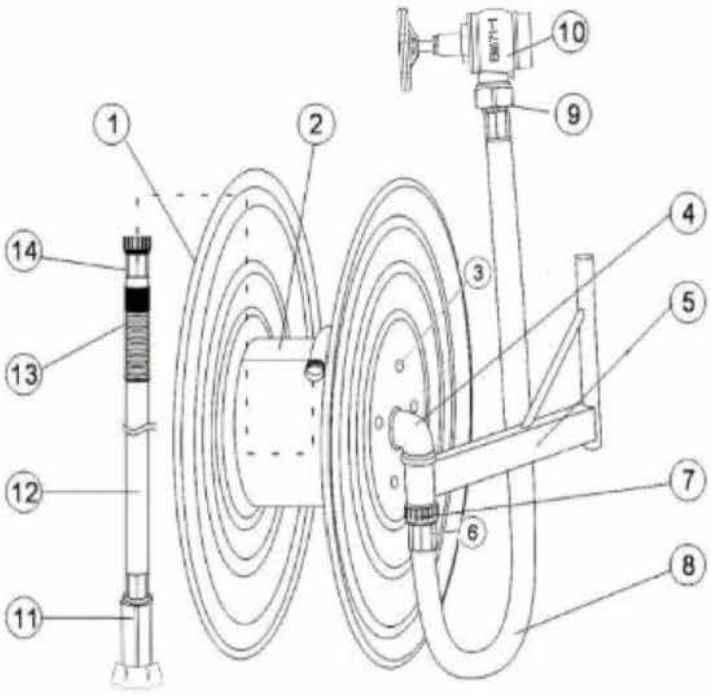

- SWINGING MANUAL HOSE REEL ASSY

• PARTS NAME

① HOSE REEL DISC ②HUB ③ LONG SCREW ROD ④ MANUAL WATERWAY ⑤ SWINGING ARM
⑥ CRIMPING SLEEVE ⑦ INLET JOINT ⑧ INLET HOSE ⑨ CONNECTOR ⑩ANGLE VALVE 1.5"-1" A-4 MODEL
⑪ NOZZLE N-04-2 ⑫ FIRE HOSE 25*30MTR ⑬ PROTECTIVE SPRING ⑭OUTLET JOINT

• FEATURES

- FULL BRASS WATERWAY WHICH WILL NEVER ROT.WE USE NIPPLES NOT HOSE CLAMPS, TO FILL IN THE INTERFACE BETWEEN HOSE AND WATERWAY. ONCE BEING SCREWED TIGHTLY,NO LEAKAGE.
- HOSE REEL WITH POWDER COATED AND ANTI-ULTRAVIOLET SIDE DISCS. THERE CAN BE PRESSURE GAUGE AT THE REEL AXIS.
- HIGH PRESSURE RESSISTANCE;WORKING AT 30 KG PRESSURE BUT NOT AFFECTED.
- ENDURANCE TEST ON REEL ROTATION; AFTER OVER 3000 ROTATION ,HOSE REELS SHOW NO VISIBLE LEAKAGE;OUR SWINGING HOSE REELS SHALL BE ABLE TO SWING 1000 TIMES TO MINIMUM 170° AND ALSO SHOW NO VISIBLE LEAKAGE OR DAMAGE.
- HIGH PRESSURE SPRAY.THE NOZZLE CAN BE ADJUSTED TO JET/SPRAY;
- OUR HOSE REELS CAN BE ALSO USED FOR CLEANING WHEN USED FOR FIRE FIGHTING.
- FIRE HOSE WITH ANTI-AGING AND ANTI-ULTRAVIOLET FUNCTION.MAXIMUM WP. IS 12BAR. EVERAGE BP.CAN BE UP TO 45BAR.

• PRODUCT SPECIFICATION & INSTALLATION MEASUREMENT

MODEL	HOSE SPECIFICATION (MM)	DIAMETER (MM)	BRACKET LENGTH (MM)	REEL WIDTH (MM)	HOSE PRESSUR(BAR)
FGV-3001R	25MM×30MTR 65MM×30MTR	600	290	150	12 BAR 17 BAR

• USAGE


1 OPEN THE VALVE
2 PULL HOSE TOWARDS FIRE
3 OPEN NOZZLE TO SPRAY/JET AND AIM AT BASE OF FIRE.
4 AFTER USE,CLOSE THE VALVE
5 DRAIN WATER FROM HOSE
6 REWIND THE HOSE AND CLOSE NOZZLE⑪ .

Hose angle valve

Hose angle valve (Angle hose valve) is used to control water flow for fire department outlet connection, or with fire hose rack assembly. It features angle pattern and rising stem, tight sealing, ideal for wet piping system.



- Certificate: UL Listed / FM Approved
- Standard: ANSI / UL 668
- Function: FDC outlet, or hose rack assembly
- W. pressure: 300 psi
- Surface: Rough / polished / chrome plated

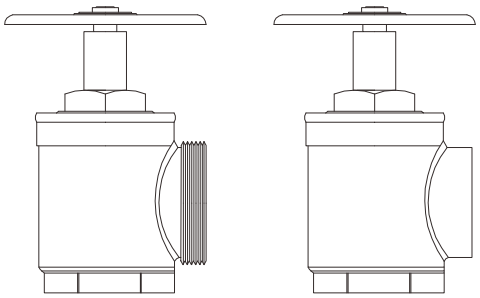

Main parts and material

Body / bonnet	Cast or forged brass	**Handwheel**	Ductile iron, red
Seat seal	EPDM rubber	**Outlet cover**	Brass cap, pin lug with chain (Optional)

Available size


Size	Pattern	Inlet	Outlet	Working pressure (psi)
1-1/2"	Angle	1-1/2" NPT, F	1-1/2" NH, M	300
1-1/2"	Angle	1-1/2" NPT, F	1-1/2" NPT, F	300
1-1/2"	Angle, hydrolator	1-1/2" NPT, F	1-1/2" NH, M	300
1-1/2"	Angle, hydrolator	1-1/2" NPT, F	1-1/2" NPT, F	300
2-1/2"	Angle	2-1/2" NPT, F	2-1/2" NH, M	300
2-1/2"	Angle	2-1/2" NPT, F	2-1/2" NPT, F	300
2-1/2"	Angle	2-1/2" GRV	2-1/2" NH, M	300
2-1/2"	Angle	2-1/2" GRV	2-1/2" NPT, F	300

Adjustable fog nozzle

Adjustable fog nozzle (Portable spray nozzle) is normally used as rack nozzle with fire hose mounted on standpipe systems. It is adjustable by rotational control from wide fog, narrow fog, straight stream, to shut-off.



- Certificate: UL Listed
- Standard: UL 401, NFPA 14 / 1964
- Fire type: Class A and B
- Fire agent: Water
- Material: Cast brass / polycarbonate
- Feature: Adjustable, shut-off feature
- Surface: Rough / polished / chrome plated

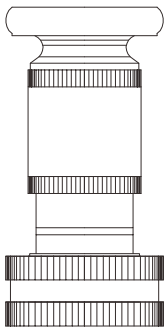

Main parts and material

Barrel / base	Forged brass / polycarbonate	**Stem (T-head)**	Forged brass / polycarbonate
Packing	Synthetic rubber	**Rubber bumper**	NBR

Available size


Size	Material	Inlet	Max inlet pressure (psi)	Rated operating pressure (psi)	Rated flow (gpm)
1-1/2"	Cast brass	1-1/2" NH, F	200	100	130
1-1/2"	Cast brass	1-1/2" NH, F	200	100	110
1-1/2"	Polycarbonate	1-1/2" NH, F	175	100	115
2-1/2"	Cast brass	2-1/2" NH, F	200	100	280
2-1/2"	Cast brass	2-1/2" BS336	200	100	280
1-1/2"	Cast brass	1-1/2" NH, F	200	100	90
2-1/2"	Cast brass	2-1/2" NH, F	200	100	200
2-1/2"	Polycarbonate	2-1/2" NH, F	175	100	273

Layflat fire hose

Layflat fire hose is typically used by the fire service to convey large quantities of high pressure water to the fire. For type 1 hose, it is conventional hose for general purpose, flexible, lightweight, without external treatment.



- Certificate: UL Listed
- Standard: BS 6391, DIN 14811, UL 19
- Feature: uncoated
- Color: White, standard
- Avail coating: Dyed or pigmented red, green, etc.
- Temperature: -40°C to 70°C

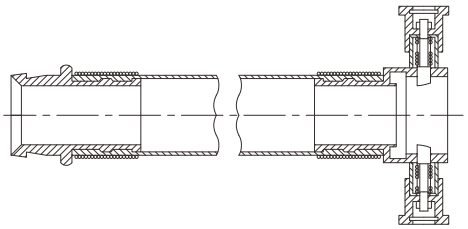

Main parts and material

Lining	EPDM, impermeable elastomeric layer	**Jacket (Reinforcement)**	100% high tenacity polyester, circular woven
Coupling	Aluminum / copper, BS 336 instantaneous,NH or Storz	**Packing**	Rolled

Available size

Size	Type	ID bore (mm)	End connection	Length (m)	Working pressure (psi)	Proof pressure (psi)	Burst pressure (psi)
1.5"	Single jacket	38	2.5" BS336	15, 23, 30, 45, etc.	250	375	750
2.5"	Single jacket	65	2.5" BS336	15, 23, 30, 45, etc.	250	375	750

Note:
1. The couplings are pre-assembled on both ends of fire hose through galvanized mild steel wire and applied over a hose guard for protection.
2. Other size is available, including 1.75", 2", 3", 4", etc.

-FG-1001S

- SINGLE DOOR,
- SURFACE MOUNTED,
- STAINLESS STEEL
- FIRE HOSE REEL CABINET













-FGR-1001S

- SINGLE DOOR,
- RECESSED
- STAINLESS
- FIRE HOSE REEL CABINET

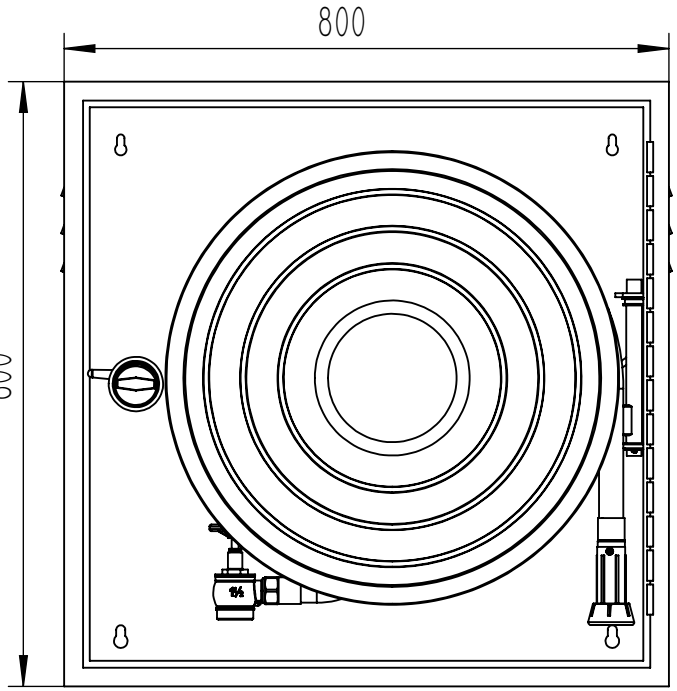

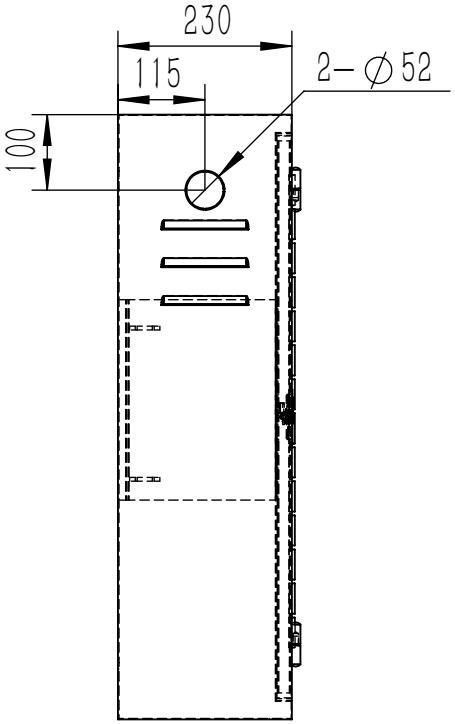

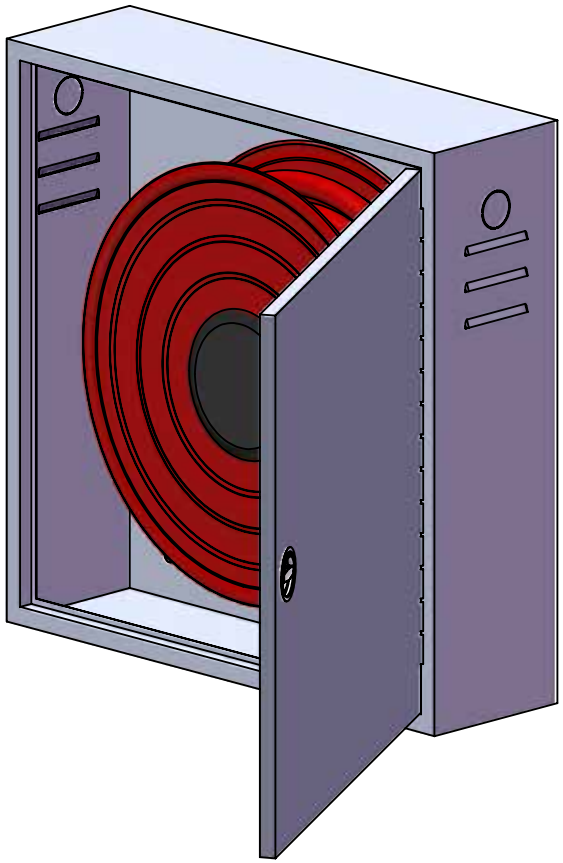

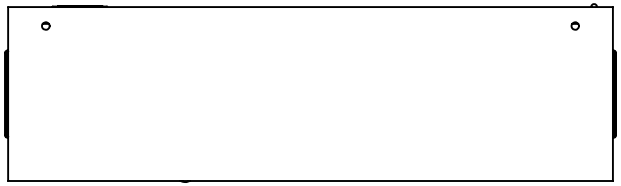



Technical requirements:


1. Cabinets made of 1.2mm SUS304
2. Cabinet must be pickled and descale before painting.
3. Cabinet with four installation holes on the back board and two holes at the bottom– ϕ 10 drainage holes at bottom
4. Cabinet supplied with round S.S round lock and S.S piano hinge


NO.	Original Size	Modified	Revisor	Auditor	Date						
△						Name	Surface Mounted Fire Cabinet			Approve	
△											
△						Material	SUS304 1.2MM	Surface Colour		Design	
△											
△						Drawing No.		Unit	mm	Draw	
△								Proportion	1:10		
△						Falcon Gold				Revision	A

-FG-1001S

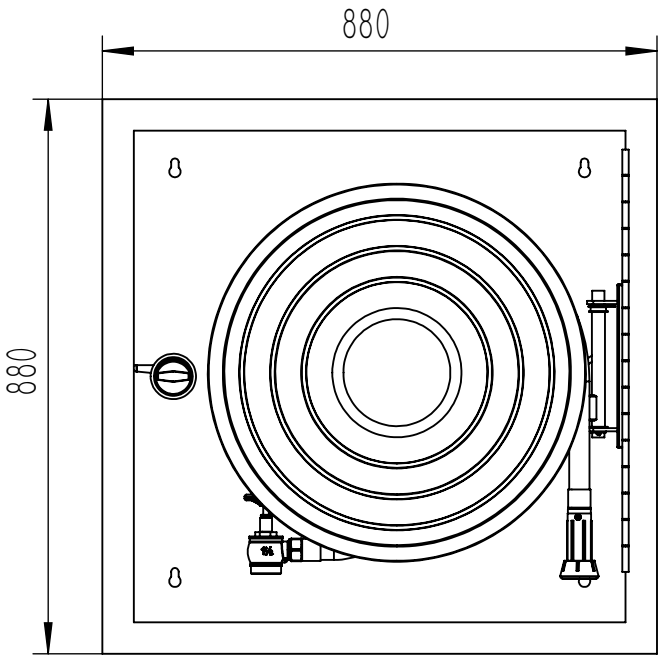

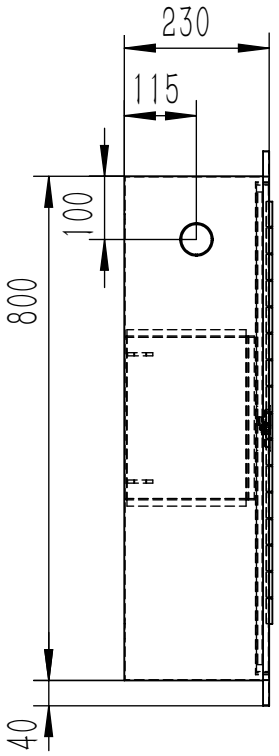

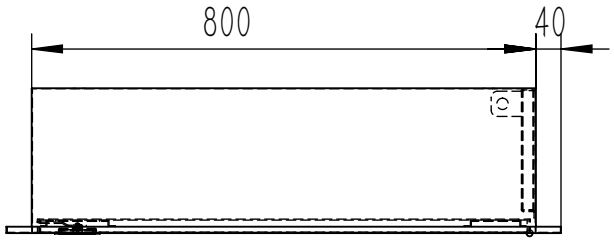

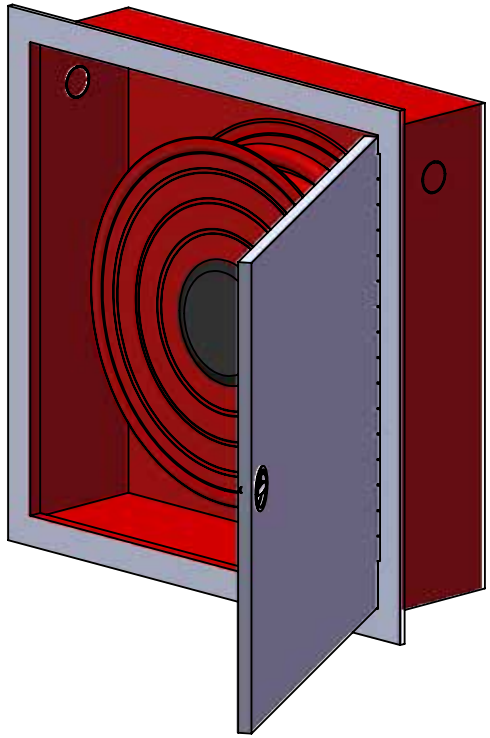

Technical requirements:

1. Cabinets body made of 1.2mm mild steel and RAL3000 powder coated.
2. Cabinet architrave and door 304 stainless steel 1.2mm, brush finish.
3. Cabinet must be pickled and descale before painting.
4. Cabinet with two installation holes on the back board
5. Cabinet supplied with round S.S round lock and S.S piano hinge .


NO.	Original Size	Modified	Revisor	Auditor	Date
△					
△					
△					
△					
△					
△					

Name	Recessed Mounted Fire Cabinet			Approve
Material	SUS304 1.2MM+ SPCC1.2MM	Surface Colour	RAL3000	Design
Drawing No.		Unit	mm	Draw
		Proportion	1:10	
Falcon Gold				Revision A

-FGR-1001S


- FIRE CABINET WITH FALCON GOLD HOSE REEL

- SURFACE MOUNTED CABINET MANUFACTURED FROM-FULLY STAINLESS 304 THICKNESS 1.2MM.
- CABINET DIMENSION W 800MM X H 800MM X D 230 MM
- RECESED CABINET ONLY DOOR STAINLESS STEEL OTHER POWDER COATED AND OVEN BAKED FOR APPEARANCE AND PROTECTION FROM RUST.
- SURFACE MOUNTED &RECESSED TYPE,RIGHT HAND OPENED, WITH STAINLESS STEEL PIANO HINGE FOR ENOUGH STRENGTH
- CABINET SUPPLIED WITH S.S ROUND LOCK FOR EASY AND FAST OPERATION.
- FULLY APPROVED TO LPCB EN671-1 STANDARD;
- HOSE REEL DRUMS PRESSED ON HYDRAULIC PRESS TO FORM RIBS FOR STRENGTH AND DURABILITY.
- HOSE REEL DISK EDGES ROLLED OVER FOR SAFE HANDLING AND AESTHETIC APPEARANCE.

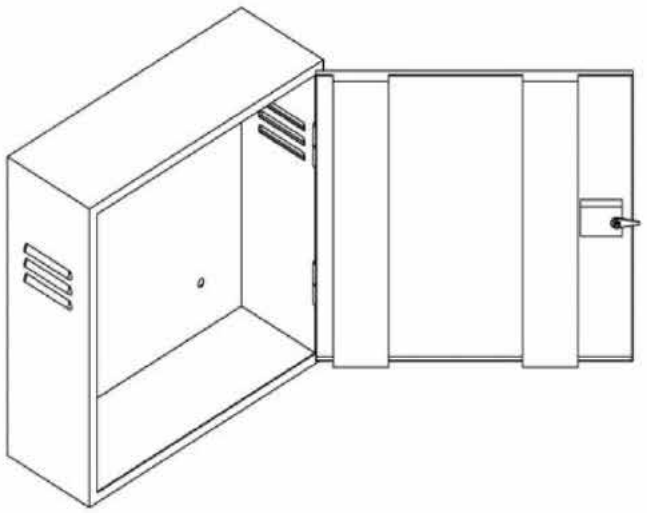





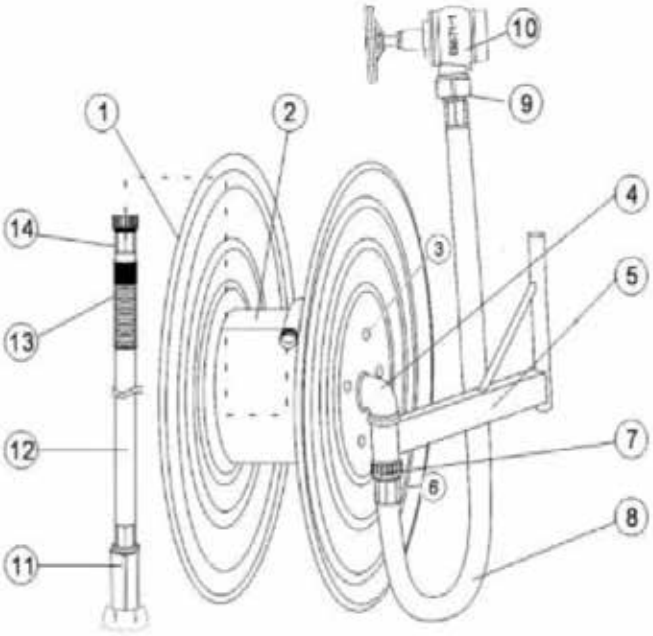

- SWINGING MANUAL HOSE REEL ASSY

• PARTS NAME

① HOSE REEL DISC ②HUB ③ LONG SCREW ROD ④ MANUAL WATERWAY ⑤ SWINGING ARM
⑥ CRIMPING SLEEVE ⑦ INLET JOINT ⑧ INLET HOSE ⑨ CONNECTOR ⑩ANGLE VALVE 1.5"-1" A-4 MODEL
⑪ NOZZLE N-04-2 ⑫ FIRE HOSE 25*30MTR ⑬ PROTECTIVE SPRING ⑭OUTLET JOINT

• FEATURES

- FULL BRASS WATERWAY WHICH WILL NEVER ROT.WE USE NIPPLES NOT HOSE CLAMPS, TO FILL IN THE INTERFACE BETWEEN HOSE AND WATERWAY. ONCE BEING SCREWED TIGHTLY,NO LEAKAGE.
- HOSE REEL WITH POWDER COATED AND ANTI-ULTRAVIOLET SIDE DISCS. THERE CAN BE PRESSURE GAUGE AT THE REEL AXIS.
- HIGH PRESSURE RESSISTANCE;WORKING AT 30 KG PRESSURE BUT NOT AFFECTED.
- ENDURANCE TEST ON REEL ROTATION; AFTER OVER 3000 ROTATION ,HOSE REELS SHOW NO VISIBLE LEAKAGE;OUR SWINGING HOSE REELS SHALL BE ABLE TO SWING 1000 TIMES TO MINIMUM 170° AND ALSO SHOW NO VISIBLE LEAKAGE OR DAMAGE.
- HIGH PRESSURE SPRAY.THE NOZZLE CAN BE ADJUSTED TO JET/SPRAY;
- OUR HOSE REELS CAN BE ALSO USED FOR CLEANING WHEN USED FOR FIRE FIGHTING.
- FIRE HOSE WITH ANTI-AGING AND ANTI-ULTRAVIOLET FUNCTION.MAXIMUM WP. IS 12BAR. EVERAGE BP.CAN BE UP TO 45BAR.

• PRODUCT SPECIFICATION & INSTALLATION MEASUREMENT

MODEL	HOSE SPECIFICATION (MM)	DIAMETER (MM)	BRACKET LENGTH (MM)	REEL WIDTH (MM)	HOSE PRESSUR(BAR)
FG-1001S	25MM×30MTR	600	290	150	12 BAR
FGR-1001S	25MM×30MTR	600	290	150	12 BAR

• USAGE

1 OPEN THE VALVE
2 PULL HOSE TOWARDS FIRE
3 OPEN NOZZLE TO SPRAY/JET AND AIM AT BASE OF FIRE.
4 AFTER USE,CLOSE THE VALVE
5 DRAIN WATER FROM HOSE
6 REWIND THE HOSE AND CLOSE NOZZLE⑪ .

-FG-2001R

- DOUBLE DOOR,
- SURFACE MOUNTED,
- MILD STEEL,
- FIRE HOSE REEL CABINET











-FGR-2001R

- DOUBLE DOOR,
- SURFACE MOUNTED,
- MILD STEEL,
- VERTICAL HOSE REEL CABINET

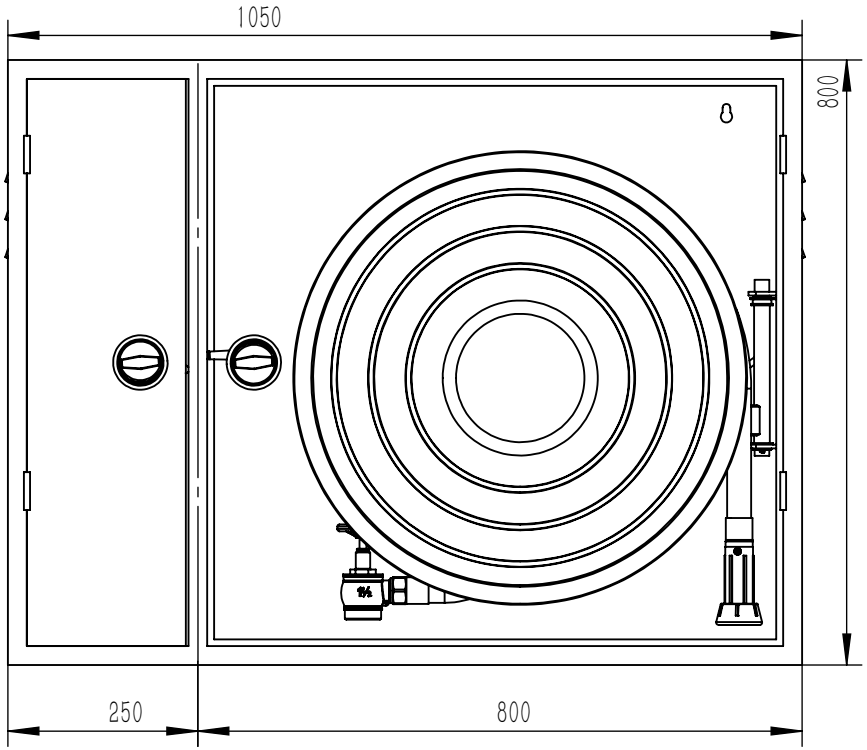


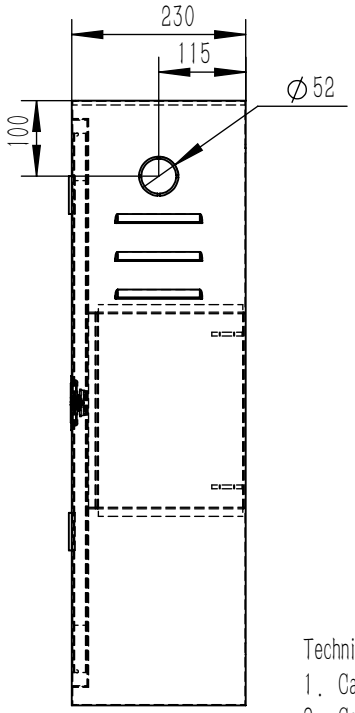



Technical requirements:


1. Cabinets made of 1.2mm mild steel and RAL3000 powder coated
2. Cabinet must be pickled and descale before painting.
3. Cabinet with four installation holes on the back board and two holes at the bottom— ϕ 10 drainage holes at bottom
4. Cabinet supplied with round S.S round lock and welded hinge

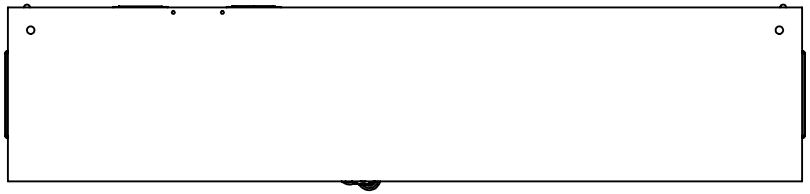



- FG-2001R


NO.	Original Size	Modified	Revisor	Auditor	Date
△					
△					
△					
△					
△					
△					

Name	Surface mounted fire cabinet ,1050x800x230			Approved	
Material	SPCC 1.2mm	Surface Treatment	RAL3000	Design	
Drawing Number	----------	Unit	mm	Draw	
		Proportion	1:10		
Falcon Gold				Revision	A

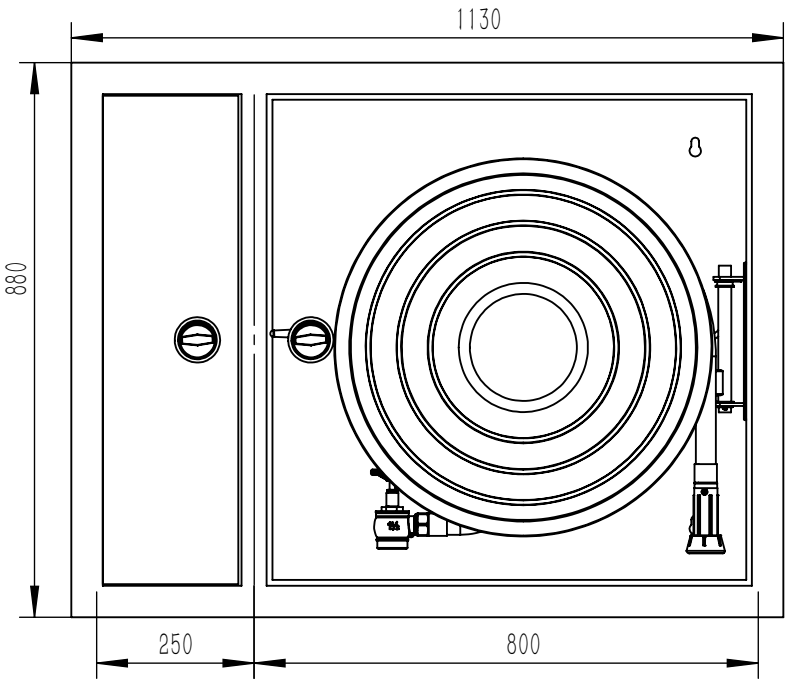

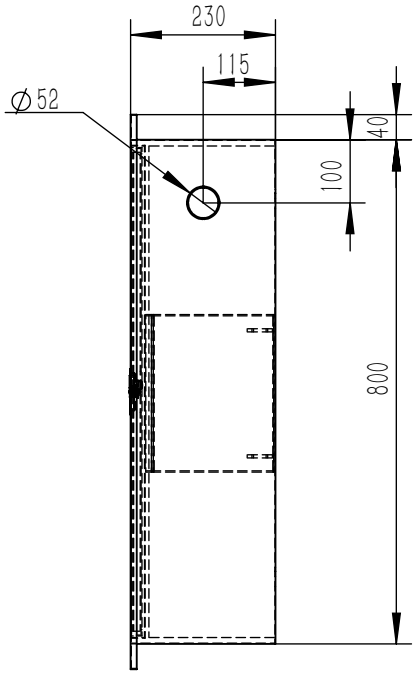

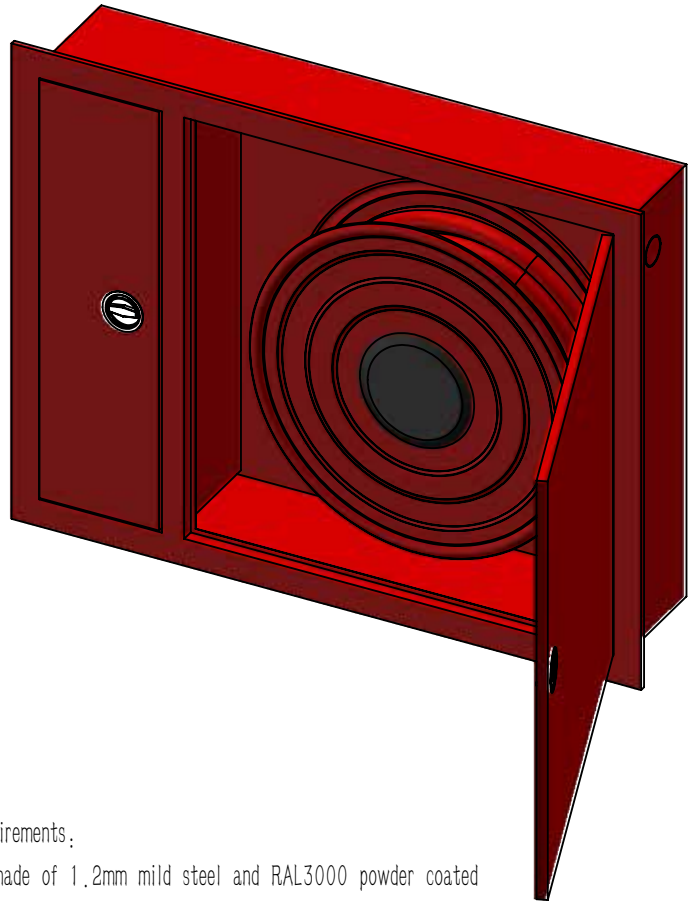

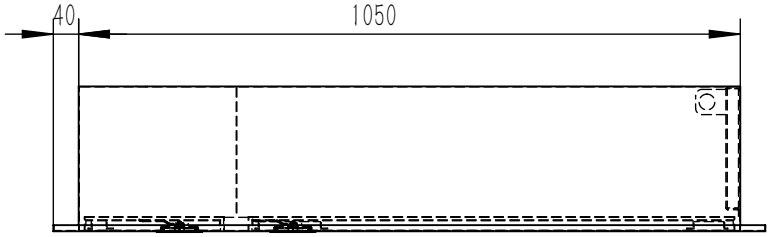

Technical requirements:

1. Cabinets made of 1.2mm mild steel and RAL3000 powder coated
2. Cabinet must be pickled and descale before painting.
3. Cabinet with four installation holes on the back board
4. Cabinet supplied with round S.S round lock and welded hinge

- FGR-2001R


NO.	Original Size	Modified	Revisor	Auditor	Date
△					
△					
△					
△					
△					
△					

Name	Recessed Mounted Fire Cabinet			Approve
Material	SPCC 1.2mm	Surface Colour	RAL3000	Design
Drawing No.	-----	Unit	mm	Draw
		Proportion	1:12	
Falcon Gold				Revision A

- FIRE CABINET WITH FALCON GOLD HOSE REEL

- CABINET MANUFACTURED FROM MILD STEEL THICKNESS 1.2MM RAL3000 POWDER COATING
- CABINET DIMENSION W 1050MM X H 800MM X D 230 MM
- CABINET FULLY POWDER COATED AND OVEN BAKED FOR APPEARANCE AND PROTECTION FROM RUST.
- SURFACE MOUNTED &RECESSED TYPE,RIGHT HAND OPENED, WITH WELDED HINGE FOR ENOUGH STRENGTH
- CABINET SUPPLIED WITH S.S ROUND LOCK FOR EASY AND FAST OPERATION.
- FULLY APPROVED TO LPCB EN671-1 STANDARD;
- HOSE REEL DRUMS PRESSED ON HYDRAULIC PRESS TO FORM RIBS FOR STRENGTH AND DURABILITY.
- HOSE REEL DISK EDGES ROLLED OVER FOR SAFE HANDLING AND AESTHETIC APPEARANCE.



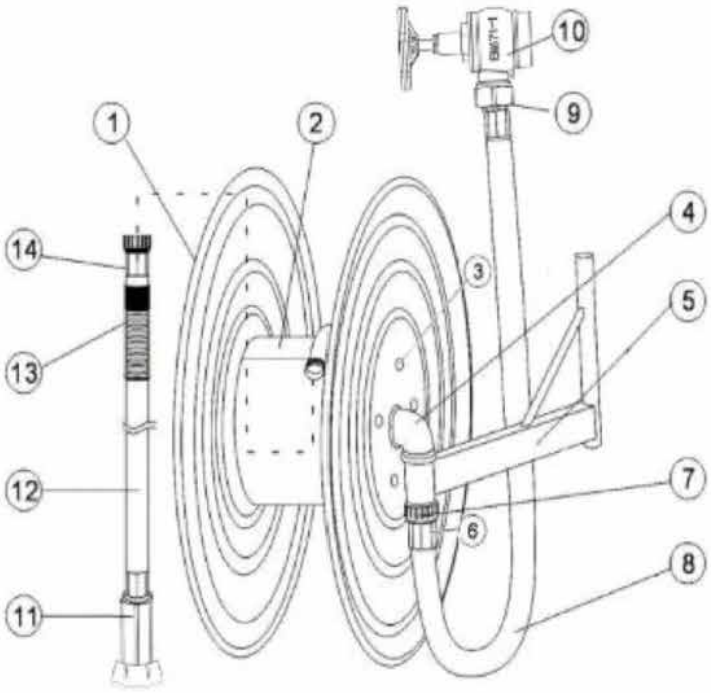

- SWINGING MANUAL HOSE REEL ASSY

• PARTS NAME

① HOSE REEL DISC ②HUB ③ LONG SCREW ROD ④ MANUAL WATERWAY ⑤ SWINGING ARM
⑥ CRIMPING SLEEVE ⑦ INLET JOINT ⑧ INLET HOSE ⑨ CONNECTOR ⑩ANGLE VALVE 1.5"-1" A-4 MODEL
⑪ NOZZLE N-04-2 ⑫ FIRE HOSE 25*30MTR ⑬ PROTECTIVE SPRING ⑭OUTLET JOINT

• FEATURES

- FULL BRASS WATERWAY WHICH WILL NEVER ROT.WE USE NIPPLES NOT HOSE CLAMPS, TO FILL IN THE INTERFACE BETWEEN HOSE AND WATERWAY. ONCE BEING SCREWED TIGHTLY,NO LEAKAGE.
- HOSE REEL WITH POWDER COATED AND ANTI-ULTRAVIOLET SIDE DISCS. THERE CAN BE PRESSURE GAUGE AT THE REEL AXIS.
- HIGH PRESSURE RESSISTANCE;WORKING AT 30 KG PRESSURE BUT NOT AFFECTED.
- ENDURANCE TEST ON REEL ROTATION; AFTER OVER 3000 ROTATION ,HOSE REELS SHOW NO VISIBLE LEAKAGE;OUR SWINGING HOSE REELS SHALL BE ABLE TO SWING 1000 TIMES TO MINIMUM 170° AND ALSO SHOW NO VISIBLE LEAKAGE OR DAMAGE.
- HIGH PRESSURE SPRAY.THE NOZZLE CAN BE ADJUSTED TO JET/SPRAY;
- OUR HOSE REELS CAN BE ALSO USED FOR CLEANING WHEN USED FOR FIRE FIGHTING.
- FIRE HOSE WITH ANTI-AGING AND ANTI-ULTRAVIOLET FUNCTION.MAXIMUM WP. IS 12BAR. EVERAGE BP.CAN BE UP TO 45BAR.

• PRODUCT SPECIFICATION & INSTALLATION MEASUREMENT

MODEL	HOSE SPECIFICATION (MM)	DIAMETER (MM)	BRACKET LENGTH (MM)	REEL WIDTH (MM)	HOSE PRESSUR(BAR)
FG-2001R	25MM×30MTR	600	290	150	12 BAR
FGR-2001R	25MM×30MTR	600	290	150	12 BAR

• USAGE

1 OPEN THE VALVE
2 PULL HOSE TOWARDS FIRE
3 OPEN NOZZLE TO SPRAY/JET AND AIM AT BASE OF FIRE.
4 AFTER USE,CLOSE THE VALVE
5 DRAIN WATER FROM HOSE
6 REWIND THE HOSE AND CLOSE NOZZLE⑪ .

-FG-2001S

- DOUBLE DOOR,
- SURFACE MOUNTED,
- STAINLESS STEEL
- FIRE HOSE REEL CABINET












-FGR-2001S

- DOUBLE DOOR,
- RECESSED
- STAINLESS
- FIRE HOSE REEL CABINET

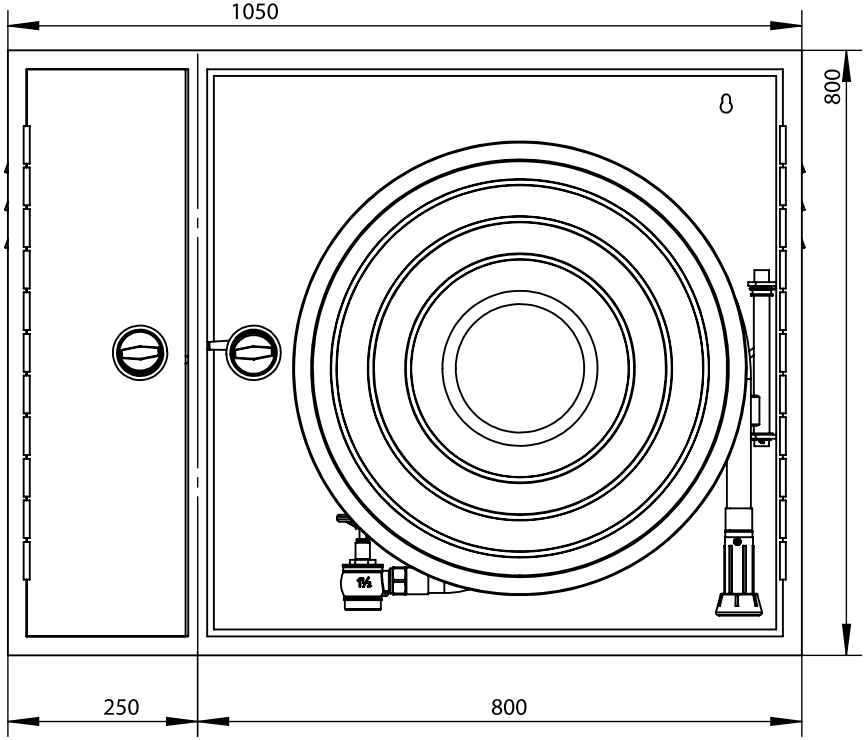


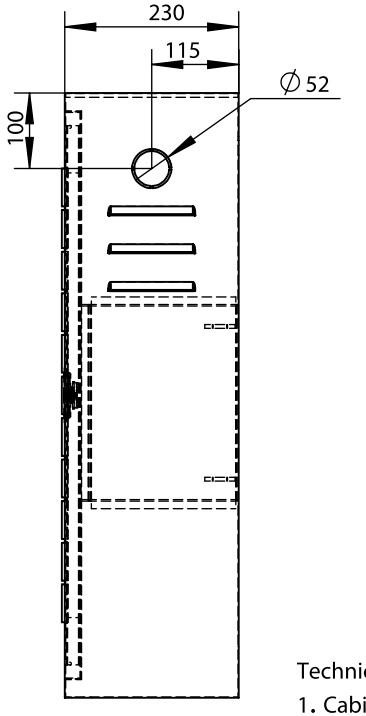

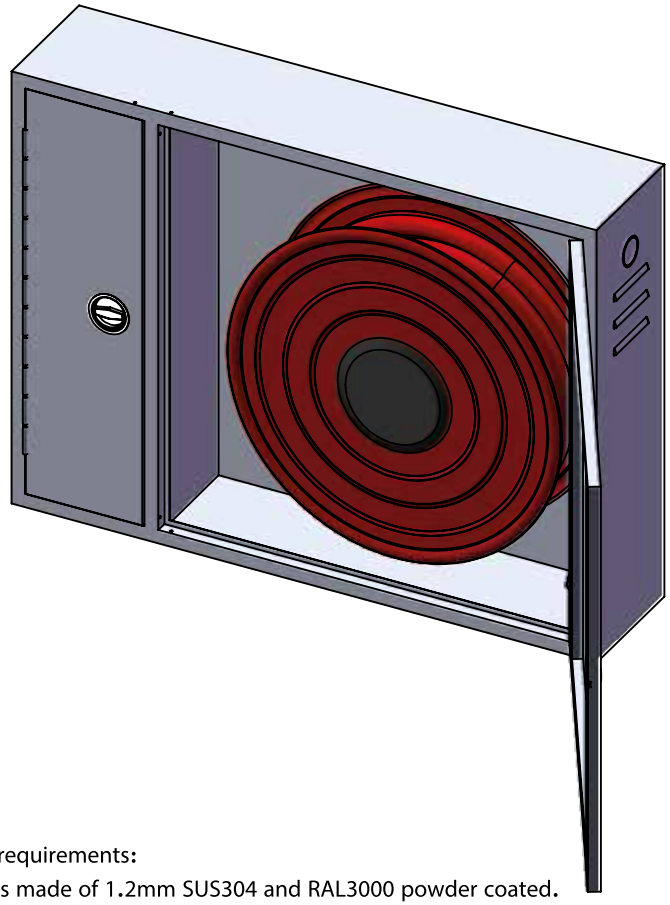


Technical requirements:


1. Cabinets made of 1.2mm SUS304 and RAL3000 powder coated.
2. Cabinet must be pickled and descale before painting.
3. Cabinet with four installation holes on the back board and two holes at the bottom- φ 10 drainage holes at bottom
4. Cabinet supplied with round S.S round lock and S.S piano hinge

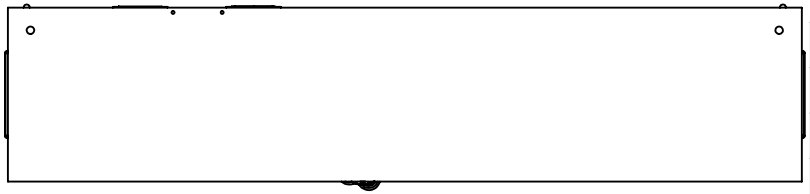



-FG-2001S

NO.	Original Size	Modified	Revisor	Auditor	Date						
						Name	Surface mounted fire cabinet ,1050x800x230			Approved	
						Material	SUS304 1.2mm	Surface Treatment	brush finish	Design	
						Drawing Number	----------	Unit	mm	Draw	
								Proportion	1:10		
						Falcon Gold				Revision	A

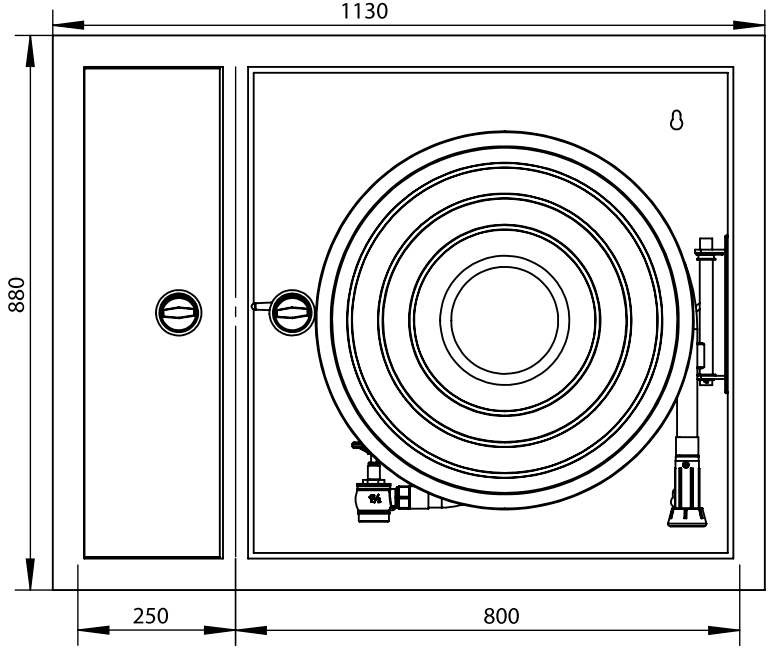

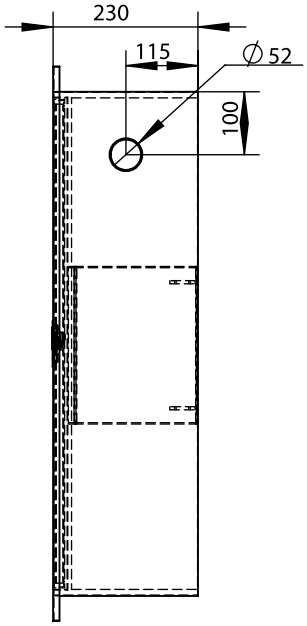

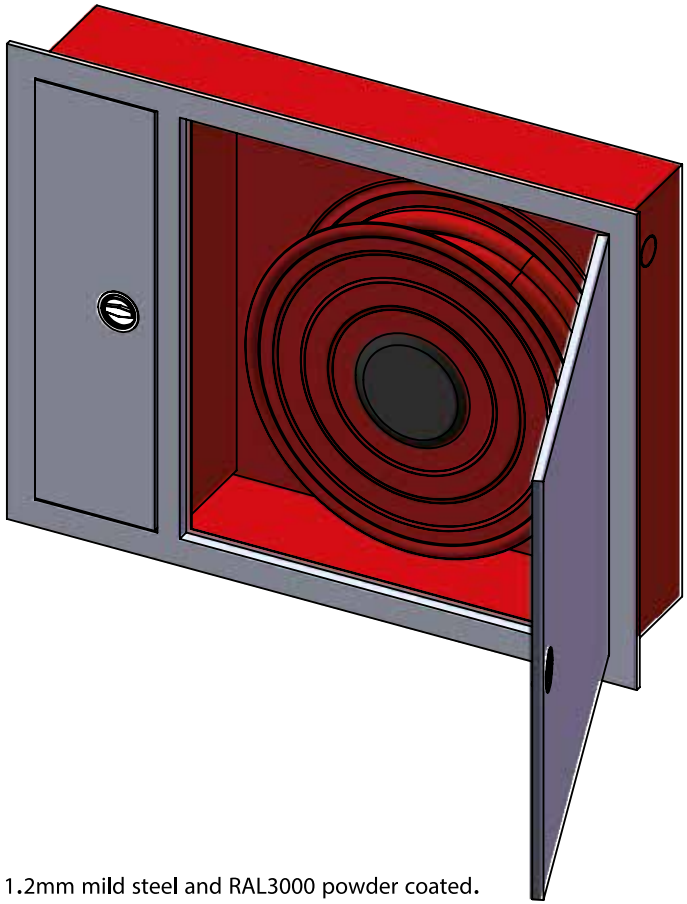

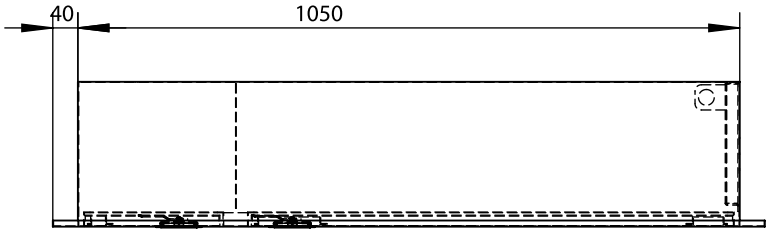

Technical requirements:

1. Cabinets body made of 1.2mm mild steel and RAL3000 powder coated.
2. Cabinet architrave and door 304 stainless steel 1.2mm, brush finish.
3. Cabinet must be pickled and descale before painting.
4. Cabinet with four installation holes on the back board
5. Cabinet supplied with round S.S round lock and S.S piano hinge.


-FGR-2001S

NO.	Original Size	Modified	Revisor	Auditor	Date						
						Name	Recessed Mounted Fire Cabinet			Approve	
						Material	SUS301 1.2MM+ SPCC 1.2mm	Surface Colour	RAL3000	Design	
						Drawing No.	-----	Unit	mm	Draw	
								Proportion	1:10		
						Falcon Gold				Revision	A

- FIRE CABINET WITH FALCON GOLD HOSE REEL

- SURFACE MOUNTED CABINET MANUFACTURED FROM-FULLY STAINLESS 304 THICKNESS 1.2MM.
- CABINET DIMENSION W 1050MM X H 800MM X D 230 MM
- RECESED CABINET ONLY DOOR STAINLESS STEEL OTHER POWDER COATED AND OVEN BAKED FOR APPEARANCE AND PROTECTION FROM RUST.
- SURFACE MOUNTED &RECESSED TYPE,RIGHT HAND OPENED, WITH STAINLESS STEEL PIANO HINGE FOR ENOUGH STRENGTH
- CABINET SUPPLIED WITH S.S ROUND LOCK FOR EASY AND FAST OPERATION.
- FULLY APPROVED TO LPCB EN671-1 STANDARD;
- HOSE REEL DRUMS PRESSED ON HYDRAULIC PRESS TO FORM RIBS FOR STRENGTH AND DURABILITY.
- HOSE REEL DISK EDGES ROLLED OVER FOR SAFE HANDLING AND AESTHETIC APPEARANCE.



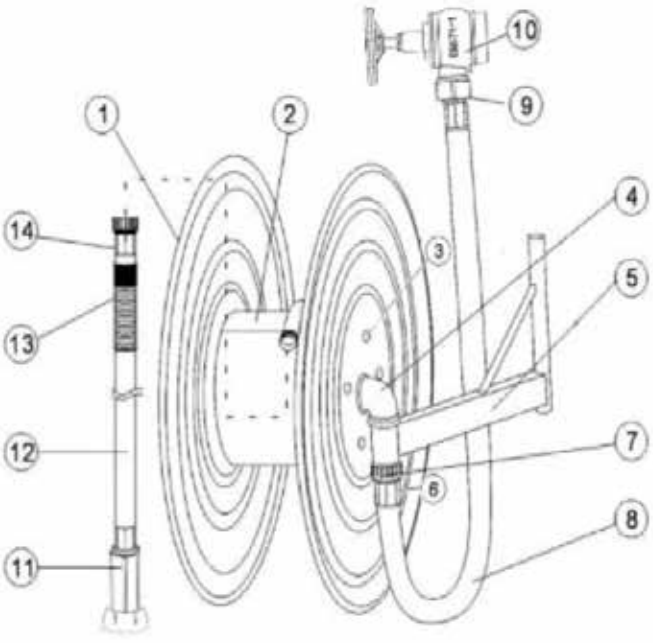

- SWINGING MANUAL HOSE REEL ASSY

• PARTS NAME

① HOSE REEL DISC ②HUB ③ LONG SCREW ROD ④ MANUAL WATERWAY ⑤ SWINGING ARM
⑥ CRIMPING SLEEVE ⑦ INLET JOINT ⑧ INLET HOSE ⑨ CONNECTOR ⑩ANGLE VALVE 1.5"-1" A-4 MODEL
⑪ NOZZLE N-04-2 ⑫ FIRE HOSE 25*30MTR ⑬ PROTECTIVE SPRING ⑭OUTLET JOINT

• FEATURES

- FULL BRASS WATERWAY WHICH WILL NEVER ROT.WE USE NIPPLES NOT HOSE CLAMPS, TO FILL IN THE INTERFACE BETWEEN HOSE AND WATERWAY. ONCE BEING SCREWED TIGHTLY,NO LEAKAGE.
- HOSE REEL WITH POWDER COATED AND ANTI-ULTRAVIOLET SIDE DISCS. THERE CAN BE PRESSURE GAUGE AT THE REEL AXIS.
- HIGH PRESSURE RESSISTANCE;WORKING AT 30 KG PRESSURE BUT NOT AFFECTED.
- ENDURANCE TEST ON REEL ROTATION; AFTER OVER 3000 ROTATION ,HOSE REELS SHOW NO VISIBLE LEAKAGE;OUR SWINGING HOSE REELS SHALL BE ABLE TO SWING 1000 TIMES TO MINIMUM 170° AND ALSO SHOW NO VISIBLE LEAKAGE OR DAMAGE.
- HIGH PRESSURE SPRAY.THE NOZZLE CAN BE ADJUSTED TO JET/SPRAY;
- OUR HOSE REELS CAN BE ALSO USED FOR CLEANING WHEN USED FOR FIRE FIGHTING.
- FIRE HOSE WITH ANTI-AGING AND ANTI-ULTRAVIOLET FUNCTION.MAXIMUM WP. IS 12BAR. EVERAGE BP.CAN BE UP TO 45BAR.

• PRODUCT SPECIFICATION & INSTALLATION MEASUREMENT

MODEL	HOSE SPECIFICATION (MM)	DIAMETER (MM)	BRACKET LENGTH (MM)	REEL WIDTH (MM)	HOSE PRESSUR(BAR)
FG-2001S	25MM×30MTR	600	290	150	12 BAR
FGR-2001S	25MM×30MTR	600	290	150	12 BAR

• USAGE

1 OPEN THE VALVE
2 PULL HOSE TOWARDS FIRE
3 OPEN NOZZLE TO SPRAY/JET AND AIM AT BASE OF FIRE.
4 AFTER USE,CLOSE THE VALVE
5 DRAIN WATER FROM HOSE
6 REWIND THE HOSE AND CLOSE NOZZLE⑪ .

Falcon Gold

YOU ARE SAFE WITH US

Let's Connect us

+971524312926
+971526299153
+97143340813

INFO@FALCON-GOLD.COM

WWW.FALCON-GOLD.COM

-FG4001RF

- FOAM FIRE CABINE
- FIRE FOAM CABINET COMPONENTS
- FIRE HOSE REEL
- RACK AND REEL FIRE HOSE




Foam fire cabinet (Foam system + fire hose reel)

Foam fire cabinet incorporates both foam extinguishing system and water extinguishing system. It is an efficient firefighting equipment for single man operation to attack class A and B fire.



- Capacity: Low expansion foam system + fire hose reel
- Mounting: Wall surface
- Surface: Red powder coating / SS





Main parts and material

Box / door	Cold rolled steel or SS, mm thickness	**Door type**	Single door, from left to right open 180°, bullet hinge or continuous piano hinge
Door glazing	Non (full solid), or acrylic viewing panel (Inside slotted or embedded into the door)	**Lock**	Rotary pull lock, or keyed cylinder lock, or keyed lock pull handle

Available size

Cabinet content	Type	Mounting	Dimension W x H x D (mm)
Inline inductor with pick up tube, 1-1/2"	1-1/2" foam system + 1-1/2" fire hose reel	Surface	700 x 1120 x 300
Foam branchpipe with control valve, 1-1/2"			
Foam concentrate container 2 x 20L			
fire hose reel, 1-1/2" x 30m, BS336 / Storz / NH			
Water inlet pipeline and brass valve, size 2"			

Note:

1. For foam system, it is available with foam concentrate AFFF 3%.
2. Different types of foam concentrates are available on request.

- FALCON GOLD FOAM CABINET

**Falcon Gold provides a wide range of effective FOAM/WATER CABINETS.
These cabinets are designed in such a way that one person can operate one unit both safely and effectively.
These cabinets have high performance for extinguishing class A and B fire classes.
Gas stations, petrochemical plants, industrial premises, and warehouses are just a few places where these cabinets can be installed.**

- ALL FIRE HOSE CABINETS AS WELL AS SHEET-MADE PARTS ARE:


**Constructed from 1.2 mm Cold Rolled Steel (CRS), with all round folded edges. Even Hose Reel edges are curled to assure safe handling.
Falcon Gold Fire Hose Cabinets are fabricated with Metal Inert Gas Welding Process, then pretreated with zinc phosphate to improve rust resistance. Afterwards, they are electrostatically painted with red polyester resin paint before being baked in the oven to give a hard-wearing resistance and gloss finish. Fire Hose cabinets are painted red with a polyester resin-texture finish. Hose reels have been hydrostatically tested to 20 bar pressure for leaks. High-level quality control standards are implemented to get quality products. Falcon Gold is not only manufacturing your designs but also makes your dreams come true.**

Rack and reel fire hose

Rack and reel fire hose is intended for interior fire protection purpose of occupant use, lightweight and compact. It is a part of fire hose rack assembly for hose station, folded on a pin rack or coiled on a reel, ready for use.



- Certificate: UL Listed / FM Approved
- Standard: UL 219, NFPA 1961 / 1962
- Feature: Occupant use, lightweight
- Color: White, standard
- Avail. coating: Impregnated yellow, red, etc.
- Temperature: -40°C to 70°C



Main parts and material


Lining	TPU (Thermoplastic polyurethane)	**Single jacket**	100% virgin filament polyester for warp and filler threads
Coupling	Brass / aluminum, rocker lug swivel, NH	**Packing**	Folded, or rolled

Available size

Size	Type	Lining	Length (feet)	Service pressure (psi)	Proof pressure (psi)	Burst pressure (psi)	Remarks
1-1/2"	Single jacket	TPU	50 / 75 / 100	250	500	750	UL

Note: The couplings are pre-assembled on both ends of fire hose through expansion rings.

- Fire Foam Cabinet Components

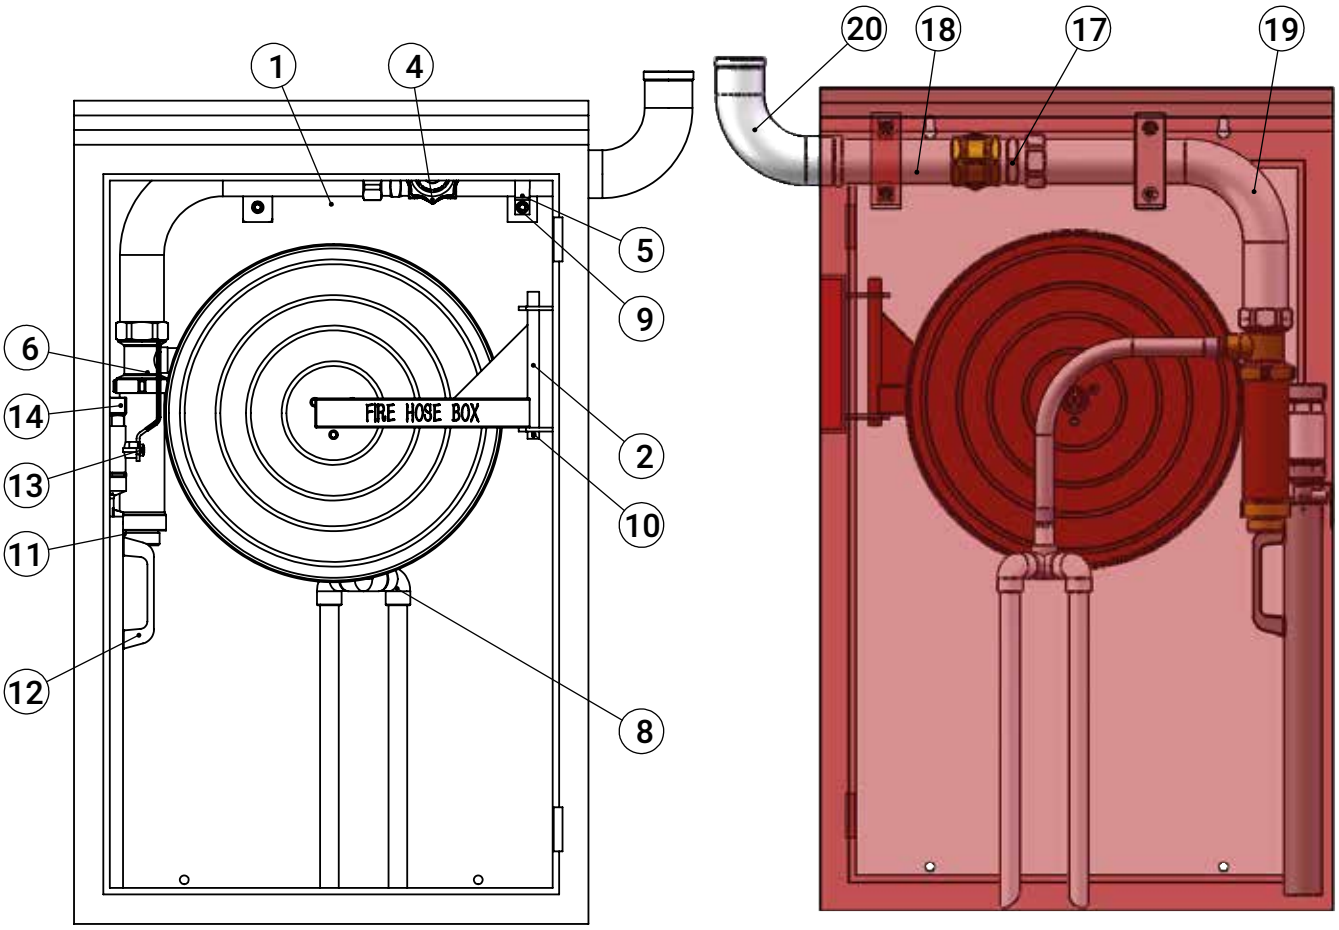

No.	Name
1	Fire Cabinet,700x1120x300
2	Fire Hose Reel 1.5 in,UL
3	Gasket,60x45x3
4	Gate Valve,G2xG2x64.5
5	Clamp,60x35x20
6	Foam Inductor
7	Flexible Suction Hose Subassembly,G1-1/2"xPF3/4x300
8	Foam Suction Tube Subassembly,G3/4"xDN25x500
9	Hex Bolt,M10x20
10	Split Pin,41x4
11	Connector,NH1.5xG2x42

No.	Name
12	Foam Nozzle
13	Ball Valve, G1.5"
14	Connector,NH1.5xG1.5x42
15	Washer,52x43x2
16	External thread street
17	Male Tube,G2"xG2"x175
18	Elbow pipe, G2
19	Washer, 55x45x3
20	90°Elbow pipe,G2"x2"BSP

CERTIFICATE OF COMPLIANCE

Certificate Number	EX26577
Report Reference	EX26577-2015-08-28
Date	2021-November-02
Issued to:	Safeguard Fire Protections Private Limited B-3 Mangolpuri Industrial Area Phase 2 Delhi, 110034 IN
This is to certify that representative samples of	FOAM LIQUID CONCENTRATES See Addendum Page for Product Designation(s).
	Have been investigated by UL in accordance with the Standard(s) indicated on this Certificate.
Standard(s) for Safety:	UL 162 - Standard for Safety for Foam Equipment and Liquid Concentrates
Additional Information:	See the UL Online Certifications Directory at https://iq.ulprospector.com for additional information

This Certificate of Compliance does not provide authorization to apply the UL Mark. Only the UL Follow-Up Services Procedure provides authorization to apply the UL Mark.

Only those products bearing the UL Mark should be considered as being UL Certified and covered under UL's Follow-Up Services.

Look for the UL Certification Mark on the product.

Bruce Mahrenholz, Director North American Certification Program

UL LLC

Any information and documentation involving UL Mark services are provided on behalf of UL LLC (UL) or any authorized licensee of UL. For questions, please contact a local UL Customer Service Representative at http://ul.com/aboutul/locations/

CERTIFICATE OF COMPLIANCE

Certificate Number	EX26577
Report Reference	EX26577-2015-08-28
Date	2021-November-02

This is to certify that representative samples of the product as specified on this certificate were tested according to the current UL requirements

Foam liquid concentrates - SAFEGUARD AR-AFFF 3%/3% , SAFEGUARD AFFF 1%, SAFEGUARD AFFF 3%, SAFEGUARD AFFF 6%, SAFEGUARD BIOSOLVC6 AFFF 3%, SAFEGUARD BIOSOLVC6 AFFF 6%, SAFEGUARD BIOSOLVC6 AR-AFFF 3%/3%, SAFEGUARD BIOSOLVC6 AR-AFFF 3%/6%, SAFEGUARD BIOSOLVC6 FP 3%, SAFEGUARD BIOSOLVC6 FFFP 3%

Bruce Mahrenholz, Director North American Certification Program

UL LLC

Any information and documentation involving UL Mark services are provided on behalf of UL LLC (UL) or any authorized licensee of UL. For questions, please contact a local UL Customer Service Representative at http://ul.com/aboutul/locations/

CERTIFICATE OF COMPLIANCE

Certificate Number	20120723-EX15900
Report Reference	EX15900-20120525
Issue Date	2012-JULY-23
Issued to:	[redacted]
This is to certify that representative samples of	FIRE HOSE FOR INTERIOR STANDPIPE, LINED, UNCOUPLED Model 17-40, 1-1/2" Single jacketed fire hose for interior standpipes with TPU lining, hot melting adhesive and polyester jackets.
	Have been investigated by UL in accordance with the Standard(s) indicated on this Certificate.
Standard(s) for Safety:	U.S. Standard for Safety for Lined Fire Hose for Interior Standpipes, UL 219
Additional Information:	See the UL Online Certifications Directory at www.ul.com/database for additional information

Only those products bearing the UL Listing Mark should be considered as being covered by UL's Listing and Follow-Up Service.

The UL Listing Mark generally includes the following elements: the symbol UL in a circle: Ⓤ with the word "LISTED"; a control number (may be alphanumeric) assigned by UL; and the product category name (product identifier) as indicated in the appropriate UL Directory.

Look for the UL Listing Mark on the product.

William R. Carney

William R. Carney, Director, North American Certification Programs

UL LLC

Any information and documentation involving UL Mark services are provided on behalf of UL LLC (UL) or any authorized licensee of UL. For questions, please contact a local UL Customer Service Representative at www.ul.com/contactus

CERTIFICATE OF COMPLIANCE

Certificate Number	20120723-EX15900
Report Reference	EX15900-20120525
Issue Date	2012-JULY-23
Issued to:	[redacted]
This is to certify that representative samples of	FIRE HOSE FOR INTERIOR STANDPIPES, LINED Model 17-40, 1-1/2" Single jacketed fire hose for interior standpipes with TPU lining, hot melting adhesive and polyester jackets. Have been investigated by UL in accordance with the Standard(s) indicated on this Certificate.
Standard(s) for Safety:	Canadian Standard for Lined Fire Hose for Interior Standpipes and Municipal and Industrial Fire Protection Services, CAN/ULC-S511-07
Additional Information:	See the ULC Online Certification Directory at www.ulc.ca for additional information

Only those products bearing the ULC Listing Mark should be considered as being covered by ULC's Listing and Follow-Up Service.

The ULC Listing Mark generally includes the following elements: the symbol ULC in a circle: (ULC) with the word "LISTED"; a control number (may be alphanumeric) assigned by ULC; and the product category name (product identifier) as indicated in the appropriate ULC Directory.

To confirm the status, validate the above information via the online directory.

Look for the ULC Listing Mark on the product.

Martin Oughton, President & General Manager

UNDERWRITERS LABORATORIES OF CANADA INC.

Any information and documentation involving ULC Mark services are provided on behalf of Underwriters Laboratories of Canada Inc. (ULC) or any authorized licensee of ULC. For questions, please contact a local ULC Customer Service Representative at www.ul.com/contactus

Falcon Gold

YOU ARE SAFE WITH US

Let's Connect us

+971524312926
+971526299153
+97143340813

INFO@FALCON-GOLD.COM

WWW.FALCON-GOLD.COM

أزيدك للمقاولات العامة
وأعمال الإلكتروميكانيكال
Azeidk for General Contracting & MEP Solutions

LPCB Approval.

Falcon Gold

YOU ARE SAFE WITH US

C.R.4030244617
012 6880407/0581444606
info@azeidk.com
www.azeidk.com

المقر الرئيسي - جدة:
برج الصفا، مقابل عزيز مول، أعلى شركة عبداللطيف جميل، مبنى A، الدور الثالث، مكتب رقم ٣٤٠.
الرياض:
حي الملز، شارع صلاح الدين، بجوار شركة زين، الدور الثاني، مكتب رقم ١٦.

LPCB®

www.redbooklive.com

Certificate of Product Approval

Certificate Number: 1038BIa Issue: 01

Falcon Gold General Trading L.L.C

First Floor Office #128
Al Wasl Building
Shiekh Zayed Road
Al Wasl
Dubai
United Arab Emirates

is certified by BRE Global Ltd. and is authorised to use the LPCB mark in association with the product(s) listed in this certificate and appendix having complied with the requirement(s) of the standards as detailed below:

Products

'Falcon Gold' Fire Hose Reels
(Refer to attached appendix for details)

Standards

EN 671-1:2012
Fixed firefighting systems. Hose systems. Hose reels with semi-rigid hose

This certificate and appendix is maintained and held in force through regular surveillance activities

Signed for BRE Global Ltd.	Joe Milton Verifier	8 April 2024 Date of Issue	8 April 2024 Date of First Issue

This certificate and appendix remains the property of BRE Global Ltd. and is issued subject to terms and conditions (for details visit www.redbooklive.com/terms).

To check the validity of this certificate and appendix please visit www.redbooklive.com/check, scan the QR tag or contact us.

BRE Global Ltd, Watford, WD25 9XX
T: +44 (0)333 321 8811 E: enquiries@breglobal.com

LPCB is a Registered Trademark of the Building Research Establishment Ltd.

 © BRE Global Ltd, 2024

80018

LPCB®

Appendix to Certificate No: 1038BIa

Issue: 01

Falcon Gold General Trading L.L.C

'Falcon Gold' Fire Hose Reels to EN 671-1:2012

Product Name	Description	Hose Nominal Bore (mm)	Hose Maximum Length (m)	Nozzle type	LPCB Ref. No.
FG-651HR	Manual, swinging arm, cabinet or wall mounted	25	30	Lever operated jet only or rotary operated jet/spray	1038BIa/02

Notes for 'Falcon Gold' Fire Hose Reels to EN 671-1:2012:

The 'Falcon Gold' fire hose reel above is approved for use in conjunction with the following cabinets:

Product Name	Description
FG-1001R	Single door, surface mounted, mild steel, fire hose reel cabinet
FG-1001S	Single door, surface mounted, stainless steel, fire hose reel cabinet
FGR-1001R	Single door, recessed, mild steel, fire hose reel cabinet
FGR-1001S	Single door, recessed, stainless steel, fire hose reel cabinet
FG-2001R	Double door horizontal, surface mounted, mild steel, fire hose reel cabinet
FG-2001S	Double door horizontal, surface mounted, stainless steel, fire hose reel cabinet
FGR-2001R	Double door horizontal, recessed, mild steel, fire hose reel cabinet
FGR-2001S	Double door horizontal, recessed, stainless steel, fire hose reel cabinet
FGV-3001R	Double door vertical, surface mounted, mild steel, fire hose reel cabinet
FGV-3001S	Double door vertical, surface mounted, stainless steel, fire hose reel cabinet
FGRV-3001R	Double door vertical, recessed, mild steel, fire hose reel cabinet
FGRV-3001S	Double door vertical, recessed, stainless steel, fire hose reel cabinet

This certificate and appendix is maintained and held in force through regular surveillance activities

Signed for BRE Global Ltd.	Joe Milton Verifier	8 April 2024 Date of Issue	8 April 2024 Date of First Issue

This certificate and appendix remains the property of BRE Global Ltd. and is issued subject to terms and conditions (for details visit www.redbooklive.com/terms).

To check the validity of this certificate and appendix please visit www.redbooklive.com/check, scan the QR tag or contact us.

BRE Global Ltd, Watford, WD25 9XX
T: +44 (0)333 321 8811 E: enquiries@breglobal.com

LPCB is a Registered Trademark of the Building Research Establishment Ltd.

© BRE Global Ltd, 2024

80018

شركة أزيدك
لأجهـزة السلامـة

Shipment Conformit
Certificate.

الإدارة: جدة - حي الصفا - شارع الأمير ماجد - الصفا بلازا - مبنى A الدور الثالث مكتب 340 - س.ت: 403026741 - هاتف -6342166 -0126880407 -
فاكس تحويلة: 111-: 0581444606
المعرض1: جدة - شارع البلدية - مركز الفانوس | المعرض 2: مكة - شارع الحج
الفروع: الرياض - ينبع - المدينة - الطائف - خميس مشيط - الدمام
info@azeidk.com www.Azeidk.com

	Shipment Country	China

Product and Manufacturer Data

	Trademark	Falcon Gold

FIRE FIGHTING



ire Fighting Equipments and Materials

DUSTRY CO LTD

DUSTRY CO LTD	Exporter Address	CHINA

CB Or

شهادة مطابقة للمنتجات الخاضعة للوائح

QIMA
YOUR EYES IN THE SUPPLY CHAIN

Certificate of conformity for regulated products

We (.....QIMA Limited.....) office number (.....05956.....) are bearing full responsability for the product described below is conforms to the conformity assessment procedure Conduct the relevant technical regulations and standards which mentioned during this certificate.

Certificate Number	19117-059-23-1130046	Issue Date	04/09/2023	Expire Date	04/09/2024
Certificate Type	Certificate of conformity for regulated products	Commercial Registration No	4030267410 / 7012025560		
Establishment Address	5065 2 8073-22335 جدة				

Product and Manufacturer Data			
Model Name	FG001	Trade Mark	Falcon Gold
Product Name	Fire Hose Cabinet		

Product Description	FIRE HOSE CABINET FOR FIRE FIGHTING	 

دليل الخدمة

Country of origin	China



دليل الخدمة
الخدمات

HS Code	590900100000
Technical Regulation	Technical Regulation for Fire Fighting Equipments and Materials
Manufacturer name	SUZHOU HLC PLASTICS INDUSTRY CO LTD

Product test data

Report number	R-Cloud-23175800
Report Date	30/08/2023
Decision of confomity assessment	Product Approved

CB Organization Office Responsabile Manager signature	22/10/2023 10:59	CB Organization Office Stamp
		

دليل الخدمة

الخدمات

تفاصيل أرقام الموديلات

تفاصيل

عودة (/ContactOfficer/MyRequests/HRRequests)

أزيدك للمقاولات العامة
وأعمال الإلكتروميكانيكال
Azeidk for General Contracting & MEP Solutions

Previous Approvals.

Falcon Gold

YOU ARE SAFE WITH US

C.R.4030244617
012 6880407/0581444606
info@azeidk.com
www.azeidk.com

المقر الرئيسي - جدة:
برج الصفا، مقابل عزيز مول، أعلى شركة عبداللطيف جميل، مبنى A، الدور الثالث، مكتب رقم ٣٤٠.
الرياض:
حي الملز، شارع صلاح الدين، بجوار شركة زين، الدور الثاني، مكتب رقم ١٦.

RSG | SAUDCONSULT | PARSONS | كدانة KIDANA

المشروع:	تعزيز إنشاء مجمعات دورات المياه ذات الطابقين بمشعر منى	التاريخ:	19/2/2025
المقاول:	مجموعة الراجحي السعودية		

☑ طلب اعتماد جديد		الرقم المرجعي :	النوع: ☐ مدني ☐ ميكانيكا ☑ معماري ☐ كهرباء
☐ اعادة طلب الاعتماد		MINA-TOL-RSG-SC-MSAR-MECH-074-R0	

☑ اعتماد مواد ☐ اعتماد مورد ☐ اعتماد طريقة العمل ☐ أخرى

الى - الاستشاري / شركة الخدمات الاستشارية السعودية للاستشارات الهندسية (سعود كونسلت)

الموضوع: طلب اعتماد مواد من شركة سما للسلامة

وصف الاعتماد:
أعمال الحريق حسب البند رقم 21200

اسم ورقم البند:
أعمال مكافحة الحريق /21200

س.ت : [illegible]
مشروع مجمعات
دورات المياه ذات الطابقين
الادارة الهندسية

المرفقات	
عينة	
كتالوج	✓
ضمان المنتج	✓
تقرير المنتج	✓
مواصفات المنتج	✓
طريقة العمل	✓

المرفق: مشعر منى
مرجع المواصفات :
اعتماد المواد المرفقة :

ملاحظات: مرفق عينة ☐ مرفق نسخة رقمية ☑

المورد / الشركة المصنعة: طلب اعتماد مواد شركة سما للسلامة

RSG [illegible]
مشروع دورات المياه ذات الطابقين
الاستلام :
التاريخ : ٢٠٢٥-٢-٢٤

مجموعة الراجحي السعودية مقدم بواسطة	الاسم:	أحمد محمد البيلي	الختم	
	التوقيع:			
الاستشاري استلمت من قبل	الاسم:		الختم	
	التوقيع:			

اعتماد الاستشاري

ملاحظات الاستشاري: لا مانع من الاعتماد المواد الآتية بالشروط الآتية

1. اعتماد صندوق الطفاية سودي FG-9005
2. اعتماد صندوق الكبيد سودي FG-1005 في حالة طرح الكابل
3. اعتماد الصندوق سودي FGR-1005 في حالة داخل قاعة
4. تقديم مخططات الدفاع المدني
5. تحديد الشروط والمواصفات الفنية
6. التوريد مع موزع معتمد لدينا
7. توضيح مقارات الضغط اللازمة

ظالم الشهري ميكانيكا ٢٠٢٥/٢/٢٤

A). اعتماد

B). اعتماد مع ملاحظات

C). مراجعة واعادة الإرسال

D). مرفوض

مكتوب لموزع ☐ مكتوب معلومات اضافية ☐
مكتوب للشارات ☐ مكتوب ضمان من الشركة المصنعة ☐

ختم الاستشاري	القسم المختص			
	الاسم	الوظيفة	التوقيع	التاريخ
	قسم الجودة			
	الاسم	الوظيفة	التوقيع	التاريخ
	مدير المشروع			
	الاسم		التوقيع	التاريخ

Scanned with CamScanner

Material Submittal

Maher Belal Engineering Consultancy
ماهر بلال للإستشارات الهندسية

شركة أزيدك للأجهزة السلامة

OWNER	: Nassar Al Refaee		
CONSULTANT	: Maher Belal Engineering Consultancy	**Document No.** :	**MS-Mech-F.F-06**
CONTRACTOR	: **Azeidk Co. for Safety**	**Date** :	**12/08/2024**
PROJECT	: ثلاجات شركة إن ارتي سي المحدودة - الخمرة	**Project No.** :	
LOCATION	: جدة		

Project		Submittal No.	MS-Mech-F.F-06	Ref. Spec's	
Ref. Dwg.		Date	12/08/2024		

Description:

Foam Fire Hose Cabinet - Falcon Gold - LPCB

■ Catalogue ☐ Drawing ☐ Sample ■ Certificate ☐ Others

Having Checked this submittal, we certify it conforms to the requirements
Of the contract Documents in all respects, except as otherwise indicated herein

.....
.....
.....
.....
.....
.....

Contractor: Azeidk Co. for Safety **Signature:** ..... **Date:** 12/08/2024

ACTION

- ☑ Approved
- ☑ Approved As Noted
- ☐ Approved As Noted / Resubmittal Required
- ☐ Not Approved

Remarks/Comments

Installation As per NFPA 14

Profession	Name	Signature	Review Date
Site Manager	Eng. Ahmad Alqudah		19/8/2024
Civil/Structural Engineer			
Electrical Engineer			
Mechanical Engineer			

AAW & PARTNERS

المملكة العربية السعودية
البرنامج الملكية

المحترفون المتطورة
Advance Professionals

ROJECT NAME: مشروع انشاء مطبخ مركزي نموذجي بقصر الزاهر بجدة LOCATION: قصر الزاهر – جدة	PAGE 01 OF 01

DOCUMENT TRANSMITTAL/ SUBMITTAL	المستندات المقدمة
REF. NO.: 156 رقم:	SUBMITTAL NO: MEC-MS-156R0
DATE: 03/08/2024 تاريخ :	☒ New Submittal ☐ Re- Submittal

DISCIPLINE:

CIVIL ☐ ARCHITECTURAL ☐ STRUCTURAL ☐ **MECHANICAL** ☒ PLUMBING ☐ ELECTRICAL ☐ GENERAL ☐

ENCLOSURES (مرفقات)

Drawings ☐ مخططات material submittal ☒ مواد catalogs ☒ كتالوج Request for inspection ☐ طلب استلام اعمال

Specification ☒ مواصفات sample ☐ عينة sketch ☐ سكتش supplier ☐ مورد lab ☐ معمل - مختبر

test date ☐ بيانات اختبار schedule ☐ جداول report ☐ تقارير clarification ☐ توضيحات others ☐ اخرى

DRWG. NO. مخطط رقم SPECS. NO: رقم المواصفة	رقم المراجعة REV.	بيـــــــان DESCRIPTION	عدد النسخ NO. OF COPIES
	0	FIRE HOSE CABINET – FALCON GOLD	1
		ATTACHED: TECHNICAL DATA SHEET.	
		ATTACHED: PREVIOUS APPROVALS	

ANY REVIEW/APPROVAL FROM THE ENGINEER SHALL NOT RELIEVE THE CONTRACTOR OF HIS OBLIGATION TO PERFORM THE WORK IN ACCORDANCE WITH THE CONTRACT DOCUMENTS.

ITEM NO BOQ: البند بجدول الكميات أو العقد:	LOCATION / USE مكان الاستخدام: قصر الزاهر-جده
CO-ORDINATOR: Name: AHMED SAMEH Signature & Date:	REVIEWED BY: Name: Ghadi Waznah Signature & Date:

شركة المحترفون المتطورة للتجارة والمقاولات المحدودة
مشروع: المطبخ المركزي - قصر الزاهر
إدارة المشاريع

CONSULTANT REPRESENTATIVE APPROVAL & COMMENTS: ملاحظات وتوصيات المهندس الإستشاري

- مأخوذ من اعتماد سابق مشابه من النوع الحديث
موديل FGR-1001S - استانلس ستيل Falcon Gold
واقفل الجهاز.

NAME/SIGNATURE: Alwaleed AbdalDahb DATE/STAMP: 7-8-2024

ACTION CODES:
A) Approved (موافقة) B) Approved As Noted (موافقة بملاحظات) C)Revised And Re-Submit (تعديل واعادة تقييم) D)Rejected(مرفوض)

OWNER REPRESENTATIVE APPROVAL & COMMENTS:

AAW & PARTNERS 2024 المهندسون الاستشاريون
أية أية تطوير وشركاه
مشروع التعاقد مع مكتب استشاري هندسي
(اشراف) مكون من 4 مشورات

ACTION CODES:
A) Approved (موافقة) B) Approved As Noted (موافقة بملاحظات) C)Revised And Re-Submit (تعديل واعادة تقييم) D)Rejected(مرفوض)

NAME:

إعتماد المالك	الختم

CONTRACTOR	CONSULTANT	OWNER
شركة وادي البناء Con Valley Co. LTD For General Contracting	GAP	masdar مصدر

Material Submittal

Project:	Masdar Technical Services Project	Material Request No.:	CON-MR-MECH-
Client :	Al - Muhadib Group		
Consultant:	GAP Consultants Office		
Contractor:	Convalley For General Contracting		

DATE:- 7/11/2023

To be completed by the Contractor

Site:

Type of Work:

- ☐ Structural & Civil
- ☐ Architecture
- ■ Mechanical
- ☐ Electrical
- ☐ Other

Material Description : FHC & FE

Specifications/ Drawing Ref. : Tender Drawing & B.O.Q

B.O.Q. Ref.

Enclosures : ■ Catalogues ☐ Technical Data ☐ Literature ☐ Certificates ☐ Samples ☐ Operational & Maintenance Manual ☐

Manufacturer / Supplier: AAEIDK (FALCON) **Local Agent :**

Additional relevant information :

FALCON FIRE HOSE CABINET (80*80*30 CM)RUBBER HOSE 1 "
FALCON CO2 FE 6 KG
FALCON POWDER FE6 KG

Checked By:
Signature:

Project Manager:
Signature:

To be completed by the Consultant :

Date Received : / /

Received By :

- ■ Approved
- ☐ Revise & Resubmit
- ☑ AAN
- ☐ Not Approved

Comments :

installation should be as per NFPA-14 and NFPA-10 for fire extinguishers.

Date : 07/11/2023

Checked by : ENG HAMDY
Signature :

7-11-23

Date received by the Contractor: / /
Received By :
Signature :

OWNER	CONSULTANT	CONTRACTOR
شركة البناء المعمر العقارية AL BINA'A AL MUAMMAR	هاشم عبدالحكيم	Azeidk شركة أزيدك للأجهزة السلامة

PROJECT NAME: Rusd Towers	LOCATION: JEDDAH

MATERIAL SUBMITTAL / APPROVAL SHEET

☑ NEW SUBMITTAL	☐ RE-SUBMITTAL	SUBMITTAL DATE: 20/02/2023	SUBMITTAL NO.: MS-Mech-03	REV.: 0

PURPOSE OF SUBMITTAL: ☑ FOR APPROVAL ☐ FOR COMMENTS ☐ FOR INFORMATION

DISCIPLINE: ☑ MECHANICAL ☑ Firefighting ☐ CIVIL ☐ ELECTRICAL ☐ H. V. A. C. ☐ PLUMBING ☐ OTHERS... *Specify:* Firefighting

MATERIAL NAME:	**Fire Hose Cabinets**	ORIGIN:	
BOQ. REFERENCE:		MANUFACTURER/SUPPLIER:	Falcon Gold
SPECS. REF.:		SUPPLIER:	
DRAWING REF.:		MATERIAL DELIVERY PERIOD:	Stock
LOCATION:	JEDDAH	MATERIAL REQUIRED AT SITE:	Rusd Towers
QUANTITY:		SAMPLE ATTACHMENT:	
B. S. REFERENCE:		CERTIFICATE ATTACHMENT:	

WARRANTY FROM THE MANUFACTURER / SUPPLIER:

CONTRACTORS REMARKS (if any:)

CONSULTANTS COMMENTS:

Installation must be according to NFPA requirements.

CONTRACTOR		CONSULTANT	
NAME:	**Mohamed Rabea**	NAME:	**Mohamed Akar**
POSITION:	**Mechanical Engineer**	POSITION:	**Consultant Engineer**
SIGNATURE:		SIGNATURE:	
DATE:	**20/02/2023**	DATE:	26/02/2023

APPROVAL STATUS: A MATERIAL APPROVED ☑ B APPROVED WITH COMMENTS C MATERIAL REJECTED

RECEIVED BY: (CONSULTANT)	SIGNATURE:	DATE: 26/02/2023	RECEIVED BY: (CONTRACTOR)	SIGNATURE:	DATE:

أزيدك للمقاولات العامة
وأعمال الإلكتروميكانيكال
Azeidk for General Contracting & MEP Solutions

Authorization Letter.

Falcon Gold

YOU ARE SAFE WITH US

C.R.4030244617
012 6880407/0581444606
info@azeidk.com
www.azeidk.com

المقر الرئيسي - جدة:
برج الصفا، مقابل عزيز مول، أعلى شركة عبداللطيف جميل، مبنى A، الدور الثالث، مكتب رقم ٣٤٠.
الرياض:
حي الملز، شارع صلاح الدين، بجوار شركة زين، الدور الثاني، مكتب رقم ١٦.

CERTIFICATE OF AUTHORIZED DISTRIBUTOR

Falcon Gold, the prestigious Emirati company.
proudly announces the appointment of **Azeidk Group** in KSA & EGYPT
as an authorized distributor of its products.
With this certificate, **Azeidk** is recognized as an authorized distributor for all Falcon Gold products within the Kingdom of Saudi Arabia & EGYPT.

Azeidk was selected for its excellence and expertise in the field of security & safety, and we have full confidence in its ability to
provide high-quality and reliable services to its clients in KSA & EGYPT.

This certificate is effective from the date of issuance & remains valid until MAY 2025.

We wish **Azeidk** success and progress as an authorized distributor of our products, and we look forward to building a strong
& fruitful partnership with them.

2024-5

DATE

GENERAL MANAGER

أزيـــدك

Azeidk

Falcon Gold

Falcon Gold

Exclusive Appointment of Azeidk as the Sole Agent for Falcon Gold Products in Saudi Arabia and Egypt

To: Azeidk

We at **Falcon Gold** are pleased to announce the appointment of **Azeidk** as the exclusive distributor of our products in both **Saudi Arabia** and **Egypt**.

This decision reflects our full confidence in Azeidk's ability to deliver our products and services with the highest quality and professionalism, meeting the expectations of our clients and adhering to the highest safety standards.

Through this partnership, Azeidk will take on the responsibility of distributing and promoting all **Falcon Gold** products in the Saudi and Egyptian markets, including our wide range of fire protection solutions such as **cabinets, hoses, extinguishers, valves**, and more. These products are certified to the highest international standards, including **NFPA, UL, and Kitemark**.

At **Falcon Gold**, we are confident that Azeidk, with its vast experience and outstanding team, will be the ideal partner to strengthen our presence in these key markets. Together, we will work to ensure that our clients' needs are met with the utmost quality and safety.

This exclusive distributorship is valid from the date of issuance and will remain in effect until **2030**, with the possibility of renewal based on our mutual achievements.

We wish **Azeidk** continued success and growth in this important partnership, and we look forward to a bright and prosperous future together.

Sincerely,
Falcon Gold

Falcon Gold
YOU ARE SAFE WITH US

+971524312926
+97143340813

info@falcon-gold.com
www.falcon-gold.com

Sheikh Zayed Rd-Al Wasl
Building-first floor office
Number 128 Dubai

أزيدك للمقاولات العامة
وأعمال الإلكتروميكانيكال
Azeidk for General Contracting & MEP Solutions

Azeidk Co. Documents

Falcon Gold

YOU ARE SAFE WITH US

C.R.4030244617
012 6880407/0581444606
info@azeidk.com
www.azeidk.com

المقر الرئيسي - جدة:
برج الصفا، مقابل عزيز مول، أعلى شركة عبداللطيف جميل، مبنى A، الدور الثالث، مكتب رقم ٣٤٠.
الرياض:
حي الملز، شارع صلاح الدين، بجوار شركة زين، الدور الثاني، مكتب رقم ١٦.

المملكة العربية السعودية
الهيئة العليا للأمن الصناعي

الهيئة العليا للأمن الصناعي
High Commission For Industrial Security

رؤية VISION 2030
المملكة العربية السعودية
KINGDOM OF SAUDI ARABIA

وثيقة التأهيل

رقم الوثيقة: ٢٤٥٣٦٢١١٦٢٥

تاريخ إصدار الوثيقة	٢٠٢٤/١٠/٢١م	تاريخ إنتهاء الوثيقة	٢٠٢٥/١٠/٢١م
الاسم التجاري	شركة ازيدك للمقاولات العامه		
رقم السجل التجاري	٤٠٣٠٢٤٤٦١٧	موقعها الرئيسي	جدة
النشاط المرخص	مقاولات الوقاية والحماية من الحريق		
الفئة	مقاولات الوقاية والحماية من الحريق		

تصادق وترخص الهيئة العليا للأمن الصناعي لهذه المنشأة لمزاولة النشاط المذكور في هذه الوثيقة.

*هذه الوثيقة سارية للسجل التجاري الرئيسي وجميع السجلات التجارية الفرعية للمنشأة.

الهيئة العليا للأمن الصناعي
High Commission For Industrial Security





الهيئة العليا للأمن الصناعي
High Commission For Industrial Security

رخصة مزاولة نشاط

المملكة العربية السعودية
الهيئة العليا للأمن الصناعي

رقم الرخصة : ٢٣٥١٠٠٧٧٣٣٢

الإسم التجاري	شركة ازيدك للمقاولات العامه			
رقم السجل التجاري	٤٠٣٠٢٤٤٦١٧	الرقم الموحد للمنشآت(٧)	٧٠١٤١٢٦٢٦٧	
تاريخ الإصدار	١٤٤٤-٠٦-٢٦	تاريخ الإنتهاء	١٤٤٧-٠٦-٢٦	منطقة مزاولة النشاط	جدة
النشاط المرخص	البيع بالجملة لأجهزة ومعدات ومواد الوقاية والحماية من الحريق			
الأجهزة والمعدات				

تشهد الهيئة العليا للأمن الصناعي بأن المنشأة الموضحة أعلاه قد أستوفت كافة الإجراءات والإشتراطات النظامية لمزاولة النشاط الموضح أعلاه وقد أصدرت لها هذه الرخصة كمنشأة مصرح لها لمزاولة النشاط المذكور.

الهيئة العليا للأمن الصناعي
High Commission For Industrial Security



* للتحقق من صلاحية الرخصة الرجاء الدخول على منصة الهيئة العليا للأمن الصناعي https://hcis.gov.sa
* يتطلب وجود النشاط في السجل التجاري المذكور أعلاه، على ان يكون السجل التجاري ساري المفعول





الهيئة العليا للأمن الصناعي
High Commission For Industrial Security

رخصة مزاولة نشاط

المملكة العربية السعودية
الهيئة العليا للأمن الصناعي

رقم الرخصة : ٢٣٥١٠٠٧٧٣٣٢

الإسم التجاري	شركة ازيدك للمقاولات العامه			
رقم السجل التجاري	٤٠٣٠٢٤٤٦١٧	الرقم الموحد للمنشآت(٧)	٧٠١٤١٢٦٢٦٧	
تاريخ الإصدار	١٤٤٤-٠٦-٢٦	تاريخ الإنتهاء	١٤٤٧-٠٦-٢٦	منطقة مزاولة النشاط	جدة
النشاط المرخص	البيع بالجملة لأجهزة ومعدات ومواد الوقاية والحماية من الحريق			
الأجهزة والمعدات				

تشهد الهيئة العليا للأمن الصناعي بأن المنشأة الموضحة أعلاه قد أستوفت كافة الإجراءات والإشتراطات النظامية لمزاولة النشاط الموضح أعلاه وقد أصدرت لها هذه الرخصة كمنشأة مصرح لها لمزاولة النشاط المذكور.

الهيئة العليا للأمن الصناعي
High Commission For Industrial Security



* للتحقق من صلاحية الرخصة الرجاء الدخول على منصة الهيئة العليا للأمن الصناعي https://hcis.gov.sa
* يتطلب وجود النشاط في السجل التجاري المذكور أعلاه، على ان يكون السجل التجاري ساري المفعول

المملكة العربية السعودية
الهيئة العليا للأمن الصناعي

الهيئة العليا للأمن الصناعي
High Commission For Industrial Security

رؤية VISION 2030
المملكة العربية السعودية
KINGDOM OF SAUDI ARABIA

رخصة مزاولة نشاط

رقم الرخصة : ٢٣٥١٣١٠١٦٣٢

الإسم التجاري	شركة ازيدك لاجهزة السلامة				
رقم السجل التجاري	٤٠٣٢٢٦٣١٤١	الرقم الموحد للمنشآت(٧)	٧٠٣١٢٩٩٨٦٥		
تاريخ الإصدار	١٤٤٥-٠٥-٢٧	تاريخ الإنتهاء	١٤٤٨-٠٥-٢٧	منطقة مزاولة النشاط	الطائف
النشاط المرخص	البيع بالتجزئة لمعدات الإطفاء والإنقاذ				
الأجهزة والمعدات					

تشهد الهيئة العليا للأمن الصناعي بأن المنشأة الموضحة أعلاه قد أستوفت كافة الإجراءات والإشتراطات النظامية لمزاولة النشاط الموضح أعلاه وقد أصدرت لها هذه الرخصة كمنشأة مصرح لها لمزاولة النشاط المذكور.

* للتحقق من صلاحية الرخصة الرجاء الدخول على منصة الهيئة العليا للأمن الصناعي https://hcis.gov.sa
* يتطلب وجود النشاط في السجل التجاري المذكور أعلاه، على ان يكون السجل التجاري ساري المفعول

المملكة العربية السعودية
وزارة الداخلية
الهيئة العليا للأمن الصناعي
إدارة التراخيص الأمنية المركزية

رؤية VISION 2030
المملكة العربية السعودية
KINGDOM OF SAUDI ARABIA

رخصة مزاولة نشاط

رقم الرخصة : ٢٣٠٢١٠٧٩٣٦٧

الإسم التجاري	شركة أزيدك لأجهزة السلامة			
رقم السجل التجاري	٤٠٣٠٢٦٧٤١٠	الرقم الموحد للمنشآت(٧)	٧٠١٢٠٢٥٥٦٠	
تاريخ الإصدار	١٤٤٤-٠٨-٠٦	تاريخ الإنتهاء	١٤٤٧-٠٨-٠٦	منطقة مزاولة النشاط	جدة
النشاط المرخص	تركيب وصيانة أجهزة ومعدات الإطفاء			
الأجهزة والمعدات				

تشهد إدارة التراخيص الأمنية المركزية بأن المنشأة الموضحة أعلاه قد أستوفت كافة الإجراءات والإشتراطات النظامية لمزاولة النشاط الموضح أعلاه وقد أصدرت لها هذه الرخصة كمنشأة مصرح لها لمزاولة النشاط المذكور.

أمين عام الهيئة العليا للأمن الصناعي
عقيد مهندس/ عادل بن زايد العتيبي

* للتحقق من صلاحية الرخصة الرجاء الدخول على منصة الهيئة العليا للأمن الصناعي https://hcis.gov.sa
* يتطلب وجود النشاط في السجل التجاري المذكور أعلاه، على ان يكون السجل التجاري ساري المفعول

المملكة العربية السعودية
وزارة الداخلية
الهيئة العليا للأمن الصناعي
إدارة التراخيص الأمنية المركزية

رؤية VISION 2030
المملكة العربية السعودية
KINGDOM OF SAUDI ARABIA

رخصة مزاولة نشاط

رقم الرخصة : ٢٣٠٢٢٠٧٨٤٤٥

الإسم التجاري	شركة أزيدك لأجهزة السلامة			
رقم السجل التجاري	٤٠٣٠٢٦٧٤١٠	الرقم الموحد للمنشآت(٧)	٧٠١٢٠٢٥٥٦٠	
تاريخ الإصدار	١٤٤٤-٠٧-١١	تاريخ الإنتهاء	١٤٤٧-٠٧-١١	منطقة مزاولة النشاط	جدة
النشاط المرخص	تركيب وصيانة أجهزة ومعدات الإنذار من الحريق			
الأجهزة والمعدات				

تشهد إدارة التراخيص الأمنية المركزية بأن المنشأة الموضحة أعلاه قد أستوفت كافة الإجراءات والإشتراطات النظامية لمزاولة النشاط الموضح أعلاه وقد أصدرت لها هذه الرخصة كمنشأة مصرح لها لمزاولة النشاط المذكور.

أمين عام الهيئة العليا للأمن الصناعي
عقيد مهندس/ عادل بن زايد العتيبي

وزارة الداخلية
الأمانة العامة
الهيئة العليا للأمن الصناعي

* للتحقق من صلاحية الرخصة الرجاء الدخول على منصة الهيئة العليا للأمن الصناعي https://hcis.gov.sa
* يتطلب وجود النشاط في السجل التجاري المذكور أعلاه، على ان يكون السجل التجاري ساري المفعول

المملكة العربية السعودية
وزارة الداخلية
الهيئة العليا للأمن الصناعي
إدارة التراخيص الأمنية المركزية

رؤية VISION 2030
المملكة العربية السعودية
KINGDOM OF SAUDI ARABIA

رخصة مزاولة نشاط

رقم الرخصة : ٢٣٥١٠٠٧٧٣٣٢

الإسم التجاري	شركة أزيدك لأجهزة السلامة			
رقم السجل التجاري	٤٠٣٠٢٦٧٤١٠	الرقم الموحد للمنشآت(٧)	٧٠١٢٠٢٥٥٦٠	
تاريخ الإصدار	١٤٤٤-٠٦-٢٦	تاريخ الإنتهاء	١٤٤٧-٠٦-٢٦	منطقة مزاولة النشاط	جدة
النشاط المرخص	البيع بالجملة لأجهزة ومعدات ومواد الوقاية والحماية من الحريق			
الأجهزة والمعدات				

تشهد إدارة التراخيص الأمنية المركزية بأن المنشأة الموضحة أعلاه قد أستوفت كافة الإجراءات والإشتراطات النظامية لمزاولة النشاط الموضح أعلاه وقد أصدرت لها هذه الرخصة كمنشأة مصرح لها لمزاولة النشاط المذكور.

أمين عام الهيئة العليا للأمن الصناعي

عقيد مهندس/ عادل بن زايد العتيبي

* للتحقق من صلاحية الرخصة الرجاء الدخول على منصة الهيئة العليا للأمن الصناعي https://hcis.gov.sa
* يتطلب وجود النشاط في السجل التجاري المذكور أعلاه، على ان يكون السجل التجاري ساري المفعول

المملكة العربية السعودية
الهيئة العليا للأمن الصناعي

الهيئة العليا للأمن الصناعي
High Commission For Industrial Security

رؤية VISION 2030
المملكة العربية السعودية
KINGDOM OF SAUDI ARABIA

رخصة مزاولة نشاط

رقم الرخصة : ٢٤٥٠٦١١١٧٢٣

الإسم التجاري	شركة أزيدك لاجهزة السلامة			
رقم السجل التجاري	٤٠٣٠٥٥٣١٦٧	الرقم الموحد للمنشآت(٧)	٧٠٣٨٨٧٧١٤٣	
تاريخ الإصدار	١٤٤٥-١٠-٢٨	تاريخ الإنتهاء	١٤٤٨-١٠-٢٨	منطقة مزاولة النشاط	جدة
النشاط المرخص	تركيب وصيانة الأجهزة الأمنية			
الأجهزة والمعدات	كاميرات المراقبة الأمنية, أنظمة الدوائر التليفزيونية المغلقة, أجهزة وأنظمة الإنذار ضد السرقة, أجهزة وبوابات الكشف عن المعادن, أجهزة تفتيش الحقائب والطرود, أجهزة بوابات الدخول والخروج بالبطاقات الممغنطة والبصمة, السياج الأمني			

تشهد الهيئة العليا للأمن الصناعي بأن المنشأة الموضحة أعلاه قد أستوفت كافة الإجراءات والإشتراطات النظامية لمزاولة النشاط الموضح أعلاه وقد أصدرت لها هذه الرخصة كمنشأة مصرح لها لمزاولة النشاط المذكور.

الهيئة العليا للأمن الصناعي
High Commission For Industrial Security

* للتحقق من صلاحية الرخصة الرجاء الدخول على منصة الهيئة العليا للأمن الصناعي https://hcis.gov.sa
* يتطلب وجود النشاط في السجل التجاري المذكور أعلاه، على ان يكون السجل التجاري ساري المفعول

المملكة العربية السعودية
الهيئة العليا للأمن الصناعي

الهيئة العليا للأمن الصناعي
High Commission For Industrial Security

رؤية VISION 2030
المملكة العربية السعودية
KINGDOM OF SAUDI ARABIA

رخصة مزاولة نشاط

رقم الرخصة : ٢٣٥١٣١٠١٦٣٢

الإسم التجاري	شركة ازيدك لاجهزة السلامة				
رقم السجل التجاري	٤٠٣٢٢٦٣١٤١	الرقم الموحد للمنشآت(٧)	٧٠٣١٢٩٩٨٦٥		
تاريخ الإصدار	١٤٤٥-٠٥-٢٧	تاريخ الإنتهاء	١٤٤٨-٠٥-٢٧	منطقة مزاولة النشاط	الطائف
النشاط المرخص	البيع بالتجزئة لمعدات الإطفاء والإنقاذ				
الأجهزة والمعدات					

تشهد الهيئة العليا للأمن الصناعي بأن المنشأة الموضحة أعلاه قد أستوفت كافة الإجراءات والإشتراطات النظامية لمزاولة النشاط الموضح أعلاه وقد أصدرت لها هذه الرخصة كمنشأة مصرح لها لمزاولة النشاط المذكور.

* للتحقق من صلاحية الرخصة الرجاء الدخول على منصة الهيئة العليا للأمن الصناعي https://hcis.gov.sa
* يتطلب وجود النشاط في السجل التجاري المذكور أعلاه، على ان يكون السجل التجاري ساري المفعول

المملكة العربية السعودية
الهيئة العليا للأمن الصناعي

الهيئة العليا للأمن الصناعي
High Commission For Industrial Security

رؤية VISION 2030
المملكة العربية السعودية
KINGDOM OF SAUDI ARABIA

رخصة مزاولة نشاط

رقم الرخصة : ٢٣٠٢٢١٠٢٠٠٣

الإسم التجاري	شركة ازيدك لاجهزة السلامة				
رقم السجل التجاري	٤٠٣٢٢٦٣١٤١	الرقم الموحد للمنشآت(٧)	٧٠٣١٢٩٩٨٦٥		
تاريخ الإصدار	١٤٤٥-٠٦-٠١	تاريخ الإنتهاء	١٤٤٨-٠٦-٠١	منطقة مزاولة النشاط	الطائف
النشاط المرخص	تركيب وصيانة أجهزة ومعدات الإنذار من الحريق				
الأجهزة والمعدات					

تشهد الهيئة العليا للأمن الصناعي بأن المنشأة الموضحة أعلاه قد أستوفت كافة الإجراءات والإشتراطات النظامية لمزاولة النشاط الموضح أعلاه وقد أصدرت لها هذه الرخصة كمنشأة مصرح لها لمزاولة النشاط المذكور.

* للتحقق من صلاحية الرخصة الرجاء الدخول على منصة الهيئة العليا للأمن الصناعي https://hcis.gov.sa
* يتطلب وجود النشاط في السجل التجاري المذكور أعلاه، على ان يكون السجل التجاري ساري المفعول

المملكة العربية السعودية
وزارة الداخلية
الهيئة العليا للأمن الصناعي
إدارة التراخيص الأمنية المركزية

رؤية VISION 2030
المملكة العربية السعودية
KINGDOM OF SAUDI ARABIA

رخصة مزاولة نشاط

رقم الرخصة : ٢٣٥١١٠٨٢٧٠٨

الإسم التجاري	شركة أزيدك لاجهزة السلامة			
رقم السجل التجاري	٢٠٥٠١٦٨٠٢٥	الرقم الموحد للمنشآت(٧)	٧٠٣٣٨١٠٣٦٢	
تاريخ الإصدار	١٤٤٤-٠٩-٢٠	تاريخ الإنتهاء	١٤٤٧-٠٩-٢٠	منطقة مزاولة النشاط	الدمام
النشاط المرخص	البيع بالتجزئة لأجهزة ومعدات ومواد الوقاية والحماية من الحريق			
الأجهزة والمعدات				

تشهد إدارة التراخيص الأمنية المركزية بأن المنشأة الموضحة أعلاه قد أستوفت كافة الإجراءات والإشتراطات النظامية لمزاولة النشاط الموضح أعلاه وقد أصدرت لها هذه الرخصة كمنشأة مصرح لها لمزاولة النشاط المذكور.

أمين عام الهيئة العليا للأمن الصناعي

عقيد مهندس/ عادل بن زايد العتيبي

وزارة الداخلية - الأمانة العامة - الهيئة العليا للأمن الصناعي

* للتحقق من صلاحية الرخصة الرجاء الدخول على منصة الهيئة العليا للأمن الصناعي https://hcis.gov.sa
* يتطلب وجود النشاط في السجل التجاري المذكور أعلاه، على ان يكون السجل التجاري ساري المفعول

وزارة الشؤون البلدية والقروية والإسكان
Ministry of Municipal Rural Affairs & Housing

بلدي
balady

رقم الشهادة 2022030862

تاريخ الاصدار 2022/04/25

اعتماد*

شهادة اعتماد
تصنيف مقدمي خدمات المدن

تمنح وزارة الشؤون البلدية والقروية والاسكان شهادة الاعتماد*

للمنشأة	مؤسسة ازيدك للمقاولات العامه

في قطاع التشييد والبناء

السجل التجاري	4030244617
النشاط	الإنشاءات العامة للمباني السكنية,الإنشاءات العامة للمباني الغير السكنية ، يشمل,(المدارس ، المستشفيات، الفنادق ...الخ)الإنشاءات العامة للمباني الحكومية,ترميمات المباني السكنية والغير سكنية

- يسري مفعول هذه الشهادة حتى تاريخ 04/10/1444 هـ / الموافق 25/04/2023 م
- تصدر هذه الشهادة الكترونياً وعلى الجهات المالكة للمشاريع التحقق من الشهادة المقدمة من خلال موقع الوزارة

وكيل الوزارة لتصنيف المقاولين
د. أحمد بن جميل قطان

تصنيف
مقدمي خدمات المدن

* هذه الشهادة منحت بغرض اصدار وثيقة التأمين ضد العيوب الخفية و الدخول في المنافسات الحكومية الأقل من قيمة مشاريع الدرجة الخامسة.

وزارة الشؤون البلدية والقروية والإسكان
بلدي balady
تنظيم مشغلي المدن

شهـــادة

تصنيف مقدمي خدمات المدن

تمنح وزارة الشؤون البلدية والقروية والإسكان شهادة تصنيف بالدرجة

الدرجة الأولى

للمنشأة: شركة ازيدك للمقاولات العامه

بيانات المنشأة

الرقم الوطني الموحد/ الترخيص	تاريخ إصدار السجل التجاري/ الترخيص	اسم مالك المنشأة	نوع المنشأة	جنسية المنشأة	رأس المال
7014126267	15/04/2013	غازي جابر درويش القحطاني	ذات مسئولية محدودة	سعودي	100000.0

بيانات شهادة التصنيف

رقم الشهادة	تاريخ الإصدار	درجة التقييم الائتماني	درجة التقييم الفني
2024005747	29/05/2024	BBB+	88.55

أنشطة شهادة التصنيف

المجال	الأنشطة
التشييد والبناء	الإنشاءات العامة للمباني السكنية,الإنشاءات العامة للمباني الغير السكنية ، يشمل,(المدارس ، المستشفيات، الفنادق ...الخ) الإنشاءات العامة للمباني الحكومية, ترميمات المباني السكنية والغير سكنية

- يسري مفعول هذه الشهادة حتى تاريخ 29/05/2026
- تصدر هذه الشهادة الكترونيا وعلى الجهات المالكة للمشاريع التحقق من الشهادة المقدمة من خلال موقع الوزارة.

وكيل الوزارة لتنظيم مشغلي المدن
عبدالرحمن بن أحمد العريني